

N90845.PF.001805  
NWIRP BETHPAGE  
5090.3b

QUARTERLY OPERATIONS REPORT FIRST QUARTER 2015 GROUNDWATER  
TREATMENT PLANT GM-38 AREA GROUNDWATER REMEDIATION NWIRP BETHPAGE NY  
10/01/2015  
H & S ENVIRONMENTAL INC

**Quarterly Operations Report  
First Quarter 2015**

**Groundwater Treatment Plant  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant  
Bethpage, New York**

**Contract No. N40085-10-D-9409  
Contract Task Order No. 0002**

October 2015

Prepared for:



Naval Facilities Engineering Command Mid-Atlantic  
9742 Maryland Avenue  
Norfolk, VA 23511

Prepared by:



**H&S Environmental, Inc.  
160 East Main Street, Suite 2F  
Westborough, Massachusetts 01581  
(508) 366-7442**

**Quarterly Operations Report  
First Quarter 2015**

**Groundwater Treatment Plant  
GM-38 Area Groundwater Remediation  
Naval Weapons Industrial Reserve Plant  
Bethpage, New York**

**Contract No. N40085-10-D-9409  
Contract Task Order No. 0002**

**October 2015**

Prepared for:

Naval Facilities Engineering Command Mid-Atlantic  
9742 Maryland Avenue  
Norfolk, VA 23511



---

Patrick Schuble  
Program Manager

10/9/15

Date

---

Jennifer Good  
Project Manager

10/9/15

Date

## TABLE OF CONTENTS

<b>1.0</b>	<b>INTRODUCTION.....</b>	<b>1-1</b>
1.1	Background.....	1-1
1.2	GWTP Overview .....	1-2
<b>2.0</b>	<b>GWTP OPERATIONS AND MAINTENANCE.....</b>	<b>2-1</b>
2.1	Routine Maintenance Activities .....	2-1
2.2	Non-routine Maintenance / Site Activities .....	2-1
<b>3.0</b>	<b>GWTP MONITORING.....</b>	<b>3-1</b>
3.1	Process Water Quality Monitoring .....	3-1
3.2	Air Quality Monitoring.....	3-1
3.3	Groundwater Quality Monitoring .....	3-2
3.3.1	Groundwater Quality Results .....	3-3
3.3.2	Quality Assurance/Quality Control Sampling.....	3-3
3.3.3	Groundwater Concentration Trends .....	3-4
<b>4.0</b>	<b>CONCLUSIONS AND RECOMMENDATIONS.....</b>	<b>4-1</b>
<b>5.0</b>	<b>REFERENCES.....</b>	<b>5-1</b>

## TABLES

TABLE 1	Discharge Monitoring Results – First Quarter 2015
TABLE 2	Air Sampling Results – First Quarter 2015
TABLE 3	Stack Emissions – First Quarter 2015
TABLE 4	Groundwater Level Measurements – First Quarter 2015
TABLE 5	Summary of Groundwater Chemistry Results – First Quarter 2015
TABLE 6	Summary of Groundwater Analytical Results – First Quarter 2015
TABLE 7	Summary of Historical Groundwater Analytical Results through First Quarter 2015

## FIGURES

FIGURE 1	Site Map
FIGURE 2	Process Flow Diagram
FIGURE 3	GM-38 Area Site Map
FIGURE 4	First Quarter 2015 Groundwater Analytical Map – Select VOC Concentrations
FIGURE 5	Groundwater Concentrations Trends of Select VOCs – RW-1
FIGURE 6	Groundwater Concentrations Trends of Select VOCs – RW-3
FIGURE 7	Groundwater Concentrations Trends of Select VOCs - RW1-MW1

- FIGURE 8 Groundwater Concentrations Trends of Select VOCs - RW1-MW3
- FIGURE 9 Groundwater Concentrations Trends of Select VOCs - RW2-MW1
- FIGURE 10 Groundwater Concentrations Trends of Select VOCs - RW3-MW1
- FIGURE 11 Groundwater Concentrations Trends of Select VOCs – RW3-MW2
- FIGURE 12 Groundwater Concentrations Trends of Select VOCs – RW3-MW3
- FIGURE 13 Groundwater Concentrations Trends of Select VOCs – RW3-MW4
- FIGURE 14 Groundwater Concentrations Trends of Select VOCs - TP-01

## **APPENDICES**

- APPENDIX A NYSDEC Effluent Limitations and Monitoring Requirements and January 2015 – March 2015 DMRs
- APPENDIX B NYSDEC Air Discharge Limit Documentation
- APPENDIX C Field Logs and Chain of Custody Documentation – First Quarter 2015
- APPENDIX D Data Validation – First Quarter 2015

## Acronyms and Abbreviations

ARAR	Applicable or Relevant and Appropriate Requirement
AS	air stripper
ASE	air stripper effluent
BFE	bag filter effluent
bgs	below ground surface
CERCLA	Comprehensive Environmental Response Compensation and Liability Act
DAR	Division of Air Resources
DCA	dichloroethane
DCE	dichloroethene
DMR	Discharge Monitoring Report
DO	dissolved oxygen
DoD	Department of Defense
DTW	depth to water
ECL	Environmental Conservation Law
EB	equipment rinsate blank
ELAP	Environmental Laboratory Accreditation Program
GOCO	Government Owned Contractor Operated
gpm	gallon per minute
GWTP	groundwater treatment plant
H&S	H&S Environmental, Inc.
HMI	human-machine interface
IRP	Installation Restoration Program
LGAC	liquid-phase granular activated carbon
MS/MSD	matrix spike/matrix spike duplicate
NAVFAC	Naval Facilities Engineering Command Mid-Atlantic
NELAC	National Environmental Accreditation Conference
NG	Northrop Grumman
NWIRP	Naval Weapons Industrial Reserve Plant
NYSDEC	New York State Department of Environmental Conservation
NYSDOH	New York State Department of Health
O&M	Operation and Maintenance
ORP	oxidation reduction potential
OU	operable unit

PCE	tetrachloroethene
PLC	programmable logic controller
QA/QC	quality assurance / quality control
ROD	Record of Decision
RPD	relative percent difference
SC	standard conductivity
scfm	standard cubic feet per minute
SPDES	Storm Pollution Discharge Elimination System
TB	trip blank
TCE	trichloroethene
TE	treated effluent
TSS	total suspended solids
TtEC	Tetra Tech EC, Inc.
USEPA	U.S. Environmental Protection Agency
VC	vinyl chloride
VGAC	vapor-phase granular activated carbon
VOC	volatile organic compound

## 1.0 INTRODUCTION

H&S Environmental, Inc. (H&S) has prepared this Quarterly Operations Report for the GM-38 Area Groundwater Treatment Plant (GWTP) at the Naval Weapons Industrial Reserve Plant (NWIRP) in Bethpage, New York. This report has been prepared for the U.S. Department of the Navy (Navy), Naval Facilities Engineering Command (NAVFAC), Mid-Atlantic, under Contract No. N40085-10-D-9409, Contract Task Order No. 0002. This First Quarter 2015 Operations Report details activities that occurred from January 2015 to March 2015. Data was collected and operational activities were performed by H&S in accordance with the following documents:

- *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by Tetra Tech EC, Inc. (TtEC) in 2010, hereafter referred to as the “O&M Manual.”
- *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by TtEC in 2010.

### 1.1 Background

NWIRP Bethpage is located in east central Nassau County, Long Island, New York, approximately 30 miles east of New York City (**Figure 1**) and is currently listed by New York State Department of Environmental Conservation (NYSDEC) as an “inactive hazardous waste site” (#1-30-003B). In the late 1990s, the Navy's property totaled approximately 109.5 acres and was a Government Owned Contractor-Operated (GOCO) facility that was operated by Northrop Grumman (NG) until September 1998. NWIRP Bethpage was bordered on the north, west, and south by property owned, or formerly owned, by NG that covered approximately 550 acres, and on the east by a residential neighborhood.

The GM-38 Area refers to a cluster of monitoring wells installed in the 1990s by NG. The GM-38 Area is approximately 8,500 feet south, southeast and hydraulically downgradient of NWIRP Bethpage. The GWTP is located within a utility easement with a street address of 100 Broadway, Bethpage, NY.

The “hot spot” cleanup remedy for the GM-38 Area groundwater was originally set forth in Record of Decision (ROD) documents for Operable Unit 2 (OU 2) Groundwater for the NG and NWIRP Sites (New York State Registry Site Numbers 1-30-003A & 1-30-003B, respectively) issued by NYSDEC Division of Environmental Remediation in March 2001 and for the NWIRP Bethpage Site by NAVFAC in April 2003 (Revision 1). The selected remedy was chosen in accordance with the New York State Environmental Conservation Law (ECL) and the Navy's Installation Restoration Program (IRP). It is also consistent with the Comprehensive Environmental Response Compensation and Liability Act (CERCLA), as amended, 42 U.S.C. §§ 9601-9675.

## 1.2 GWTP Overview

Groundwater is extracted from recovery wells RW-1 and RW-3 and treated in the GWTP. The treatment process consists of flow equalization, air stripping and vapor-phase carbon treatment, bag filtration, and liquid-phase carbon treatment. Though the GWTP was originally equipped with a pH adjustment system utilizing sodium hydroxide, it has since been determined that pH adjustment is not necessary and the equipment has been taken off-line and sodium hydroxide sent off site for beneficial reuse. A process flow diagram is presented as **Figure 2**. The treated water is either re-injected into injection well IW-1 or discharged into the Nassau County Recharge Basin #495. Under CERCLA, the Navy is required to meet the effluent requirement in the NYSDEC's Storm Pollution Discharge Elimination System (SPDES) Permit Application as an Applicable or Relevant and Appropriate Requirements (ARAR).

The GWTP was designed to operate at an average flow rate of 1,100 gallons per minute (gpm) (800 gpm from RW-1 and 300 gpm from RW-3), as measured by the average discharge flow rate. It was determined that this flow rate would be necessary to effectively contain the higher concentration of contamination in the GM-38 Area groundwater. Volatile Organic Compounds (VOCs) in the influent groundwater consist of trichloroethene (TCE), tetrachloroethene (PCE), vinyl chloride (VC), cis-1,2-dichloroethene (cis-1,2-DCE), 1,2-dichloroethane (1,2-DCA), benzene, toluene, and total xylenes.

The air stripper (AS) is a structural aluminum tower that is packed with 3.5-inch diameter polypropylene Jaeger Tripack. Groundwater is pumped to the air stripper distribution port and sprayed over the column of Jaeger Tripack at a flow rate of approximately 1,100 gpm. Previously, 100 gpm of recirculated water was also rerouted through the AS, but as of October 2010, recirculation was no longer deemed necessary to the operation of the system. An induced draft countercurrent flow of air enters the air stripper below the base of the packing material at a rate of 8,000 standard cubic feet per minute (scfm). The large surface area of the packing material allows for a mass transfer of the VOCs from the groundwater into the air stream. The VOCs in the off-gas, except for vinyl chloride, are removed via two 20,000-lb vapor phase granular activated carbon (VGAC) units (VGAC-1 and VGAC-2). Vinyl chloride is oxidized by a 20,000-lb vessel containing zeolite impregnated with potassium permanganate (VGAC-3) into potassium chloride and carbon dioxide. The potassium chloride remains in the pore structure of the zeolite substrate. The treated off-gas is discharged from the stack.

Water treated by the air stripper is subsequently processed through three 8,000-lb liquid phase granular activated carbon (LGAC) units in parallel prior to discharge in the recovery basin (or injection well, if necessary. To date, no water has been discharged to the injection well).

The GWTP is controlled by a programmable logic controller (PLC)-based digital and analog control system, with instrumentation that monitors pH, pressure, tank level, flow transmitters, differential pressure transmitters, water level in recovery wells, and motor operational status. The information in the PLC is made available to an operator via a human-machine interface (HMI) program. By using this program, the status of the GWTP can be displayed in real time and adjusted, if necessary, by the operator.

A recent evaluation of the GM-38 Area, conducted in order to better determine the capture zone of the recovery wells, recommended that use of recovery well RW-3 be discontinued. The report entitled

*“Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant”* (Tetra Tech 2014) was submitted to NYSDEC in March 2014 and stated, “When RW01 and RW03 were pumped together, there was no noticeable additive influence on the drawdown in shallower monitoring wells, indicating that in the shallower portions of the GM-38 Area groundwater, RW01 operation is sufficient.” This recommendation was later approved and implemented on 1 July 2015. Both RW-1 and RW-3 were in operation during this First Quarter 2015 reporting period.

## 2.0 GWTP OPERATIONS AND MAINTENANCE

While designed to run completely automated, the GWTP requires regular weekly visits by an operator to record and adjust operational parameters and to perform scheduled maintenance. The GWTP is equipped with telemetry that will alert an on-call operator in the event of a plant shutdown.

### 2.1 Routine Maintenance Activities

Routine maintenance activities at the GWTP were performed during the operator's visits. These activities include general site inspections, collection of operational data (water and vapor flowrates, differential pressures across the AS, carbon units, bag filter units and blower discharge pressures, tank levels and totalizer readings), measurement of water levels in the recovery wells, adjustment of pump signal settings, collection of vapor and process water samples, changing out of bag filters, switching of lead/lag pump assignments, and preventive maintenance of system equipment. In addition, the following maintenance tasks were also performed during this reporting period:

- On 25 February, the annual backflow preventer inspection was performed. Results were submitted to Bethpage Water District and New York State Department of Health (NYSDOH), as required.
- On 9 January, 26 January, 9 February, 20 February, 2 March, and 23 March, bag filters were changed out.
- On 2 March, the system was shut down in order to backwash the three LGAC units.

### 2.2 Non-routine Maintenance / Site Activities

The following non-routine activities occurred during the First Quarter:

- On 15 January, indoor air samples were collected from the GWTP; results were provided under separate cover.
- On 23 January, new air relief valves were installed on the two bag filter units.
- On 28 January, a new air relief valve was installed on the effluent piping.
- On 11 March, an instrumentation contractor was on site to disable the in-line effluent pH meter, as it was not operable and determined not to be necessary for system operations since the pH adjustment system is no longer in operation. Effluent pH will continue to be monitored on a regular basis using a handheld pH meter, and the in-line meter will not be replaced. In addition, an issue with the Kepware software was resolved, and the water level probe for RW-1 was pulled, cleaned to improve performance, and reinstalled in the recovery well.

### 3.0 GWTP MONITORING

The intent of the GWTP is to remove contaminant mass and reduce elevated VOC levels to levels similar to those in the surrounding aquifer. It is anticipated that GWTP operation will minimize contaminant impacts on water supply wells and currently unaffected portions of the groundwater aquifer. The GWTP is not intended to remediate groundwater contamination in the local aquifer to non-detectable levels (TtEC 2010). Various process samples (water and vapor) are collected on a monthly basis to monitor GWTP efficiency and to ensure compliance with Federal and State effluent discharge and air emission requirements. In addition, groundwater samples are collected semi-annually to monitor water quality and determine the effectiveness of the remediation activities and monitor the hydraulic containment and capture of impacted groundwater by the recovery wells.

#### 3.1 Process Water Quality Monitoring

Processed groundwater is analyzed to comply with calculations submitted by the Navy and approved by NYSDEC Water Division for the effluent limitations and monitoring requirements. These results are also submitted to the NYSDEC on a monthly basis in the form of a Discharge Monitoring Report (DMR). A copy of the approved NYSDEC effluent limitation and monitoring constituents and the reporting forms are included in **Appendix A**.

Monthly aqueous samples are collected from each recovery well (RW-1 and RW-3), as well as the treated effluent (TE) discharge line. In addition, various intermediary process system samples are collected monthly, consisting of air stripper effluent (ASE), bag filter effluent (BFE), and effluent of each of the three LGAC units (LC1, LC2, and LC3). The analytical results of monthly process water samples collected during the First Quarter are presented in **Table 1**. The data demonstrates that all permitted constituents were in compliance with regulatory requirements during the First Quarter. **Table 1** also summarizes the average monthly flowrates in gallons per minute along with the total volume of water processed during each month of the First Quarter.

Monthly DMRs for the First Quarter (January – March 2015) are included in **Appendix A**.

#### 3.2 Air Quality Monitoring

Treated off-gas discharged at the stack of the GWTP is subject to emissions limitations. Original discharge goals were derived from calculations submitted by the Navy and approved by the NYSDEC Division of Air Resources (DAR) in July 2009. In November 2011, the Navy submitted an evaluation proposing revised discharge goals, which NYSDEC approved in October 2013. A copy of this documentation is included as **Appendix B**.

While only sampling of the stack emissions is required for NYSDEC compliance, process vapor samples are also collected using 6-L summa canisters at various locations to monitor for breakthrough of the VGAC units. The analytical results of monthly influent and effluent vapor samples as well as midfluent samples (VC12 and VC13) collected during the First Quarter are presented in **Table 2**. Air emissions calculations using the stack vapor concentrations along with discharge flowrates are presented in **Table 3**.

The calculations demonstrate that all constituents were within the regulatory requirements during the First Quarter based on the calculated emission rates.

### 3.3 Groundwater Quality Monitoring

The groundwater monitoring well system at the GM-38 Groundwater Remediation Area consists of fourteen monitoring wells (as summarized in **Table 4**), three recovery wells (RW-1, RW-2, RW-3) and one injection well (IW-1). Though RW-2 was installed in 2005, a pump was never installed in this well and the well is not operated as a recovery well due to concerns expressed by the Bethpage Water District. Well locations are depicted on **Figure 3**.

Depth to water (DTW) measurements are collected from twelve of the monitoring wells on a quarterly basis. Prior to 2014, water quality samples were collected from eight of the monitoring wells on a quarterly basis; beginning in 2014, the sample collection frequency was reduced to semi-annually, with sample collection generally in the March and September time-frame. The monitoring network includes well clusters located near the recovery and injection wells as described below and as shown on **Figure 3**. In addition, two wells, GM-38D and GM-38D2, located at the corner of Arthur Avenue and Broadway, are monitored by others.

Semi-annual groundwater samples were collected from eight monitoring wells (RW1-MW1, RW1-MW3, RW2-MW1, RW3-MW1, RW3-MW2, RW3-MW3, RW3-MW4, and TP-01). Samples were collected using bladder pumps in accordance with the U.S. Environmental Protection Agency (USEPA) low-flow sampling methodologies. Results of the groundwater sampling for the First Quarter are presented in Section 3.3.1 below, and descriptions of monitoring well locations are as follows:

#### Recovery Well 1 (RW-1) Monitoring Wells

The RW-1 cluster consists of three monitoring wells screened between 395 and 435 feet below ground surface (bgs). RW1-MW1 is located approximately 140 feet northwest of RW-1 and RW1-MW2 is located approximately 50 feet north of RW-1. RW1-MW3 is located approximately 400 feet northeast of RW-1, on the eastern side of Seaford Oyster Bay Expressway. All three wells are hydraulically monitored while only RW1-MW1 and RW1-MW3 are also monitored for water quality.

#### Recovery Well 2 (RW-2) Monitoring Wells

The RW-2 cluster consists of three monitoring wells screened between 470 and 510 feet bgs. RW2-MW1 is located approximately 60 feet northwest of RW-2, RW2-MW2 is located approximately 20 feet west of RW-2, and RW2-MW3 is located approximately 100 feet west of RW-2. All three wells are hydraulically monitored while only RW2-MW1 is monitored for water quality.

#### Recovery Well 3 (RW-3) Monitoring Wells

The RW-3 cluster consists of four monitoring wells. RW3-MW1 and RW3-MW4 are screened between 475 and 495 feet bgs. RW3-MW2 and RW3-MW3 are screened between 330 and 350 feet bgs and 320 and 340 feet bgs, respectively. RW3-MW1 and RW3-MW2 are located approximately 500 feet west of the GM-38 cluster, at the intersection of Arthur Avenue and Leroy Avenue. RW3-MW3 and RW3-MW4 are located approximately 400 feet north of the intersection of Arthur Avenue and Broadway. All four wells are both hydraulically monitored and monitored for water quality.

### TP-01

TP-01 is screened between 450 and 470 feet bgs and is located approximately 25 feet north of the GWTP building, inside the fenced area. It is hydraulically monitored to observe the change in water levels due to the influence from the pumping rates at the neighboring public water supply well field near the hot spot area and is also monitored for water quality.

### Injection Well 1 (IW-1) Monitoring Well

There is one monitoring well associated with injection well IW-1. IW1-MW1 is screened between 20 and 150 feet bgs, is located approximately 20 feet south of IW-1, and is only hydraulically monitored on a quarterly basis.

#### **3.3.1 Groundwater Quality Results**

H&S collected groundwater samples for the First Quarter from 25-26 March 2015. Field parameters measured during well purging, consisting of pH, specific conductance (SC), temperature, oxidation-reduction potential (ORP) and dissolved oxygen (DO), are summarized in **Table 5**. Following stabilization of field parameters, groundwater samples were collected. Copies of the field logs and chain of custody documentation are presented in **Appendix C**.

Groundwater samples were submitted to a National Environmental Laboratory Accreditation Conference (NELAC), Department of Defense (DoD) Environmental Laboratory Accreditation Program (ELAP) certified, laboratory, Analytical Laboratories Services, located in Middletown, PA. The samples were analyzed for VOCs via USEPA Method 624, mercury via USEPA Method 245.1, and total suspended solids (TSS) via USEPA Method SM20 2540D. Validated analytical sampling results collected during the First Quarter monitoring event are summarized in **Table 6**. Data validation reports are presented in **Appendix D**. Raw analytical data is provided under separate cover.

#### **3.3.2 Quality Assurance/Quality Control Sampling**

Quality assurance/quality control (QA/QC) samples were collected during the semi-annual groundwater monitoring event in accordance with the *Final Sampling and Analysis Plan* (TtEC 2010a). These samples consisted of blind field duplicates (collected from RW3-MW3 during the First Quarter), matrix spike/matrix spike duplicate (MS/MSD) samples, equipment rinsate blanks (EB) collected at a rate of one per sampling event, and trip blanks (TB) submitted at a rate of one per sample cooler. No contaminants were detected in the equipment blank or trip blank submitted for this event. The overall lack of contamination in the blanks indicates that quality control requirements were achieved.

For field duplicate samples, the precision between the original sample and its duplicate is evaluated by calculating the relative percent difference (RPD). RPDs for the First Quarter sampling event are presented in the data validation report in **Appendix D**. As indicated, RPDs for all analytes were well below the guideline of 50%. This overall consistency between the samples and its duplicate verifies that proper sample collection methods were followed.

### 3.3.3 Groundwater Concentration Trends

Historical groundwater analytical results through the First Quarter are presented in **Table 7**. Groundwater analytical results of select VOCs (cis-1,2-DCE, PCE, TCE, and VC) for the First Quarter monitoring event are presented graphically as **Figure 4**. Additionally, concentration trends of select VOCs (cis-1,2-DCE, TCE, and PCE, as well as VC for RW-1) over time for each recovery well (RW-1 and RW-3 sampled monthly) and the eight monitoring wells sampled during the First Quarter monitoring event are presented in **Figures 5 through 14** and discussed below.

**Figure 5** presents concentrations detected at recovery well RW-1. Concentrations of TCE have decreased from initial concentrations in early 2010 (maximum value of 710 µg/L detected in February 2010), remaining around or below 300 µg/L since the latter half of 2012. During the First Quarter 2015, concentrations ranged from 154-189 µg/L. Concentrations of cis-1,2-DCE have followed a similar trend, decreasing from a high of 160 µg/L in February 2010 to a low of 15.5 µg/L in January 2015. PCE concentrations have also exhibited decreasing trends over time, with concentrations decreasing from 180 µg/L in February 2010 to a low of 33.3 µg/L in December 2014. Concentrations of VC have decreased below initial concentrations in 2010. After reaching a maximum concentration of 61 µg/L in February 2010, VC concentrations have remained below 5.0 µg/L since the final quarter of 2011 and below 1.0 µg/L since June 2013.

**Figure 6** presents concentrations detected at recovery well RW-3. Concentrations of TCE have decreased from initial concentrations in February 2010 (660 µg/L). During the First Quarter 2015, concentrations ranged from 215-231 µg/L. Concentrations of cis-1,2-DCE have remained consistently below 4.0 µg/L. PCE has been detected at low levels during only a few sampling events, with the most recent detection of 0.28 J µg/L in March 2014.

**Figure 7** presents concentrations detected at RW1-MW1, with the most recent data collected in First Quarter 2015. The concentration of TCE in the First Quarter 2015 (99.5 µg/L) was higher than initial concentrations observed in May 2005 (53.6 µg/L) but less than the highest concentration observed to date (175 µg/L in September 2013). No overall trend is discernible. The concentration of cis-1,2-DCE in the First Quarter 2015 (39.5 µg/L) was below the initial concentration observed in May 2005 (78.6 µg/L), below the maximum concentration observed in May 2009 (180 µg/L), and the lowest concentration observed to date. Concentrations of PCE have remained consistently below 1.0 µg/L.

**Figure 8** presents concentrations detected at RW1-MW3, with the most recent data collected in First Quarter 2015. Concentrations of cis-1,2-DCE and PCE have consistently remained below 1.0 µg/L. Concentrations of TCE have also remained consistently low, ranging from 0.58 J – 3.2 µg/L.

**Figure 9** presents concentrations detected at RW2-MW1, with the most recent data collected in First Quarter 2015. Concentrations of TCE in the First Quarter 2015 (4.3 µg/L) were less than initial concentrations observed in May 2005 (37.6 µg/L), which was also the highest TCE concentration observed to date. No overall trend is discernible. The concentration of cis-1,2-DCE observed in the First Quarter 2015 (2.6 µg/L) was above initial concentrations observed in May 2005 (non-detect) but below

the maximum concentration observed in December 2013 (11.0 µg/L). PCE has not been detected during any sampling event.

**Figure 10** presents concentrations detected at RW3-MW1, with the most recent data collected in First Quarter 2015. Concentrations of TCE in the First Quarter 2015 (41.8 µg/L) were higher than initial concentrations observed in January 2010 (35.0 µg/L), though remain less than maximum TCE concentrations observed in November 2010 (77.6 µg/L). No overall trend is discernible. Concentrations of cis-1,2-DCE and PCE have exhibited similar trends, increasing from initial concentrations, but remaining consistently near or below 2.0 µg/L (a PCE concentration of 2.2 µg/L was observed in the First Quarter 2015).

**Figure 11** presents concentrations detected at RW3-MW2, with the most recent data collected in First Quarter 2015. TCE concentrations observed in the First Quarter 2015 (159 µg/L) were similar to initial concentrations observed in January 2010 (160 µg/L), but less than the maximum concentration observed in April 2010 (211 µg/L). No overall trend is discernible. Concentrations of cis-1,2-DCE at this location have consistently remained between 1.0 – 2.0 µg/L. PCE was only detected in August 2012 and March 2014, when concentrations of 0.28 J µg/L and 0.29 J µg/L, respectively, were observed.

**Figure 12** presents concentrations detected at RW3-MW3, with the most recent data collected in First Quarter 2015. TCE concentrations observed in the First Quarter 2015 (182 µg/L) were less than initial concentrations observed in January 2010 (350 µg/L), and also less than the maximum concentration observed in June 2013 (410 µg/L). No overall trend is discernible. Concentrations of cis-1,2-DCE have remained near or below 2.0 µg/L and PCE has remained below 1.0 µg/L.

**Figure 13** presents concentrations detected at RW3-MW4, with the most recent data collected in First Quarter 2015. TCE concentrations have decreased since the initial sampling event in January 2010 (21 µg/L), with a concentration of 2.7 µg/L observed in the First Quarter 2015. PCE had not been detected during any sampling event, and cis-1,2-DCE has not been detected since the initial sampling event in January 2010 (0.46 µg/L).

**Figure 14** presents concentrations detected at TP-01, with the most recent data collected in First Quarter 2015. TCE concentrations observed in the First Quarter 2015 (52.3 µg/L) were less than initial concentrations observed in January 2010 (65 µg/L), which was also the maximum concentration observed to date. No overall trend is discernible. Concentrations of cis-1,2-DCE have generally decreased over time, from an initial value of 190 µg/L to 13.4 µg/L in the First Quarter 2015. PCE concentrations have ranged from non-detectable levels in March 2014 to 6.0 µg/L in June 2012.

## 4.0 CONCLUSIONS AND RECOMMENDATIONS

The intent of the groundwater treatment system at GM-38 is to remove mass and reduce elevated VOC concentrations to levels similar to those in the surrounding aquifer, and in doing so minimize the impacts on downgradient water supply wells and currently unaffected portions of the aquifer. Based on the removal of VOCs by the GWTP and decreasing contaminant concentration trends observed in the recovery wells and several of the monitoring wells, progress toward these goals is apparent. Based on the concentrations in the groundwater wells, the GWTP should continue to be operated. In accordance with the O&M Manual, the groundwater sampling frequency for the eight monitoring wells has been reduced to semi-annually. Water levels for the 14 monitoring wells will continue to be monitored on a quarterly basis.

## 5.0 REFERENCES

Tetra Tech, Inc. (Tetra Tech). 2014. *Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. March.

Tetra Tech EC, Inc. (TtEC). 2010. *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. April.

Tetra Tech EC, Inc. (TtEC). 2010a. *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York*. September.

## **TABLES**

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**First Quarter 2015**

SPDES Parameters	Daily Maximum Goal	Units	January 2015									
			RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE) <sup>(2)</sup>	Treated Effluent (TE) Duplicate
Process Stream												
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date								1/12/15				
Average Flowrate	1100	GPM	854	206	1,060	NR	1056	NR	NR	NR	1,098	NR
Total Flow		gallons	38,144,250	9,174,850	47,319,100	NR	47,134,883	NR	NR	NR	49,005,567	NR
pH	5.5 - 8.5	SU	5.35	5.29	5.34	6.02	6.53	6.45	6.50	6.53	6.61	6.59
Carbon Tetrachloride	NA	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.0 J	2.5 J	2.1 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.0 J	1.5 J	1.9 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	15.5	1.7 J	12.5 J	0.90 J	0.75 J	0.30 J	0.42 J	0.47 J	0.63 J	0.72 J
trans 1,2-Dichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	35.9	ND (5.0)	28.9	0.31 J	0.33 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.5 J	ND (5.0)	1.21 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	154	215	166	4.5	3.8	0.71 J	0.57 J	ND (1.0)	2.2	2.4
Vinyl Chloride	2	µg/L	ND (10.0)	ND (10.0)	ND (10.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Mercruy	0.25	µg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	NA	mg/L	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**First Quarter 2015**

SPDES Parameters	Daily Maximum Goal	Units	February 2015									
Process Stream			RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			2/10/15									
Average Flowrate	1100	GPM	843	206	1,049	NR	1047	NR	NR	NR	1,088	NR
Total Flow		gallons	33,980,550	8,315,467	42,296,017	NR	42,196,167	NR	NR	NR	43,857,200	NR
pH	5.5 - 8.5	SU	5.07	4.94	5.04	5.95	6.12	6.15	6.22	6.25	6.25	6.24
Carbon Tetrachloride	NA	µg/L	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.4	2.7	2.5	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.8	1.8	2.6	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	18.5	1.9	15.2	0.53 J	0.50 J	0.51 J	0.52 J	0.53 J	0.54 J	0.53 J
trans 1,2-Dichloroethene	5	µg/L	0.31 J	ND (1.0)	0.25 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	38.5	ND (1.0)	30.9	ND (1.0)	0.15 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	0.85 J	0.84 J	0.85 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	189	231	197	2.8	2.3	ND (1.0)	0.74 J	ND (1.0)	1.1 J	1.2 J
Vinyl Chloride	2	µg/L	0.65 J	ND (2.0)	0.52 J	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Mercruy	0.25	µg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	NA	mg/L	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)

**Table 1**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Results**  
**First Quarter 2015**

SPDES Parameters	Daily Maximum Goal	Units	March 2015									
Process Stream			RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	Treated Effluent (TE)	Treated Effluent (TE) Duplicate
Well Depth		ft	445	530	NA	NA	NA	NA	NA	NA	NA	NA
Screened Interval		ft	335-395 410-430	392-412 442-504	NA	NA	NA	NA	NA	NA	NA	NA
Sampling Date			3/16/15									
Average Flowrate	1100	GPM	836	206	1,042	NR	1,039	NR	NR	NR	1,087	NR
Total Flow		gallons	37,316,500	9,194,133	46,510,633	NR	46,367,200	NR	NR	NR	48,508,633	NR
pH	5.5 - 8.5	SU	5.49	5.05	5.40	5.97	6.24	6.30	6.33	6.35	6.36	6.38
Carbon Tetrachloride	NA	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.2 J	2.7 J	2.3 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.9 J	1.7 J	2.7 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	16.1	1.7 J	13.3 J	0.59 J	0.42 J	0.51 J	0.53 J	0.52 J	0.52 J	0.51 J
trans 1,2-Dichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	39.5	ND (5.0)	31.7	0.33 J	0.33 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	164	230	177	3.4	2.4	0.77 J	1.1	ND (1.0)	0.81 J	0.79 J
Vinyl Chloride	2	µg/L	ND (10.0)	ND (10.0)	ND (10.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Mercruy	0.25	µg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	NA	mg/L	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)	ND (5)

**Notes:**

J - Estimated result between laboratory method detection limit and reporting limit

NA - Not Applicable

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

gpm - gallons per minute

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

**Table 2**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**First Quarter 2015**

DAR Parameters	Discharge Goal <sup>(3)</sup>	Units	January 2015				February 2015					
Process Stream			Influent (VCI1)	VC12	VC23	Effluent	Effluent Duplicate	Influent (VCI1)	VC12	VC23	Effluent	Effluent Duplicate
Sampling Date				1/12/15				2/10/15				
Average Flowrate		CFM	NR	NR	NR	8,555	NR	NR	NR	NR	8,391	NR
Total Flow <sup>(1)</sup>		ft <sup>3</sup>	NR	NR	NR	381,879,445	NR	NR	NR	NR	338,310,265	NR
Total Flow <sup>(2)</sup>		m <sup>3</sup>	NR	NR	NR	10,813,622	NR	NR	NR	NR	9,579,880	NR
1,2-Dichloroethane	NA	µg/m <sup>3</sup>	4.0 J	4.0	ND	ND	ND	5.1 J	3.2	ND	ND	ND
cis 1,2-Dichloroethene	> 100,000 <sup>(4)</sup>	µg/m <sup>3</sup>	250	210	220	60	62	160	99	230	79	77
trans 1,2-Dichloroethene		µg/m <sup>3</sup>	3.4 J	4.4	4.7	ND	ND	ND	1.9 J	4.0	ND	ND
1,2-Dichloroethene (total)	> 100,000	µg/m <sup>3</sup>	250	220	230	60	62	160	100	240	79	77
Toluene	NA	µg/m <sup>3</sup>	4.5 J	0.78 J	0.30 J	ND	ND	1.1 J	0.79 J	ND	ND	ND
Xylene	NA	µg/m <sup>3</sup>	4.2 J	0.96 J	ND	ND	ND	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND	4.4 J	ND	ND	ND	ND
Trichloroethene	2,600	µg/m <sup>3</sup>	3,300	1,100	14	4.6	1.7 J	3,600	1,200	12	3.3 J	ND
Vinyl Chloride	560	µg/m <sup>3</sup>	21	7.4	5.8	0.78 J	ND	5.4	3.9	6.8	2.0	2.2
Tetrachloroethylene	5,100	µg/m <sup>3</sup>	630	29	9.9	1.0 J	ND	630	55	7.4	ND	ND

**Table 2**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**First Quarter 2015**

DAR Parameters	Discharge Goal <sup>(3)</sup>	Units	March 2015					
Process Stream			Influent (VCI1)	VC12	VC23	Effluent	Effluent Duplicate	
Sampling Date				3/12/15				
Average Flowrate		CFM	NR	NR	NR	8,416	NR	
Total Flow <sup>(1)</sup>		ft <sup>3</sup>	NR	NR	NR	375,667,920	NR	
Total Flow <sup>(2)</sup>		m <sup>3</sup>	NR	NR	NR	10,637,731	NR	
1,2-Dichloroethane	NA	µg/m <sup>3</sup>	6.0 J	5.3 J	ND	ND	ND	
cis 1,2-Dichloroethene	> 100,000 <sup>(4)</sup>	µg/m <sup>3</sup>	150	190	300	110	110	
trans 1,2-Dichloroethene		µg/m <sup>3</sup>	ND	ND	5.2	1.9 J	ND	
1,2-Dichloroethene (total)	> 100,000	µg/m <sup>3</sup>	150	190	300	120	110	
Toluene	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND	
Xylene	NA	µg/m <sup>3</sup>	ND	5.2 J	ND	ND	ND	
1,1,2-Trichloroethane	NA	µg/m <sup>3</sup>	ND	ND	ND	ND	ND	
Trichloroethene	2,600	µg/m <sup>3</sup>	3,200	3,000	16	6.5	ND	
Vinyl Chloride	560	µg/m <sup>3</sup>	5.5	5.9	6.3	2.4	2.9	
Tetrachloroethene	5,100	µg/m <sup>3</sup>	510	32	7.1	2.2 J	ND	

Notes:

NA - Not applicable

ND - Not detected

NR - Not recorded

SGC - Short-term Guideline Concentration

µg/m<sup>3</sup> - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

(1) Total Flow (ft<sup>3</sup>) = avg flowrate (cfm) \* operational time (min)

(2) Total Flow (m<sup>3</sup>) = total flow (ft<sup>3</sup>) \* (0.3048<sup>3</sup>)m<sup>3</sup>/ft<sup>3</sup>

(3) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(4) Discharge goal is for total 1,2-Dichloroethene.

**Table 3**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Stack Emissions**  
**First Quarter 2015**

DAR Parameters	Discharge Goal <sup>(1)</sup>	Units	January 2015	February 2015	March 2015
Sampling Date			1/12/15	2/10/15	3/12/15
Average Flowrate		CFM	8,555	8,391	8,416
Total Flow		ft <sup>3</sup>	381,879,445	338,310,265	375,667,920
Total Flow		m <sup>3</sup>	10,813,622	9,579,880	10,637,731
Trichloroethene	0.09	lb/hr	0.00015	0.00010	0.00020
Vinyl Chloride	0.02	lb/hr	0.00002	0.00006	0.00008
1,2 Dichloroethene	11	lb/hr	0.00192	0.00248	0.00378
1,2-Dichloroethane	NA	lb/hr	0.00000	0.00000	0.00000
Toluene	NA	lb/hr	0.00000	0.00000	0.00000
Xylene	NA	lb/hr	0.00000	0.00000	0.00000
1,1,2-Trichloroethane	NA	lb/hr	0.00000	0.00000	0.00000
Tetrachloroethene	0.18	lb/hr	0.00003	0.00000	0.00007

Notes:

NA - Not applicable

lb/hr - pounds per hour

DAR - Division of Air Resources

CFM - Cubic feet per minute

Stack Emissions (lb/hr) = average flowrate (cfm) \* (0.3048<sup>3</sup>)m<sup>3</sup>/ft<sup>3</sup> \* conc.(ug/m<sup>3</sup>) \* 1 lb/453592370 ug \*  
60 min/hr

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**Table 4**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Level Measurements**  
**First Quarter 2015**

Monitoring Well ID	Date	Well Elevation (ft amsl)	Total Depth (ft)	Screen Interval (ft)	Depth to Water (ft)	Groundwater Elevation (ft amsl)
RW1-MW1	03/25/15	85.86	435	395-435	35.72	50.14
RW1-MW2	03/25/15	87.35	435	395-435	37.74	49.61
RW1-MW3	03/25/15	80.34	435	395-435	27.58	52.76
RW2-MW1	03/25/15	90.75	510	470-510	38.09	52.66
RW2-MW2	03/25/15	90.15	510	470-510	37.51	52.64
RW2-MW3	03/25/15	89.75	510	470-510	38.12	51.63
RW3-MW1	03/25/15	92.22	495	475-495	35.95	56.27
RW3-MW2	03/25/15	91.98	350	330-350	39.62	52.36
RW3-MW3	03/25/15	92.98	340	320-340	37.25	55.73
RW3-MW4	03/25/15	92.92	495	475-495	37.65	55.27
TP-01	03/25/15	85.91	470	450-470	35.05	50.86
IW1-MW1	03/25/15	89.41	150	20-150	45.54	43.87
GM38D	NA	91.37	340	320-340	NA	NA
GM382D	NA	91.57	495	475-495	NA	NA

**Notes:**

amsl - above mean sea level

ft - feet

NA - Not Available

**Table 5**  
**Summary of Final Groundwater Chemistry Data**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Summary of Groundwater Chemistry Results**  
**First Quarter 2015**

Location	Temp (°C)	pH (SU)	S.C. (uS/cm)	DO (mg/L)	ORP (mV)	Turbidity (NTU)	Color (Visual)
RW1-MW1	14.22	4.22	182	1.58	246.3	0.19	clear
RW1-MW3	12.00	5.44	192	1.19	168.2	3.24	clear
RW2-MW1	12.42	8.92	291	0.86	157.1	2.09	clear
RW3-MW1	10.73	4.80	132	3.44	293.7	35.3	clear
RW3-MW2	10.51	4.94	90	3.28	294.5	1.77	clear
RW3-MW3	14.48	5.08	151	1.51	236.1	8.41	clear
RW3-MW4	14.01	4.65	180	1.18	280.7	0.62	clear
TP-01	10.97	6.18	173	7.76	181.4	0.26	clear

**Notes:**

S.C. = Specific Conductance

mS/cm = milliSiemens per centimeter

NTU = nephelometric turbidity units

mg/L = milligrams per liter

°C = degrees celsius

mV = millivolts

SU = standard units

ORP = oxidation/reduction potential

**Table 6**  
**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Summary of Detected Groundwater Analytical Results**  
**First Quarter 2015**

Sample ID	RW1-MW1	RW1-MW3	RW2-MW1	RW3-MW1	RW3-MW2	RW3-MW3		RW3-MW4	TP-01
Sample Date	3/25/2015	3/25/2015	3/26/2015	3/25/2015	3/25/2015	3/25/2015	3/25/2015	3/25/2015	3/25/2015
Comments						Duplicate			
VOCS (EPA 624) ug/L <sup>(1)</sup>									
Benzene	ND	ND	0.56 J	ND	ND	ND	ND	ND	ND
Chloroform	ND	0.79 J	0.46 J	ND	ND	0.40 J	0.33 J	1.2	2.6
Chloromethane	ND	0.29 J	ND						
1,1-dichloroethane	5.1	8.1	2.1	0.64 J	0.56 J	1.8	1.8	6.9	2.5
1,2-dichloroethane	ND	ND	0.41 J	ND	ND	ND	ND	ND	0.88 J
1,1-dichloroethene	2.2 J	2.3 J	0.61 J	0.42 J	0.33 J	1.5 J	1.4 J	1.3 J	1.2 J
cis-1,2-dichloroethene	39.5	0.54 J	2.6	ND	1.5	1.3	1.3	ND	13.4
trans-1,2-dichloroethene	0.79 J	ND							
Tetrachloroethene	0.30 J	ND	ND	2.2	ND	0.36 J	0.37 J	ND	0.48 J
Toluene	ND	ND	0.26 J	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	ND	1.5	ND	0.35 J	0.38 J	0.48 J	0.45 J	0.60 J	ND
1,1,2-trichloroethane	ND	0.43 J	ND						
Trichloroethene	99.5	2.0	4.3	41.8	159	182	184	2.7	52.3
Mercury (EPA 245.1) ug/L	ND								
TSS (SM20 2540D) mg/L	ND	ND	17	12	ND	ND	ND	5	ND

**Notes:**

J = estimated value

ND = Not detected above laboratory method detection limit

mg/L = milligrams per liter

µg/L = micrograms per liter

(1) Samples were analyzed for TCL VOCs. Only those VOCs detected are presented above.



















## **FIGURES**

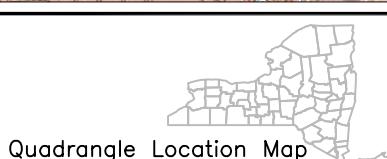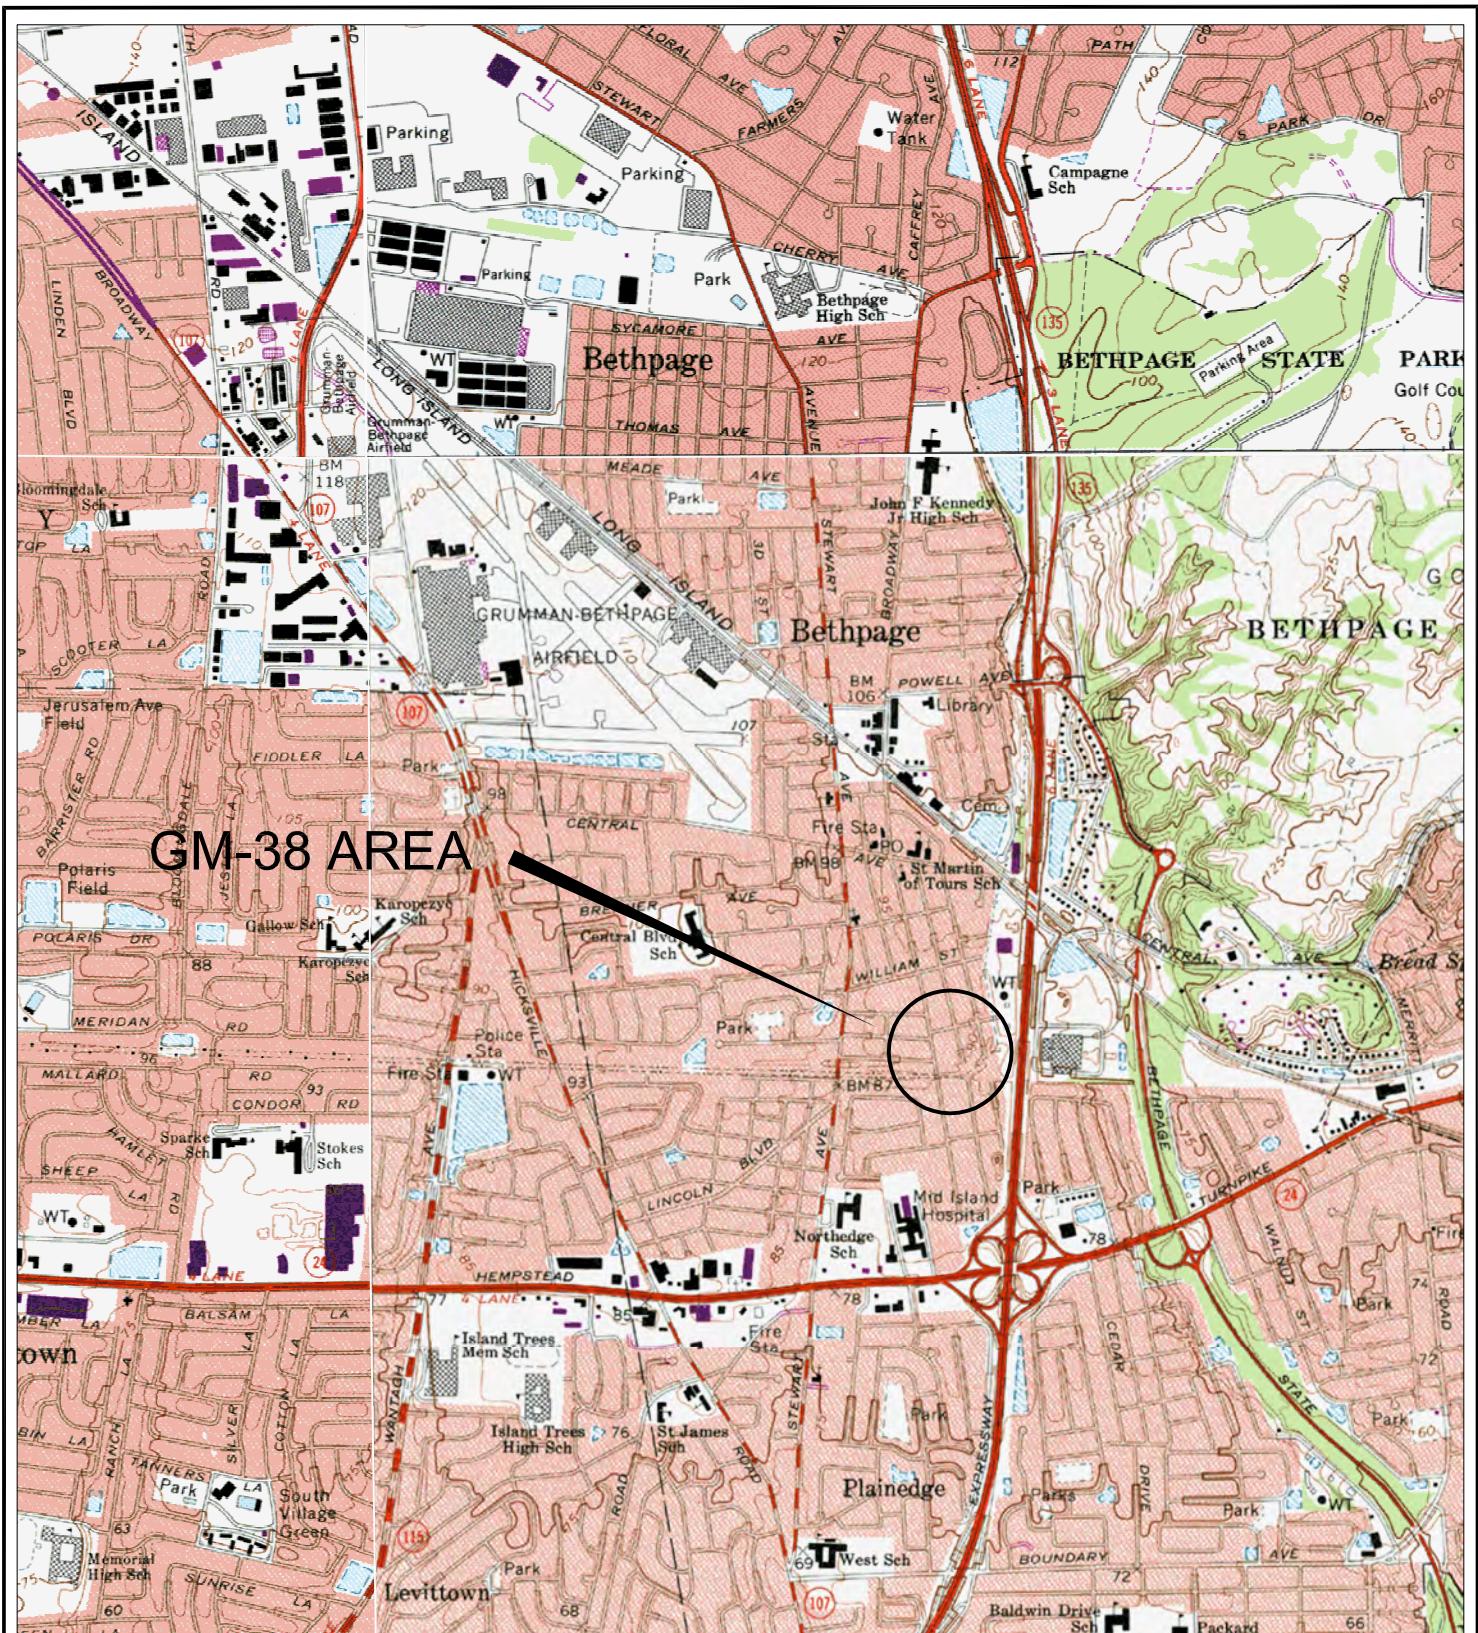



N


U.S. Navy RAC  
Engineering Field Activity, Northeast  
GM-38 Area (Offsite)  
NWIRP Bethpage  
Bethpage, NY

Figure 1  
Site Location Map


Source: U.S.G.S. Topographic Maps (7.5 Minute)  
Amityville, Freeport, Hicksville, Huntington, NY Quadrangles

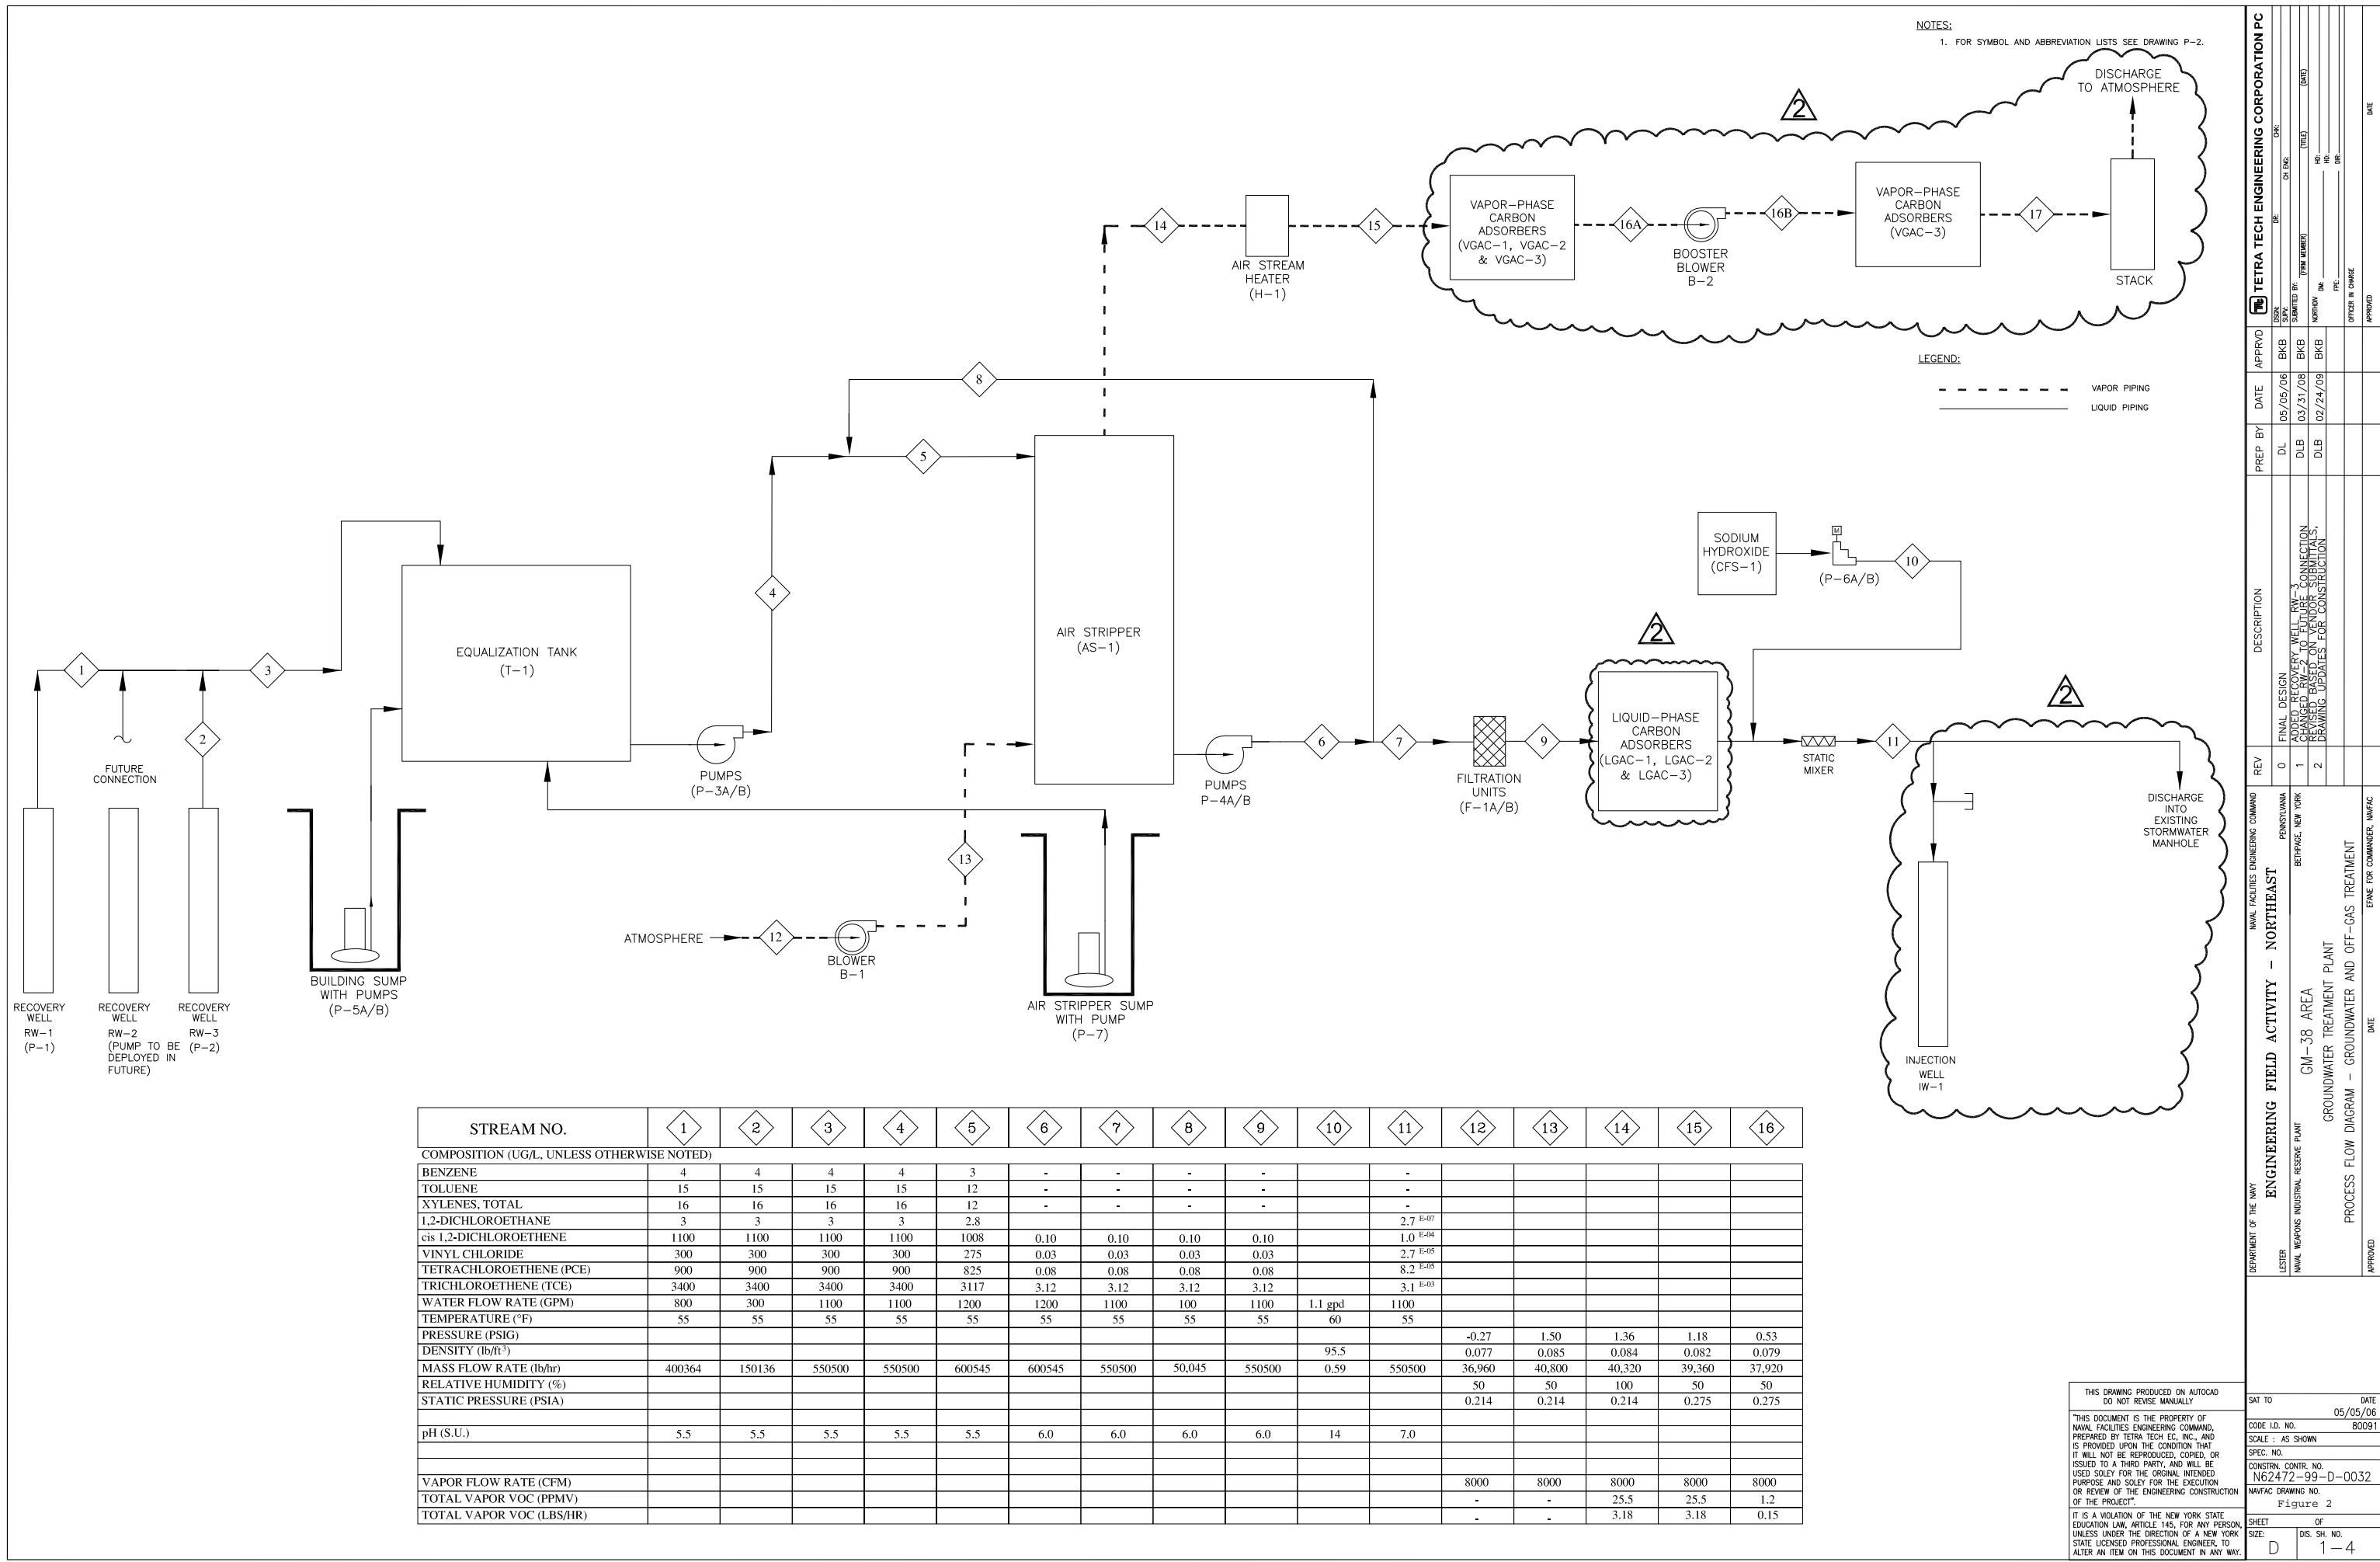

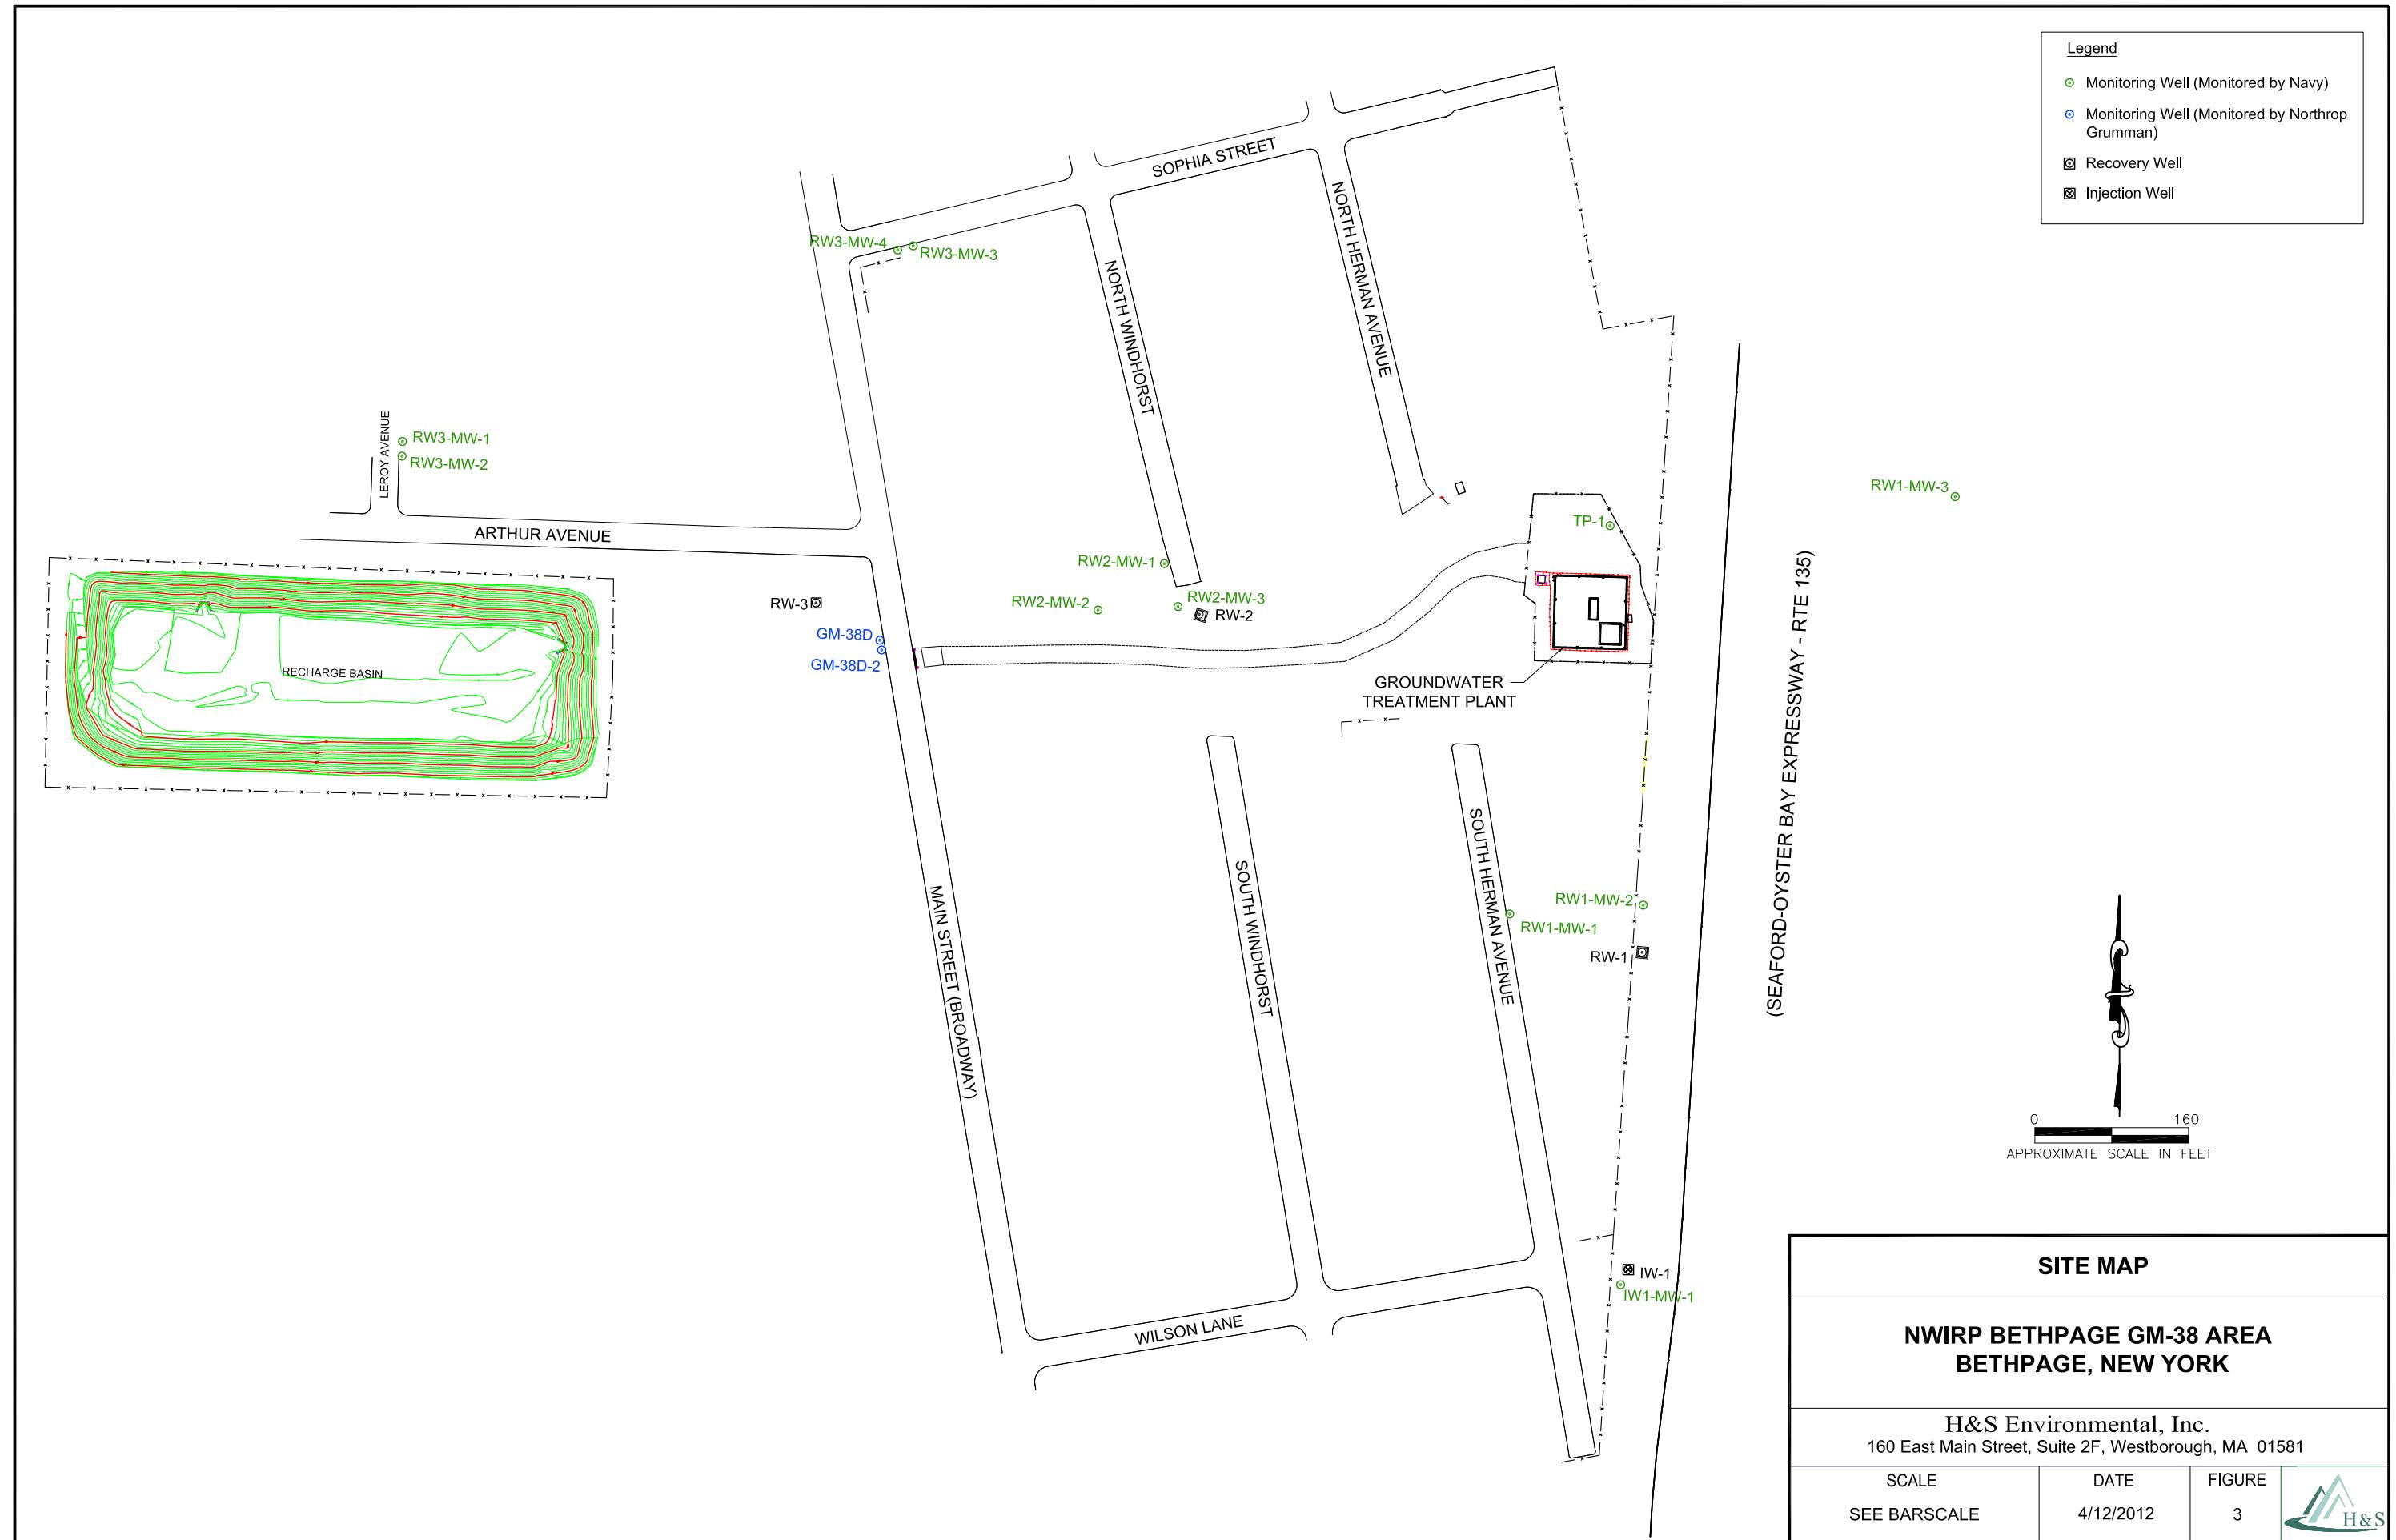


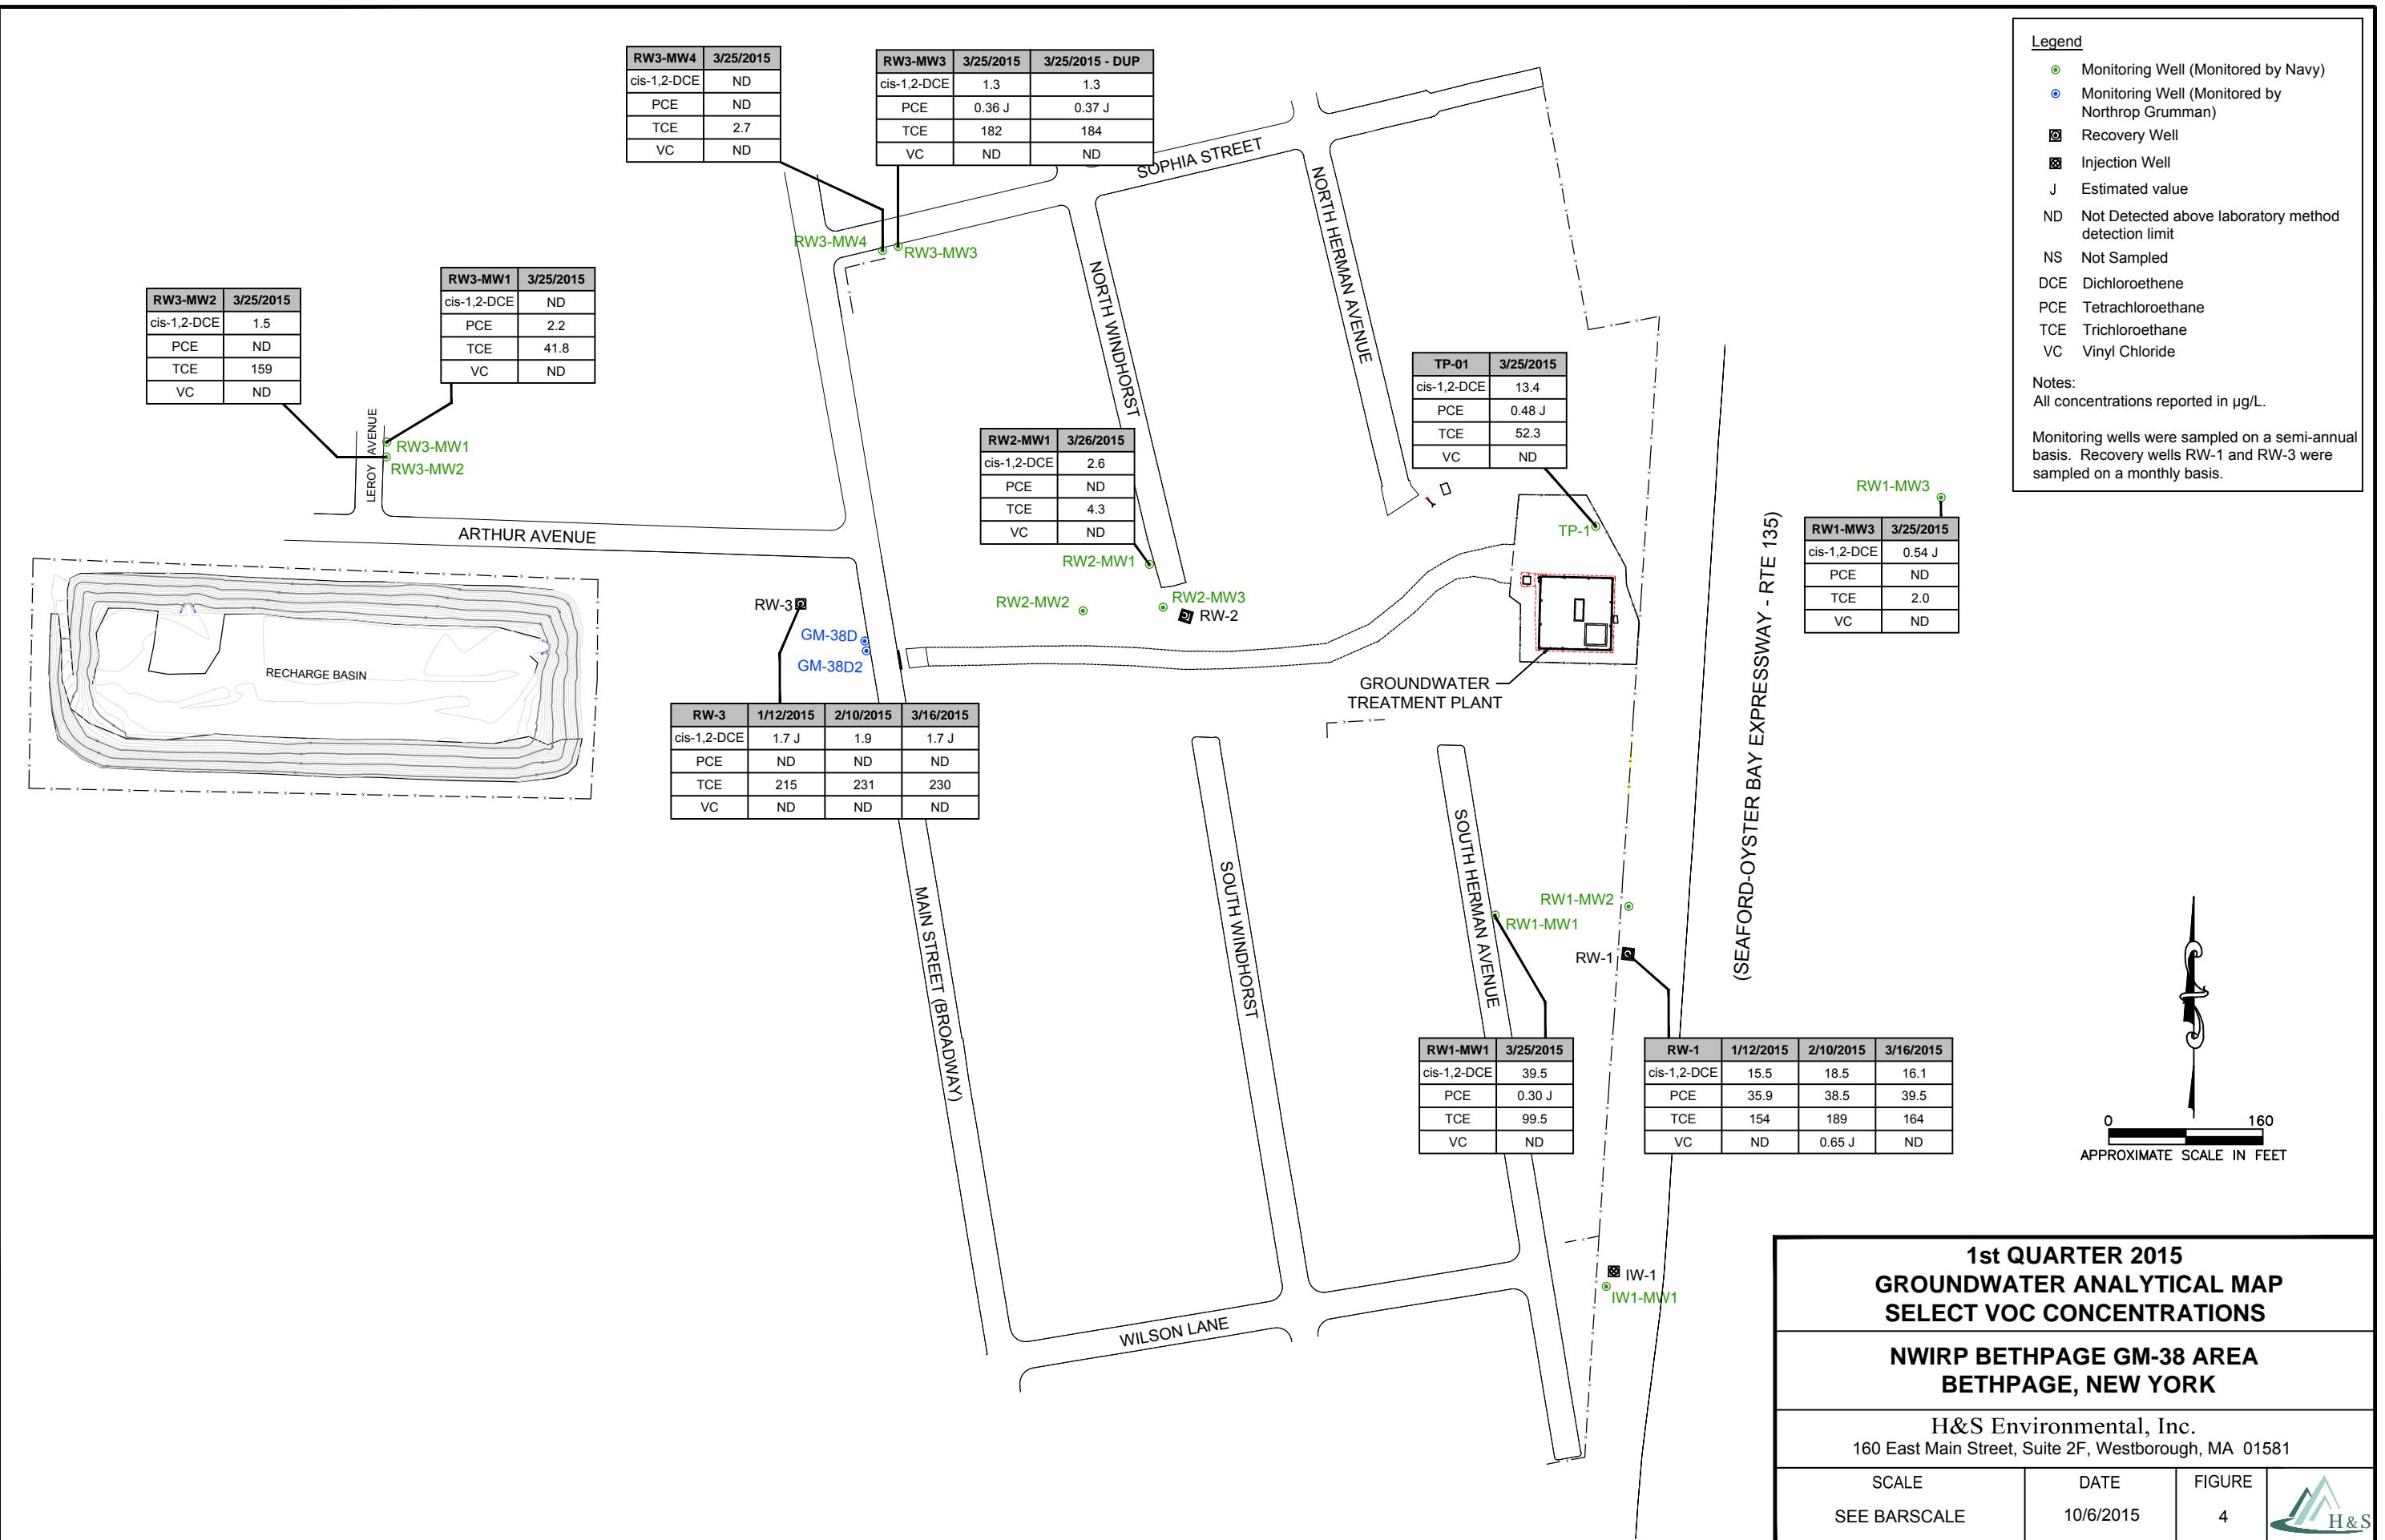


**Figure 5**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW1**

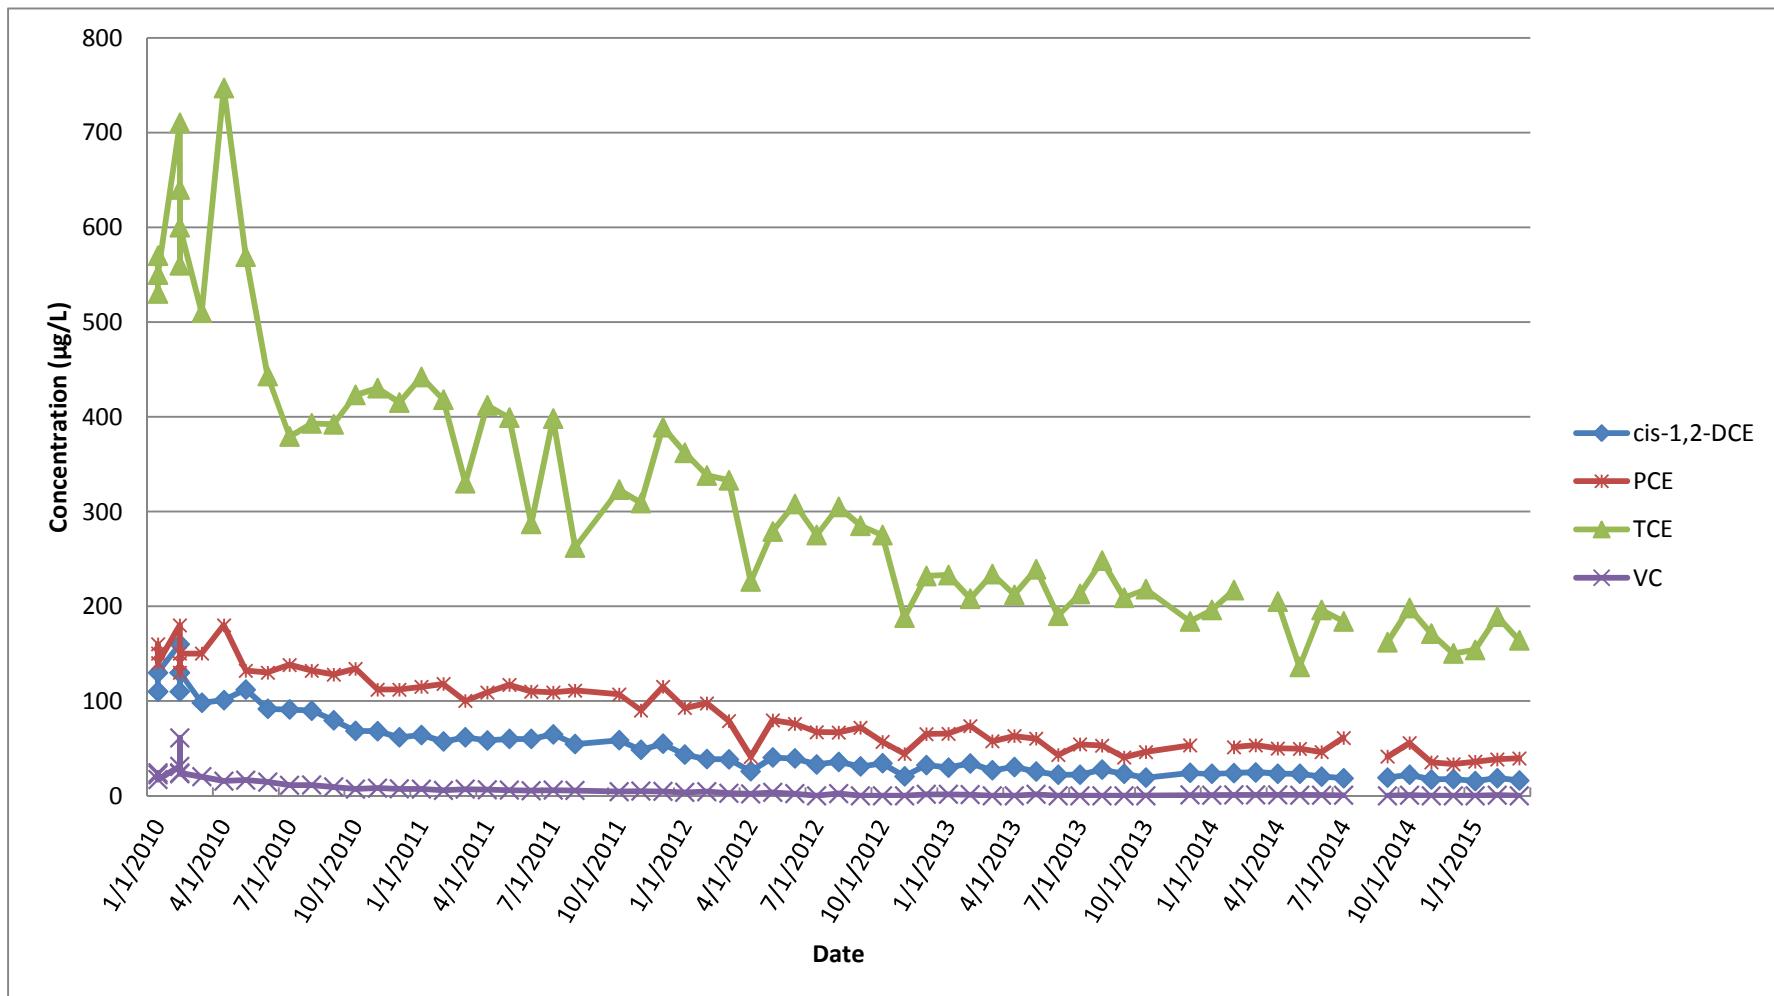


**Figure 6**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3**

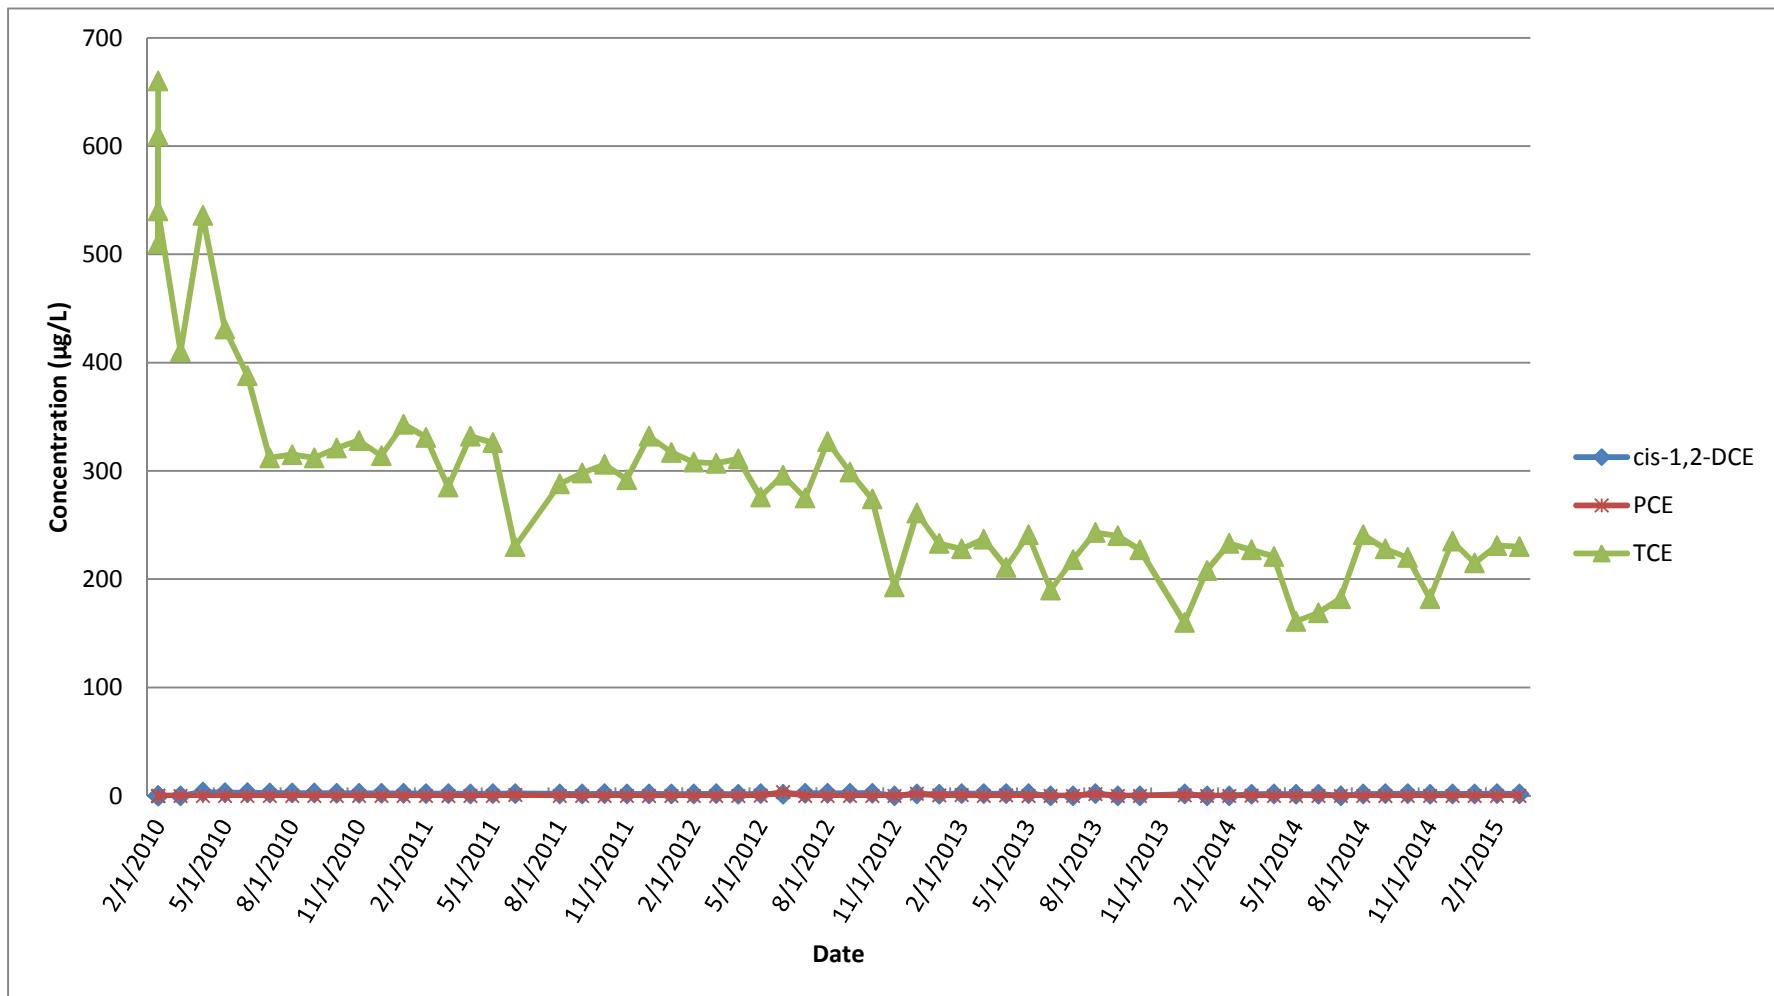


**Figure 7**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW1-MW1**

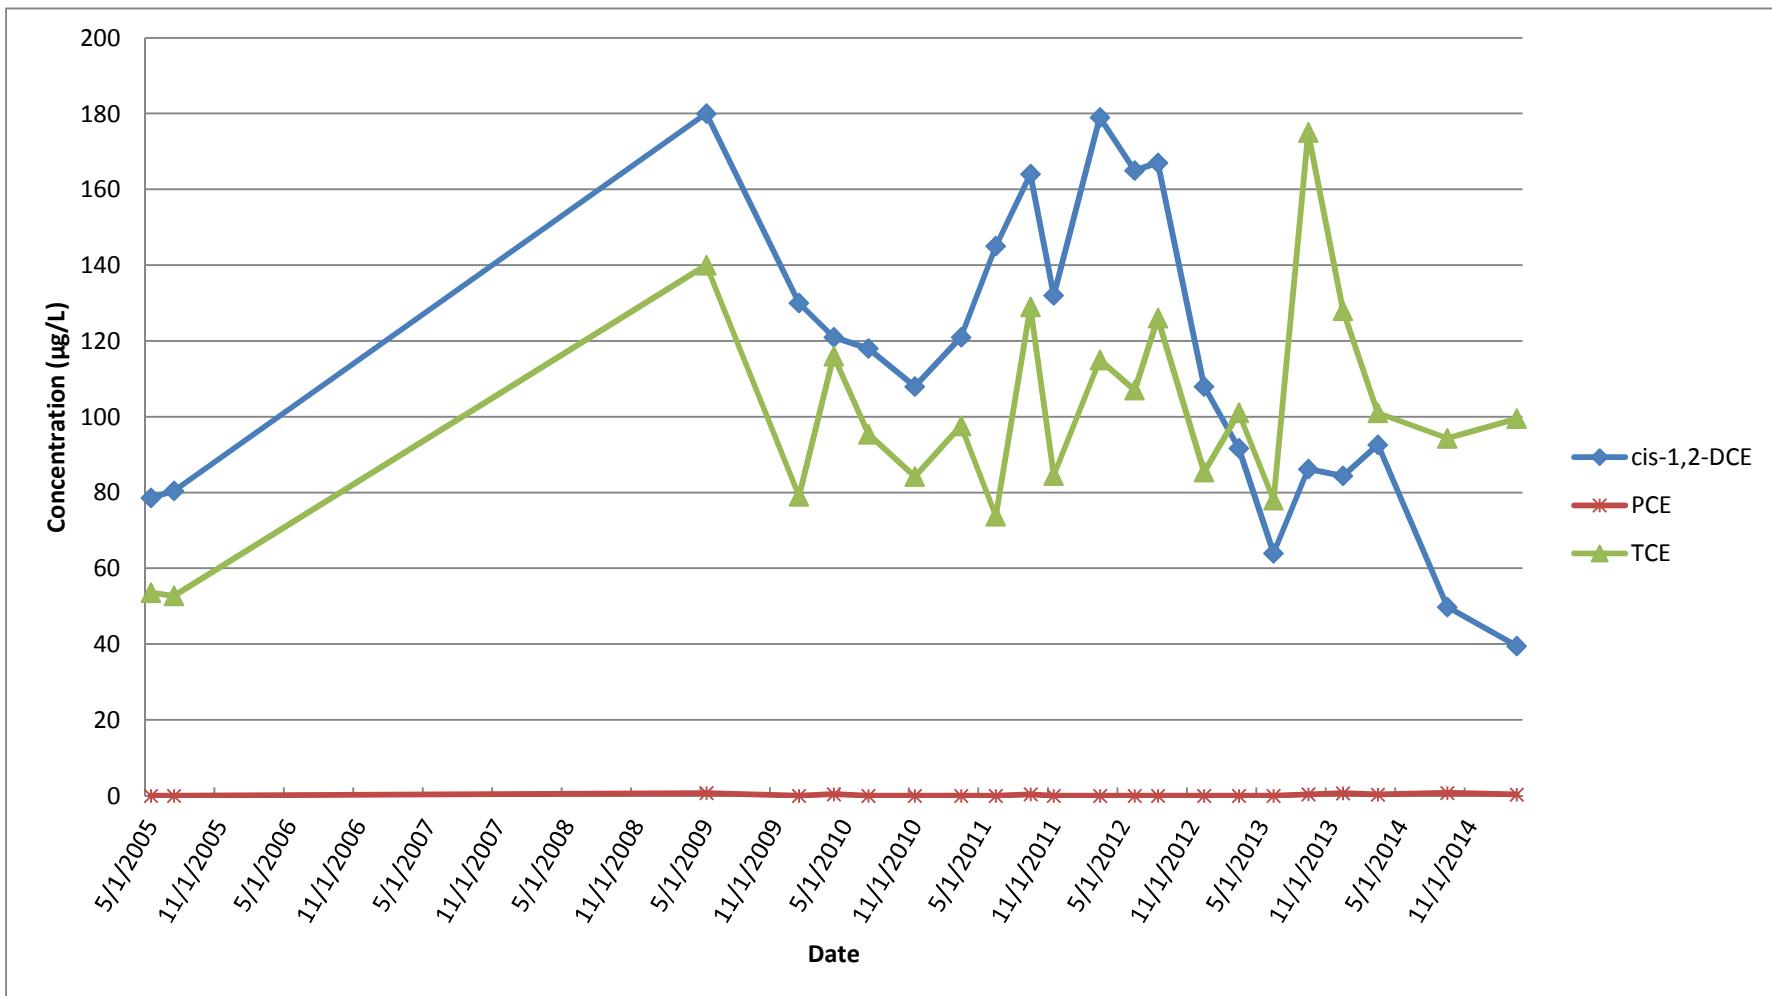


**Figure 8**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW1-MW3**

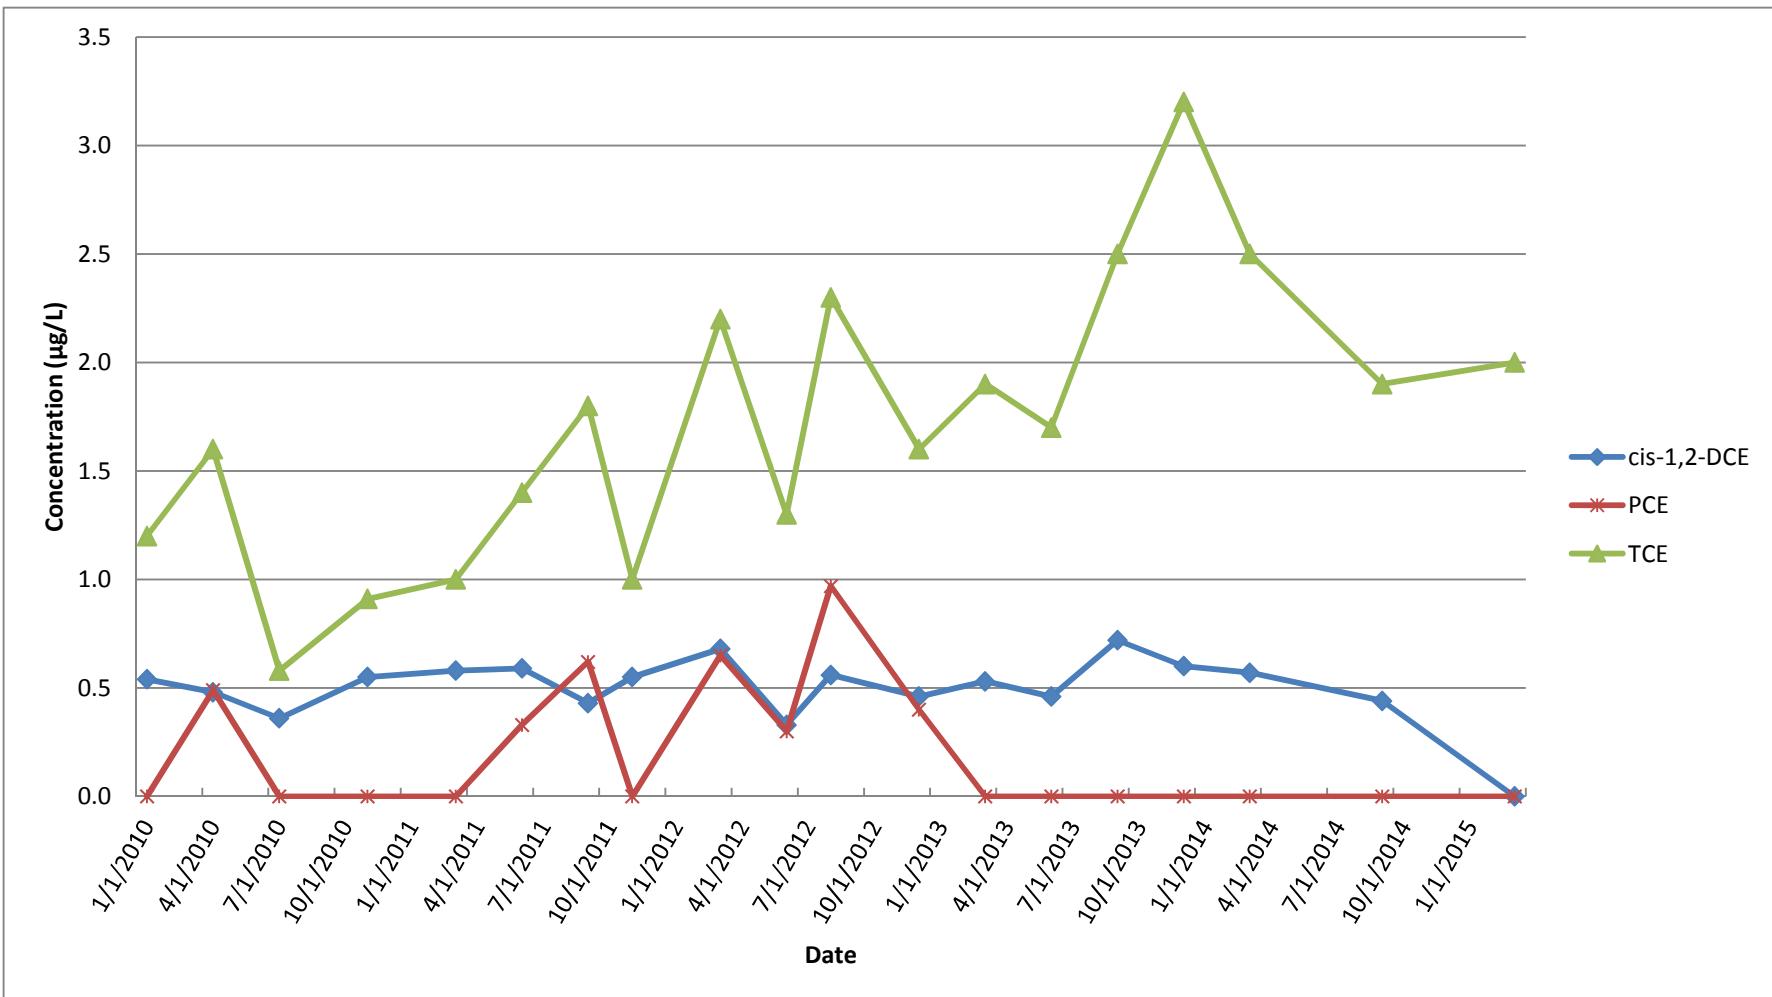


**Figure 9**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW2-MW1**

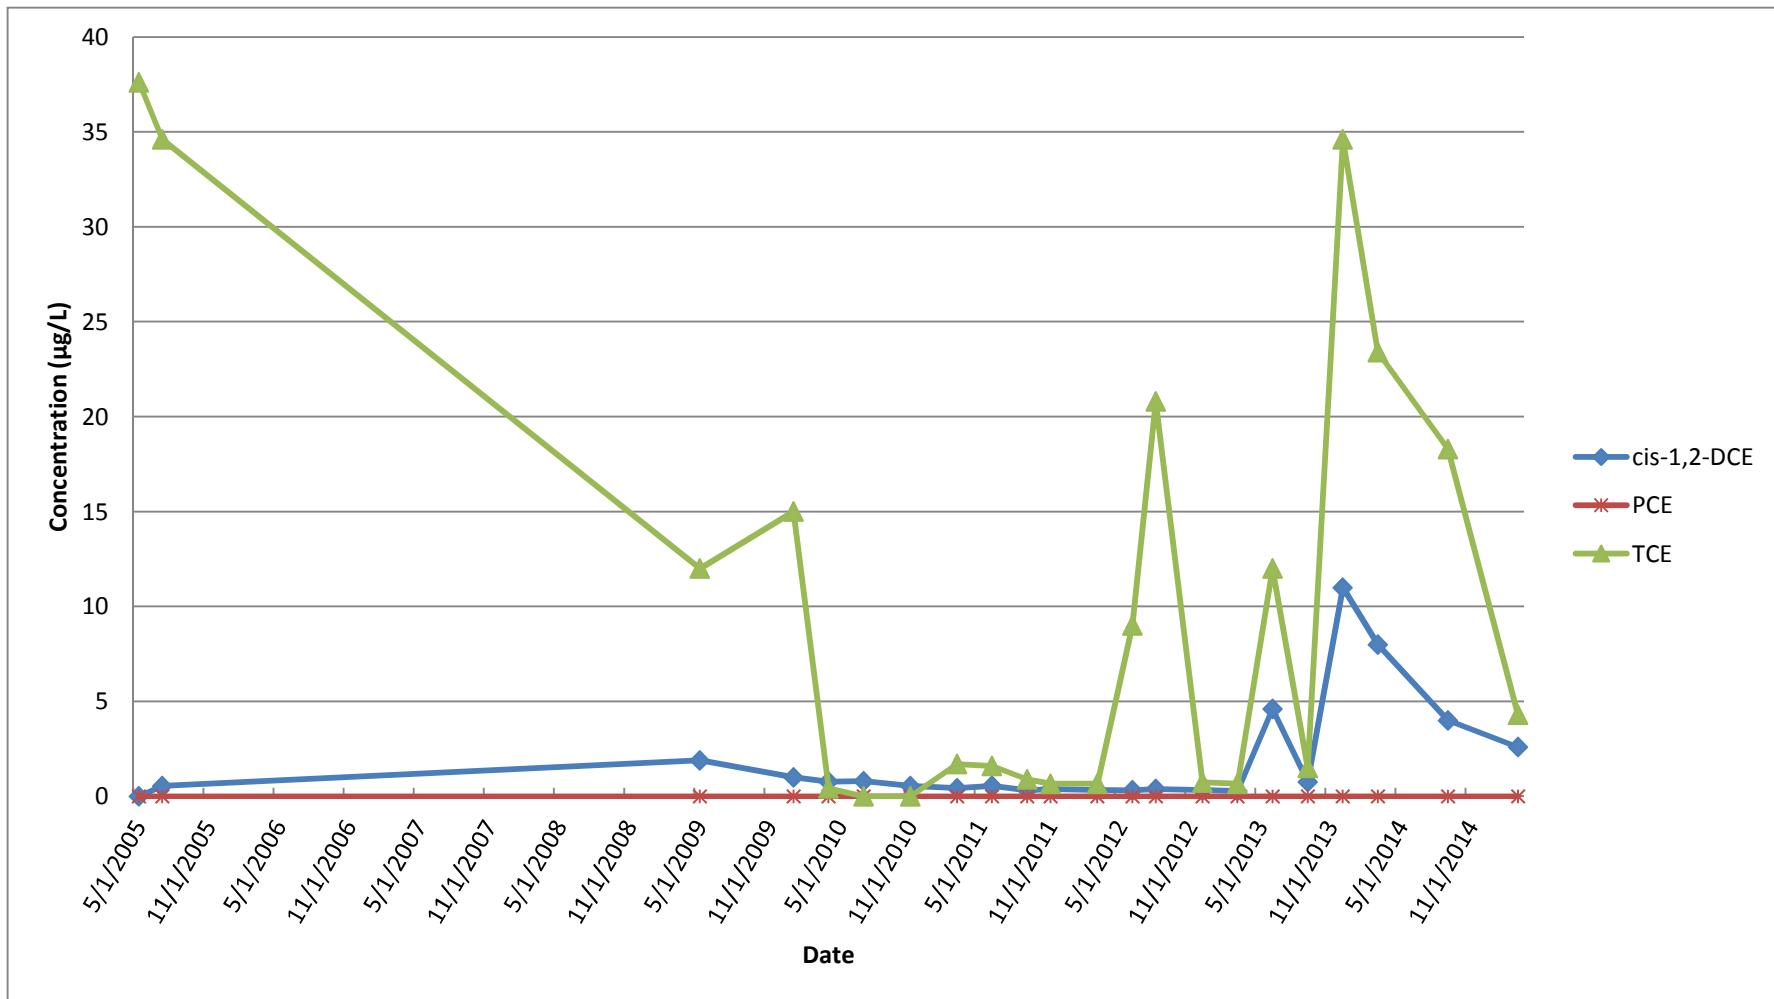


**Figure 10**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW1**

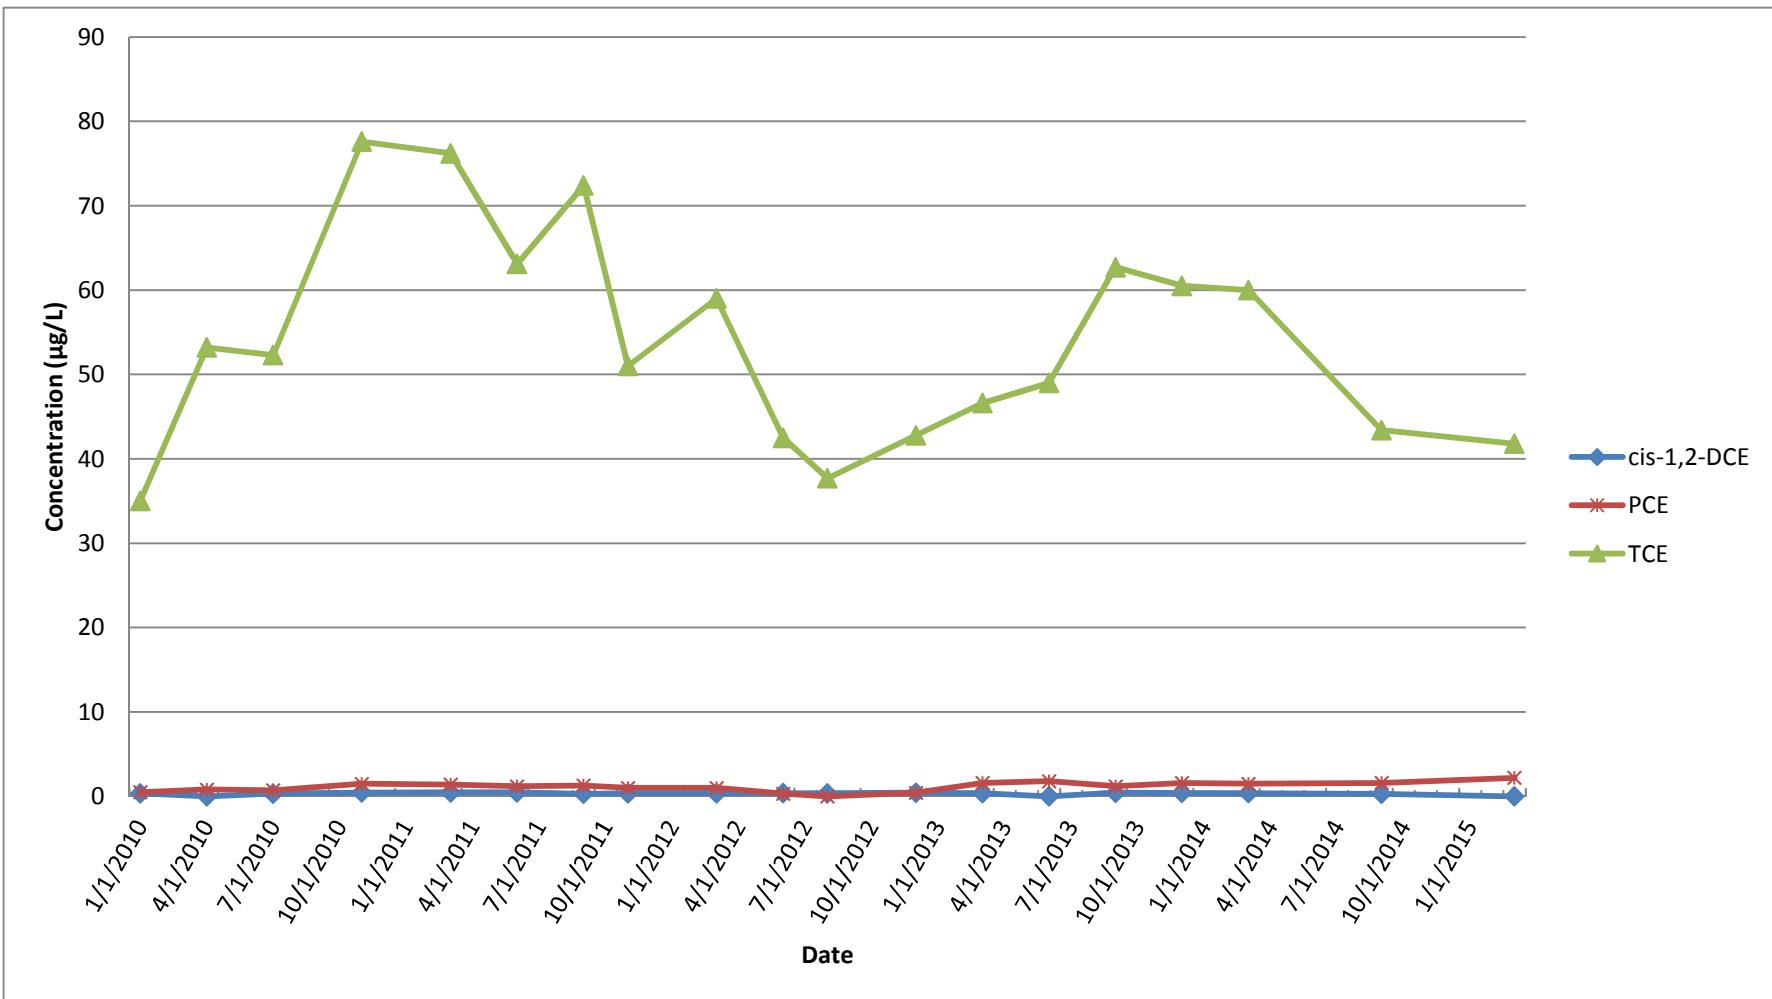


**Figure 11**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW2**

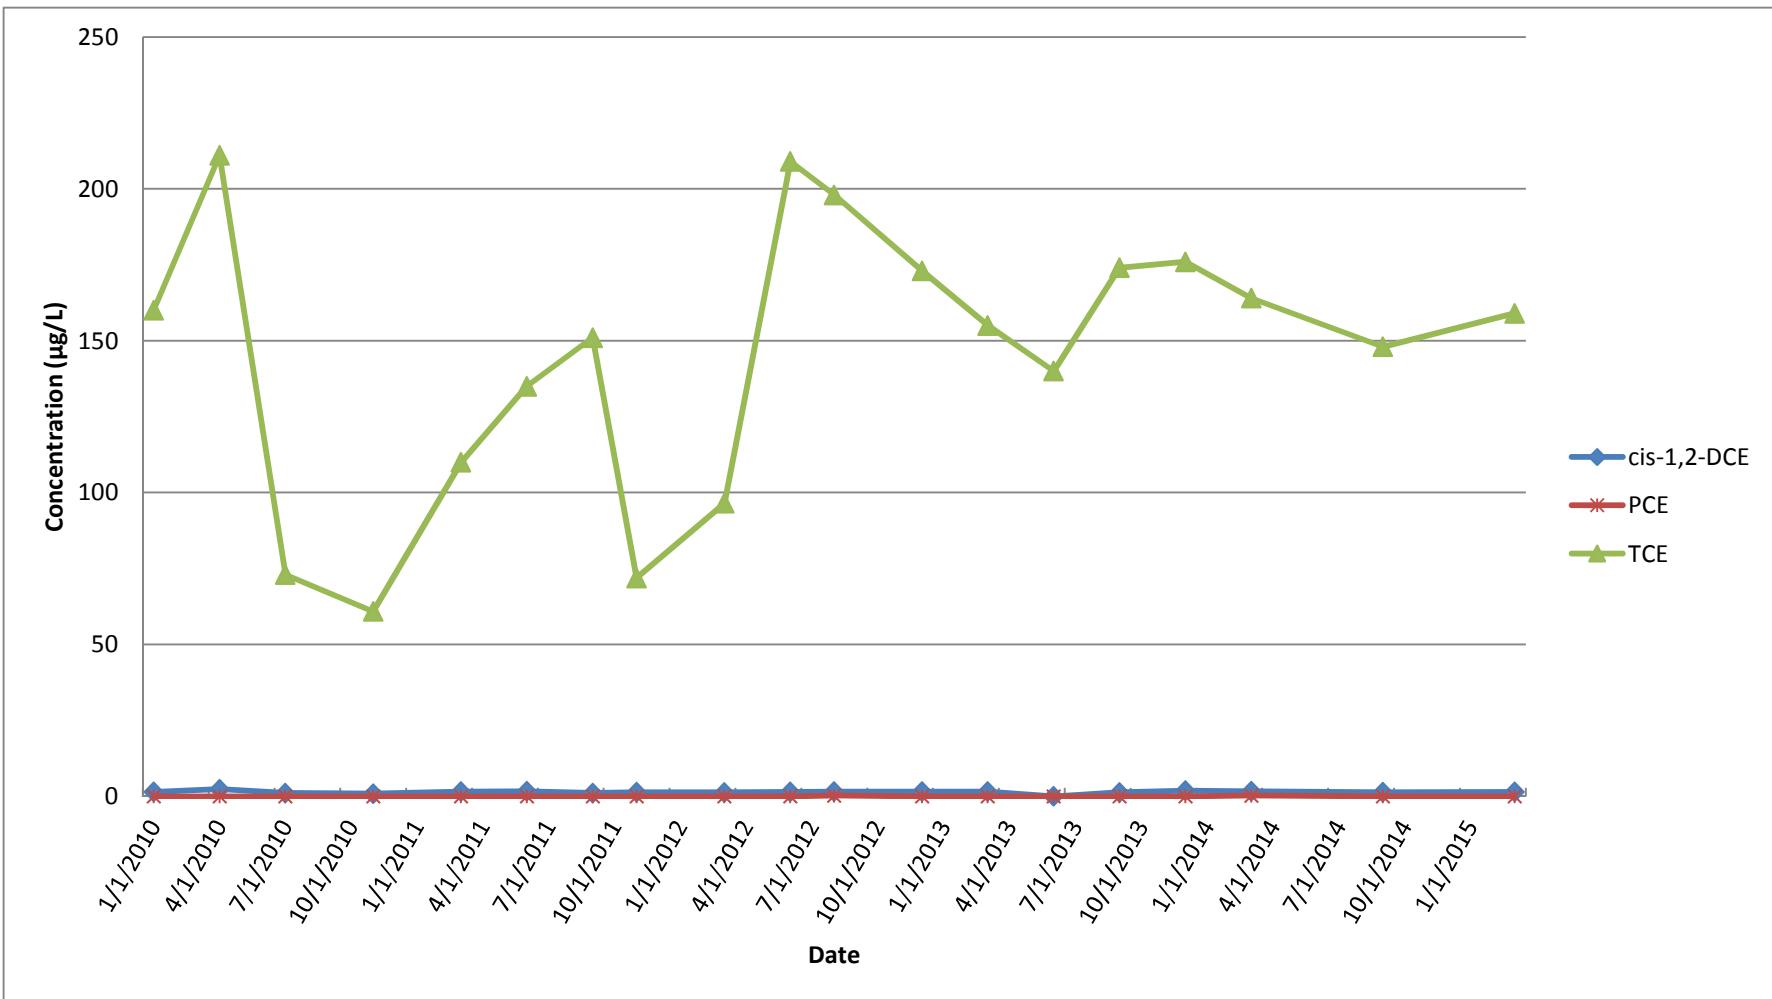


**Figure 12**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW3**

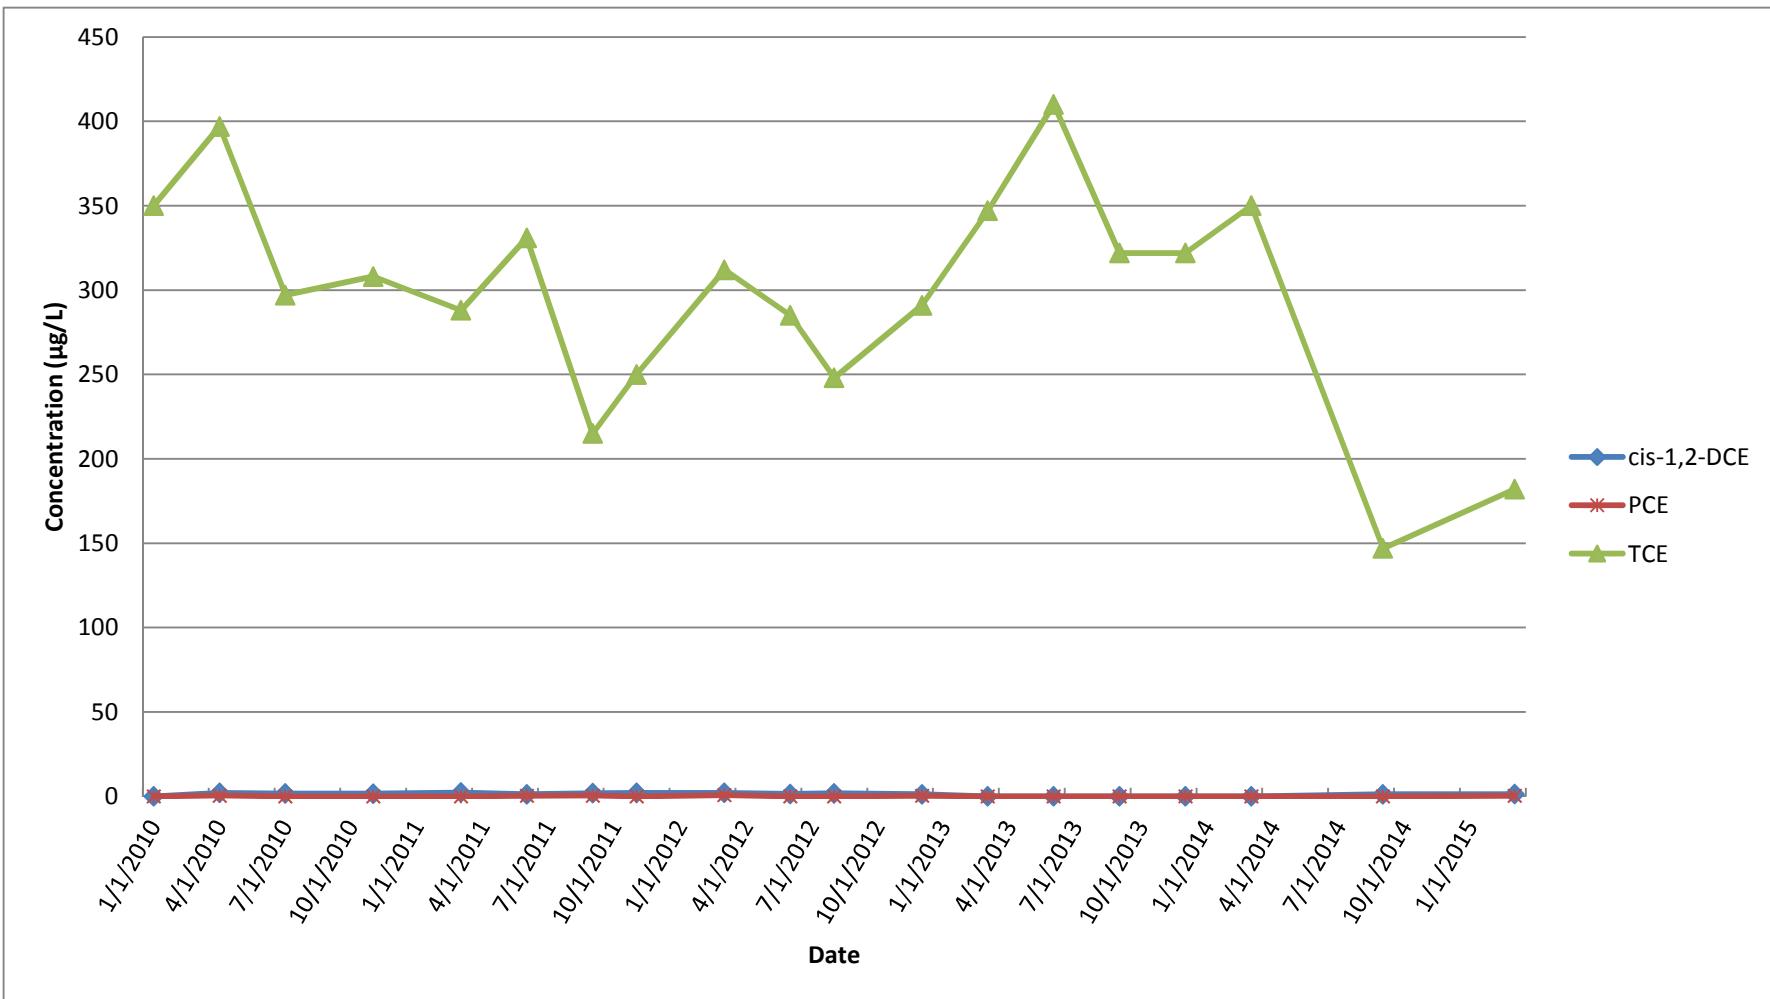

**Figure 13**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**RW3-MW4**

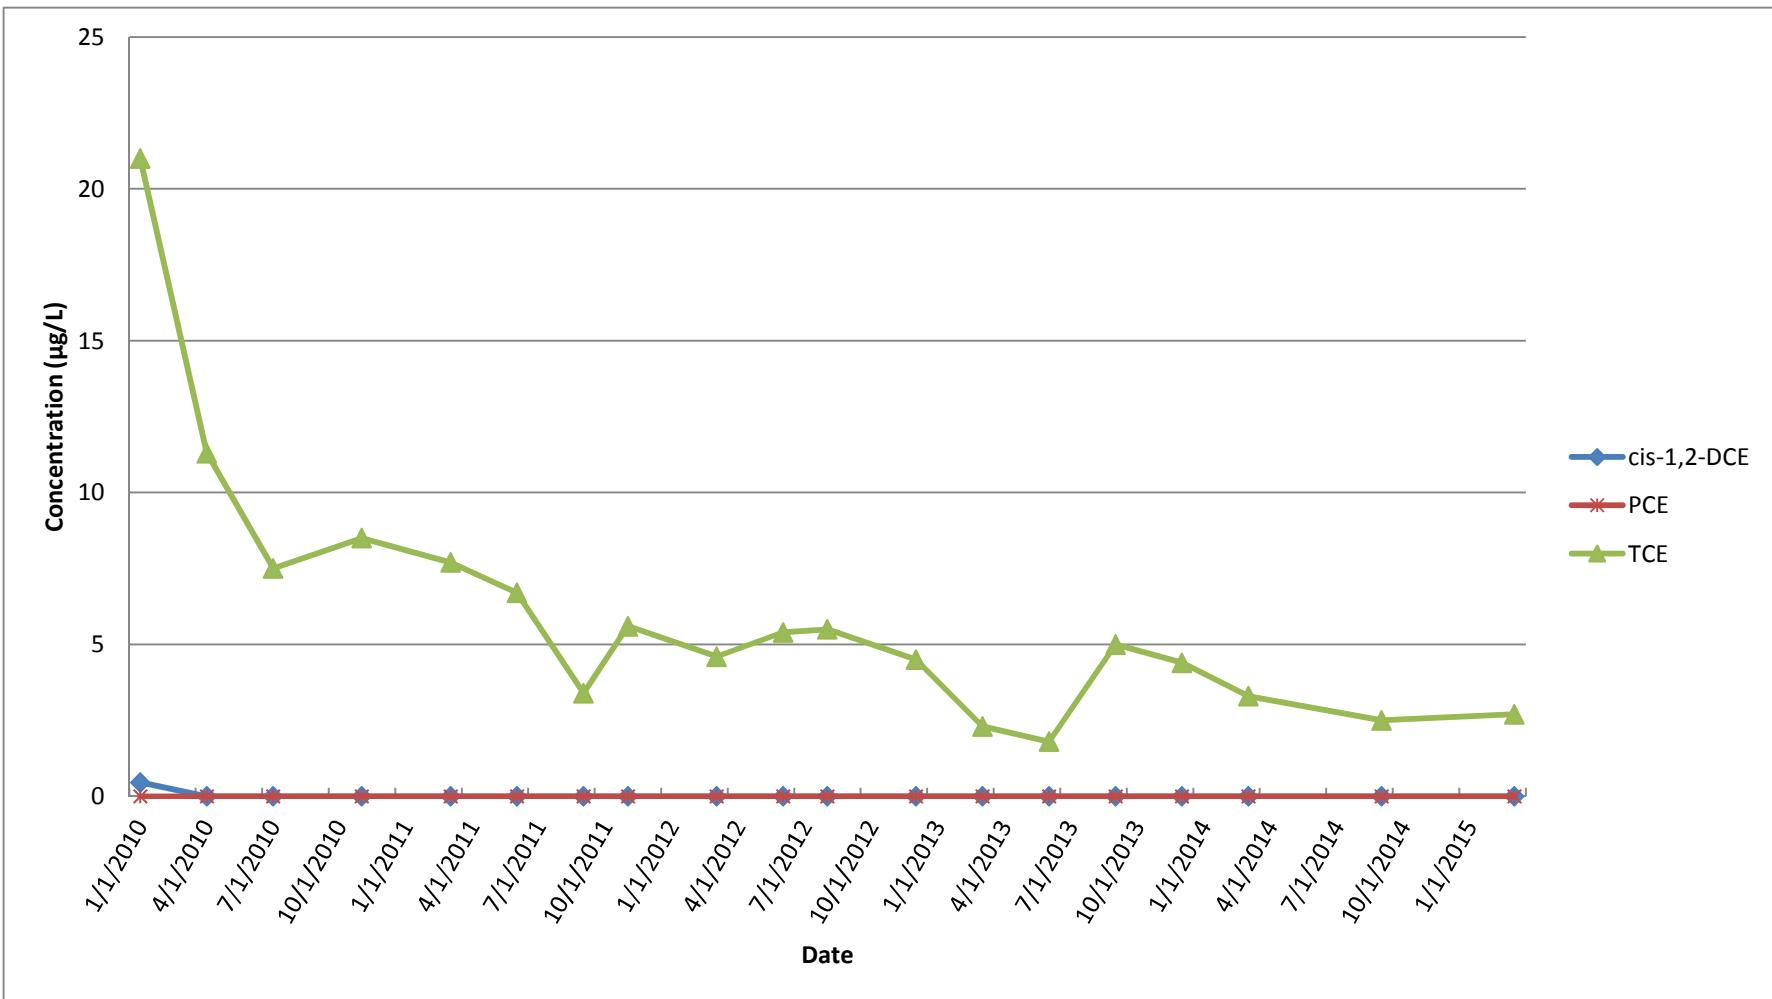

**Figure 14**  
**GM-38 Area Groundwater Remediation**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Groundwater Concentration Trends of Select VOCs**  
**TP-01**

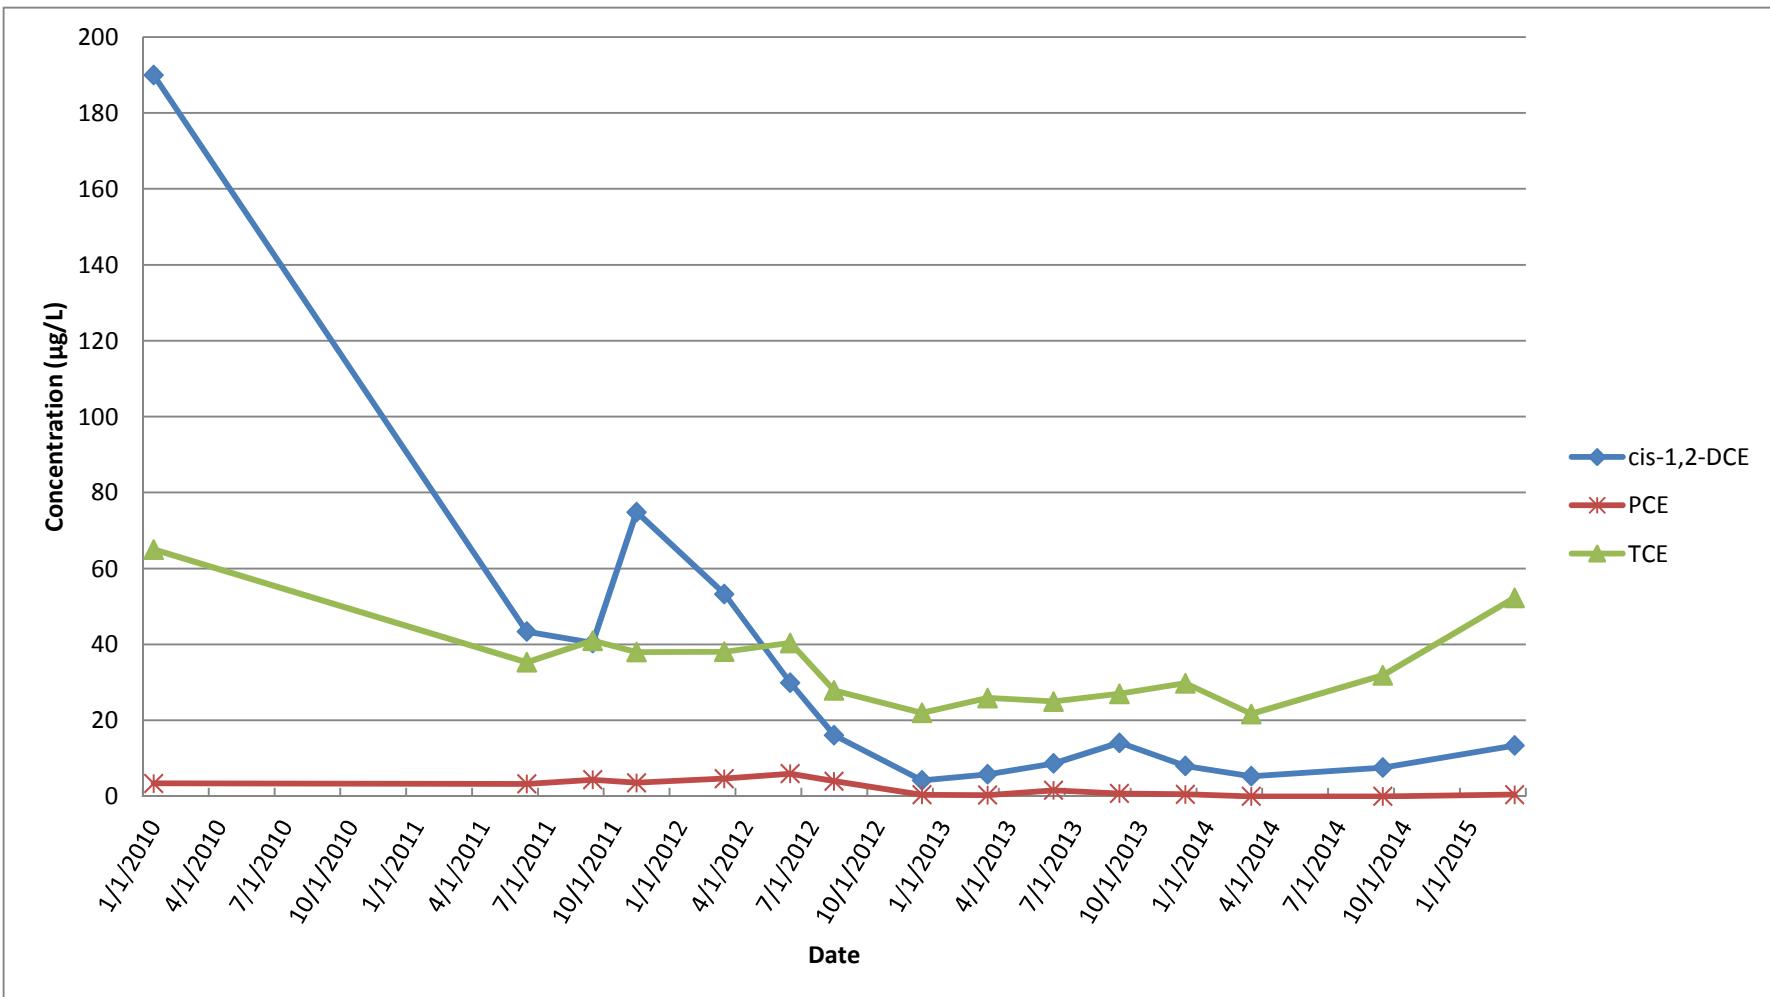


## **APPENDIX A**

### **NYSDEC EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS AND MONTHLY DMRS**


# New York State Department of Environmental Conservation

## Division of Water

Bureau of Water Permits, 4<sup>th</sup> Floor  
 625 Broadway, Albany, New York 12233-3505  
 Phone: (518) 402-8111 • FAX: (518) 402-9029  
 Website: [www.dec.state.ny.us](http://www.dec.state.ny.us)



Alexander B. Grannis  
Commissioner

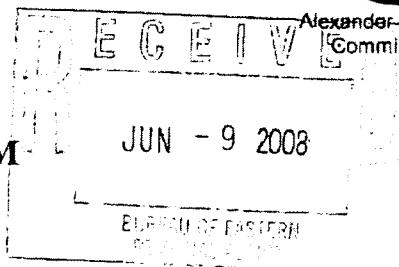

## MEMORANDUM

JUN - 9 2008

BUREAU OF EASTERN  
REGIONAL ENGINEERING

**TO:** Steven Scharf, DER

**FROM:** Jean Occidental, DOW, Bureau of Water Permits JO

**SUBJECT:** Naval Weapons Industrial Reserve Plant (NWIRP); DER Site # 1-01-001

**DRAINAGE BASIN:** na

**DATE:** June 6, 2008

In response to your request and the permittee's SPDES Permit Equivalent Application dated April 27, 2008, attached is the effluent criteria for the above noted groundwater remediation discharge.

The Division of Water does not have any regulatory authority over a discharge from a State, PRP, or Federal Superfund Site. The Division of Environmental Remediation will be responsible for ensuring compliance with the attached effluent criteria and approval of all engineering submissions. Additional Condition (1) identifies the contact to send all effluent results, engineering submissions, and modification requests. The Regional Water Engineer should be kept apprised of the status of these discharges and, in accordance with the attached criteria, receive a copy of the effluent results for informational purposes.

If you have any questions, please call me at (518) 402-8116.

Attachment

cc: (w/att) RWE, Region 1  
 C. Webber  
 BWP Permit Coordinator

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

## EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning: April 1, 2009and lasting until: April 1, 2014

the discharges from the treatment facility to Groundwater shall be limited and monitored by the operator as specified below:

Outfall and Parameters	Limitations		Units	Minimum Monitoring Requirements	
	Daily Avg.	Daily Max.		Measurement Frequency	Sample Type
Treated Groundwater Remediation Discharge from: Recovery Wells 1, 2, and 3					
Flow	Monitor	1100	GPM	Continuous	Recorder
pH (range)	5.5 - 8.5		SU	Weekly	Grab
1,1-Dichloroethane	NA	5	µg/l	Monthly <sup>1</sup>	Grab
1,2-Dichloroethane	NA	0.6	µg/l	Monthly <sup>1</sup>	Grab
1,1-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
cis-1,2-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
trans-1,2-Dichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Tetrachloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
1,1,1-Trichloroethane	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Trichloroethene	NA	5	µg/l	Monthly <sup>1</sup>	Grab
Vinyl chloride	NA	2	µg/l	Monthly <sup>1</sup>	Grab
Mercury	NA	0.25	µg/l	Monthly <sup>1</sup>	Grab

Footnotes:

- (1) The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

Additional Conditions:

- (1) Discharge is not authorized until such time as an engineering submission showing the method of treatment is approved by the Department. The discharge rate may not exceed the effective or design treatment system capacity. All monitoring data, engineering submissions and modification requests must be submitted to:

Steven Scharf  
Division of Environmental Remediation  
NYSDEC, 625 Broadway  
Albany, NY 12233-7015  
Phone: (518) 402-9620

With a copy sent to:

Regional Water Engineer  
NYSDEC - Region 1  
Building 40, SUNY Campus  
Stony Brook, New York 11790-2356  
Phone: (631) 444-0354

- (2) Only site generated wastewater is authorized for treatment and discharge.
- (3) Authorization to discharge is valid only for the period noted above but may be renewed if appropriate. A request for renewal must be received 6 months prior to the expiration date to allow for a review of monitoring data and reassessment of monitoring requirements.
- (4) Any use of corrosion/scale inhibitors, biocidal-type compounds, or other water treatment chemicals used in the treatment process must be approved by the department prior to use.
- (5) This discharge and administration of this discharge must comply with the substantive requirements of 6NYCRR Part 750.

**JANUARY 2015**



17 February 2015

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
JANUARY 2015 REPORTING PERIOD**

Dear Mr. Wilkie:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 January 2015 to 31 January 2015 are presented in Attachment A. There was no significant downtime for the GWTP during this reporting period; minor downtime occurred for maintenance activities.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
H&S Environmental, Inc.

A handwritten signature in blue ink, appearing to read "At Good".

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from January 2015

Cc: Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Al Taormina – H&S  
GM-38 Copy

**ATTACHMENT A**

**GROUNDWATER AND AIR SAMPLING RESULTS**

**JANUARY 2015**

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Report**  
**January 2015**

SPDES Parameters		January 2015				
Process Stream	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A				1/12/15	
Average Flowrate	1100	GPM	854	206	1,060	1,098
Total Flow	N/A	gallons	38,144,250	9,174,850	47,319,100	49,005,567
pH	5.5 - 8.5	SU	5.35	5.29	5.34	6.61
Carbon Tetrachloride	NA	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.0 J	2.5 J	2.1 J	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.0 J	1.5 J	1.9 J	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	15.5	1.7 J	12.5 J	0.63 J
trans 1,2-Dichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
Tetrachloroethene	5	µg/L	35.9	ND (5.0)	28.9	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	1.5 J	ND (5.0)	1.2 J	ND (1.0)
Trichloroethene	5	µg/L	154	215	166	2.2
Vinyl Chloride	2	µg/L	ND (10.0)	ND (10.0)	ND (10.0)	ND (2.0)
Mercury	0.25	mg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	N/A	mg/L	ND (5)	ND (5)	ND (5)	ND (5)

**Notes:**

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**January 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	January 2015	
Process Stream			Influent	Effluent
Sampling Date	N/A	N/A	1/12/15	
Average Flowrate	CFM	N/A	NR	8,555
Total Flow	ft <sup>3</sup>	N/A	NR	381,879,445
Total Flow	m <sup>3</sup>	N/A	NR	10,813,622
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	4.0 J	ND
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	250	60
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		3.4 J	ND
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	250	60
Toluene	µg/m <sup>3</sup>	N/A	4.5 J	ND
Total Xylene	µg/m <sup>3</sup>	N/A	4.2 J	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	ND	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	3,300	4.6
Vinyl Chloride	µg/m <sup>3</sup>	560	21	0.78 J
Tetrachloroethene	µg/m <sup>3</sup>	5,100	630	1.0 J

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Controlled Stack Emissions**  
**January 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	January 2015
Sampling Date	N/A	N/A	1/12/15
Average Flowrate	CFM	N/A	8,555
Total Flow	ft <sup>3</sup>	N/A	381,879,445
Total Flow	m <sup>3</sup>	N/A	10,813,622
Trichloroethene	lb/hr	0.09	0.00015
Vinyl Chloride	lb/hr	0.02	0.00002
1,2 Dichloroethene	lb/hr	11	0.00192
1,2-Dichloroethane	lb/hr	N/A	0.00000
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	0.18	0.00003

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**FEBRUARY 2015**



19 March 2015

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
FEBRUARY 2015 REPORTING PERIOD**

Dear Mr. Wilkie:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 February 2015 to 28 February 2015 are presented in Attachment A. There was no significant downtime for the GWTP during this reporting period.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
H&S Environmental, Inc.

A handwritten signature in blue ink, appearing to read "At Your Service".

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from February 2015

Cc: Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Al Taormina – H&S  
GM-38 Copy

**ATTACHMENT A**

**GROUNDWATER AND AIR SAMPLING RESULTS**

**FEBRUARY 2015**

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Report**  
**February 2015**

SPDES Parameters	February 2015					
Process Stream	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A				2/10/15, 2/25/15 <sup>(2)</sup>	
Average Flowrate	1100	GPM	843	206	1,049	1,088
Total Flow	N/A	gallons	33,980,550	8,315,467	42,296,017	43,857,200
pH	5.5 - 8.5	SU	5.07	4.94	5.04	6.25
Carbon Tetrachloride	NA	µg/L	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.4	2.7	2.5	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.8	1.8	2.6	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	18.5	1.9	15.2	0.54 J
trans 1,2-Dichloroethene	5	µg/L	0.31 J	ND (1.0)	0.25 J	ND (1.0)
Tetrachloroethene	5	µg/L	38.5	ND (1.0)	30.9	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	0.85 J	0.84 J	0.85 J	ND (1.0)
Trichloroethene	5	µg/L	189	231	197	1.1 J
Vinyl Chloride	2	µg/L	0.65 J	ND (2.0)	0.52 J	ND (2.0)
Mercury	0.25	mg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	N/A	mg/L	ND (5)	ND (5)	ND (5)	ND (5)

**Notes:**

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

(2) Samples were collected for VOC analysis on 2/10/15 and 2/25/15. Average analytical results are presented above.

Samples were collected for mercury and TSS analysis on 2/10/15 and pH analysis on 2/25/15.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**February 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	February 2015	
Process Stream			Influent	Effluent
Sampling Date	N/A	N/A	2/10/15	
Average Flowrate	CFM	N/A	NR	8,391
Total Flow	ft <sup>3</sup>	N/A	NR	338,310,265
Total Flow	m <sup>3</sup>	N/A	NR	9,579,880
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	5.1 J	ND
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	160	79
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		ND	ND
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	160	79
Toluene	µg/m <sup>3</sup>	N/A	1.1 J	ND
Total Xylene	µg/m <sup>3</sup>	N/A	ND	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	4.4 J	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	3,600	3.3 J
Vinyl Chloride	µg/m <sup>3</sup>	560	5.4	2.0
Tetrachloroethene	µg/m <sup>3</sup>	5,100	630	ND

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Controlled Stack Emissions**  
**February 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	February 2015
Sampling Date	N/A	N/A	2/10/15
Average Flowrate	CFM	N/A	8,391
Total Flow	ft <sup>3</sup>	N/A	338,310,265
Total Flow	m <sup>3</sup>	N/A	9,579,880
Trichloroethene	lb/hr	0.09	0.00010
Vinyl Chloride	lb/hr	0.02	0.00006
1,2 Dichloroethene	lb/hr	11	0.00248
1,2-Dichloroethane	lb/hr	N/A	0.00000
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	0.18	0.00000

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**MARCH 2015**



10 April 2015

Mr. Henry Wilkie  
New York State Department of Environmental Conservation  
Division of Solid & Hazardous Materials  
625 Broadway  
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT  
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2  
MARCH 2015 REPORTING PERIOD**

Dear Mr. Wilkie:

H&S Environmental, Inc. (H&S) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2.

GWTP operational data from 1 March 2015 to 31 March 2015 are presented in Attachment A. There was no significant downtime for the GWTP during this reporting period.

As indicated in Attachment A, all permitted constituents were in compliance with regulatory guidelines during this reporting period.

Please contact me at 508-366-7442 with any questions or concerns you may have regarding this report.

Sincerely,  
H&S Environmental, Inc.

A handwritten signature in blue ink, appearing to read "At Your Service".

Jennifer Good  
Project Manager

Attachment A: Groundwater and Air Sampling Results from March 2015

Cc: Steven Scharf – NYSDEC  
Jean Occidental - NYSDEC Division of Water  
Jennifer Pilewski - NYSDEC – Region 1 Water Engineer  
Gerard Ennis - Nassau County Department of Public Works  
Linda Bianculli - Town of Oyster Bay  
Lora Fly - NAVFAC Mid-Atlantic RPM  
Al Taormina – H&S  
GM-38 Copy

**ATTACHMENT A**  
**GROUNDWATER AND AIR SAMPLING RESULTS**  
**MARCH 2015**

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Discharge Monitoring Report**  
**March 2015**

SPDES Parameters		March 2015				
Process Stream	Daily Treated Effluent Maximum	Units	RW-1	RW-3	Combined Influent <sup>(1)</sup> (RW-1 + RW-3)	Treated Effluent
Well Depth	N/A	ft	445	530	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	N/A	N/A
Sampling Date	N/A				3/16/15	
Average Flowrate	1100	GPM	836	206	1,042	1,087
Total Flow	N/A	gallons	37,316,500	9,194,133	46,510,633	48,508,633
pH <sup>(2)</sup>	5.5 - 8.5	SU	5.49	5.05	5.40	6.36
Carbon Tetrachloride	NA	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	2.2 J	2.7 J	2.3 J	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	2.9 J	1.7 J	2.7 J	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	16.1	1.7 J	13.3 J	0.52 J
trans 1,2-Dichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
Tetrachloroethene	5	µg/L	39.5	ND (5.0)	31.7	ND (1.0)
1,1,1-Trichloroethene	5	µg/L	ND (5.0)	ND (5.0)	ND (5.0)	ND (1.0)
Trichloroethene	5	µg/L	164	230	177	0.81 J
Vinyl Chloride	2	µg/L	ND (10.0)	ND (10.0)	ND (10.0)	ND (2.0)
Mercury	0.25	mg/L	ND (0.00050)	ND (0.00050)	ND (0.00050)	ND (0.00050)
Total Suspended Solids (TSS)	N/A	mg/L	ND (5)	ND (5)	ND (5)	ND (5)

**Notes:**

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

N/A - Not Applicable

(1) Influent concentrations presented are the weighted average concentrations of RW-1 and RW-3.

(2) pH values were measured on 3/26/15.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Air Sampling Results**  
**March 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	March 2015	
Process Stream			Influent	Effluent
Sampling Date	N/A	N/A	3/12/15	
Average Flowrate	CFM	N/A	NR	8,416
Total Flow	ft <sup>3</sup>	N/A	NR	375,667,920
Total Flow	m <sup>3</sup>	N/A	NR	10,637,731
1,2-Dichloroethane	µg/m <sup>3</sup>	N/A	6.0 J	ND
cis 1,2-Dichloroethene	µg/m <sup>3</sup>	> 100,000 <sup>(2)</sup>	150	110
trans 1,2-Dichloroethene	µg/m <sup>3</sup>		ND	1.9 J
1,2-Dichloroethene (total)	µg/m <sup>3</sup>	>100,000	150	120
Toluene	µg/m <sup>3</sup>	N/A	ND	ND
Total Xylene	µg/m <sup>3</sup>	N/A	ND	ND
1,1,2-Trichloroethane	µg/m <sup>3</sup>	N/A	ND	ND
Trichloroethene	µg/m <sup>3</sup>	2,600	3,200	6.5
Vinyl Chloride	µg/m <sup>3</sup>	560	5.5	2.4
Tetrachloroethene	µg/m <sup>3</sup>	5,100	510	2.2 J

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

**GM-38 Area Groundwater Remediation**  
**Groundwater Treatment Plant**  
**Naval Weapons Industrial Reserve Plant - Bethpage, NY**  
**Controlled Stack Emissions**  
**March 2015**

DAR Parameters	Units	Discharge Goal <sup>(1)</sup>	March 2015
Sampling Date	N/A	N/A	3/12/15
Average Flowrate	CFM	N/A	8,416
Total Flow	ft <sup>3</sup>	N/A	375,667,920
Total Flow	m <sup>3</sup>	N/A	10,637,731
Trichloroethene	lb/hr	0.09	0.00020
Vinyl Chloride	lb/hr	0.02	0.00008
1,2 Dichloroethene	lb/hr	11	0.00378
1,2-Dichloroethane	lb/hr	N/A	0.00000
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	0.18	0.00007

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

**APPENDIX B**

**NYSDEC AIR DISCHARGE LIMIT  
DOCUMENTATION**

# New York State Department of Environmental Conservation

Division of Environmental Remediation  
Remedial Action Bureau A, 12<sup>th</sup> Floor  
625 Broadway, Albany, New York 12233-7015  
Phone: (518) 402-9620 FAX: (518) 402-9022



Joseph Martens  
Commissioner

October 31, 2013

Lora Fly  
Remedial Program Manager  
NAVFAC Mid-Atlantic  
Northeast IPT  
9742 Maryland Avenue  
Norfolk, VA, 23511-3095

RE: Northrop Grumman, Naval Weapons Industrial Reserve Plant (NWIRP) and Grumman Steel Los Sites, NYSDEC Site No.'s 1-30-003 A & B.

Dear Ms. Fly:

Tetra Tech NUS Inc., on behalf of the Department of the Navy NAVFAC Midlantic, has submitted an application to remove the GM 38 Area Groundwater Extraction and Treatment system impregnated Xeolite™ resin from the air discharge treatment system. Currently, the air treatment system uses a combined activated carbon with permanganate impregnated resin treatment train. The New York State Department of Environmental Conservation (NYSDEC) has reviewed the Department of the Navy application and concurs with the findings presented.

The routine monitoring, as detailed in Table 1, clearly indicates that vinyl chloride, one of the main contaminants of concern, has diminished to almost non-detect, and discharge concentrations have dropped to below the limit to require air treatment for the other contaminants as well. However, NAVFAC Midlantic is still proposing activated carbon to reduce the other discharge contaminant levels. Therefore, the NYSDEC hereby approves the proposed changes to the GM 38 Area air treatment. The Xeolite™ resin beds will remain in place should reactivation, based on routine monitoring, be required.

If you have any questions in the interim, please contact me at (518)402-9620.

Sincerely,

Steven M. Scharf, P.E.  
Project Engineer  
Remedial Action Bureau A  
Division of Environmental Remediation

EC: J. Swartwout  
S. Scharf  
W. Parish, Region 1  
S. Karpinski, NYSDOH  
E. Hannon, NGC  
D. Stern, Arcadis  
D. Brayack, TTNUS



**TETRA TECH**

NOR-01264

November 21, 2011

Mr. Stephen Scharf  
New York Department of Environmental Conservation  
Division of Environmental Remediation  
Bureau of Remedial Action A  
625 Broadway, 11<sup>th</sup> Floor  
Albany, New York 12233-7015

Reference: C LEAN Contract No. N62470-08-D-1001  
Contract Task Order WE06

Subject: Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds (VOCs)  
for Air Stripping Tower  
GM-38 Offsite Groundwater Treatment Plant,  
NWIRP Bethpage, New York

Dear Mr. Scharf:

On behalf of the Navy, please find enclosed a copy of the subject document. This document presents an evaluation of current concentrations of off gas VOCs from the GM-38 groundwater treatment plant air-stripping tower (prior to treatment with granular activated carbon). Maximum emission rates were re-evaluated due to decreasing maximum concentrations of target VOCs in un-treated air stripper AS-1 off gas. In addition, breakthrough of target contaminants (e.g., cis-1,2-dichloroethene) is beginning to occur in the granular activated carbon bed. Maximum emission rates were re-evaluated to provide a determination if breakthrough of contaminants would trigger the need for a replacement of the granular activated carbon bed.

Existing Discharge Goals were established in the "Final Operation, Maintenance and Monitoring Plan for Groundwater Treatment Plant GM -38 Area Groundwater Remediation" prepared by Tetra Tech EC (April 2010). Existing goals were based on emission estimates for a 95% reduction (see Attachment A), instead of being based on the original DAR-1 analysis of air stripper off gas. Emission estimates were calculated using the air stripper design flow rate of 8,000 cubic feet per minute (cfm), and previous contaminant discharge rates in pounds per hour (lb/hr). Original emission estimates are provided in Attachment B.


Proposed Revised Discharge Goals were calculated using an average flow rate of 9,200 cfm, January to March 2011 VOC loading rates (taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services), and the Actual Annual % of Annual Guideline Concentrations (AGCs), taken from the revised DAR-1 Model Output. The revised DAR-1 Model Output is provided in Attachment C. Existing Discharge Goals and Proposed Revised Discharge Goals are compared in tabular format in the first page of the attachment. Proposed Revised Discharge Goals for trichloroethene (TCE) are the same as previous. The proposed limit for tetrachloroethene (PCE) is approximately 10 times the previous limit, and vinyl chloride is approximately 2 times the previous limit. Revised Discharge Goals for 1,2-dichloroethene (goals are the same for cis-1,2-dichloroethene) are 100 times greater than previously established limits. It is recommended that these revised limits replace previous discharge goals, and treatment of air stripper off gas by granular activated carbon is recommended to continue for TCE and PCE, with no treatment required for vinyl chloride and 1,2-dichloroethene.

**Tetra Tech NUS, Inc.**

5700 Lake Wright Drive, Suite 309, Norfolk, VA 23502  
Tel 757.461.3768 Fax 757.461.4148 www.ttnus.com

If you have any questions please contact Ms. Lora Fly, NAVFAC Mid-LANT, at (757) 341-2012.

Sincerely,



David D. Brayack, P.E.  
Project Manager

Enclosure: (1) Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds  
(VOCs) for Air Stripping Tower  
GM-38 Offsite Groundwater Treatment Plant

Distribution:

Mid-Lant, Lora Fly  
NYSDEC (Albany), Henry Wilkie  
NYSDOH (Troy), Steve Karpinski  
NAVAIR, Richard Smith  
USEPA, Carol Stein  
NGC, Kent Smith  
Tetra Tech NUS, Dave Brayack  
ECOR Solutions, Al Taormina  
Administrative Record  
Public Repository  
Project File

**TABLE 1**  
**COMPARISON OF EXISTING DISCHARGE GOALS WITH ACTUAL EMISSIONS AND PROPOSED DISCHARGE GOALS**  
**AIR STRIPPING TOWER GM-38 OFFSITE GROUNDWATER TREATMENT PLANT**  
**NWIRP BETHPAGE, NEW YORK**

Chemical	Existing Discharge Goal		Actual January to March 2011 Values (Pre-Off Gas Treatment)		Proposed Revised Discharge Goals based on DAR-1 Analysis	
	Existing Discharge Loading Rate (pounds (lbs)/hour) <sup>(1)</sup>	Equivalent Existing Discharge Goals ( $\mu\text{g}/\text{m}^3$ ) <sup>(2)</sup>	Actual Jan-Mar 2011 Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(3)</sup>	Actual VOC Loading Pre-Off Gas Treatment (lbs/hour) <sup>(4)</sup>	Proposed Discharge Loading Rate (lbs/hour) <sup>(5)</sup>	Equivalent Proposed Discharge Goal ( $\mu\text{g}/\text{m}^3$ ) <sup>(5)</sup>
TCE	0.09	2,600	10,000	0.345	0.09	2,600
PCE	0.02	580	6,800	0.234	0.18	5,100
Vinyl Chloride	0.01	290	76	0.003	0.02	560
1,2-Dichloroethene (total)	0.03	870	750	0.026	11	greater than 100,000

**Notes:**

<sup>(1)</sup>Existing Discharge Goals are based on the design flow rate of 8,000 cfm. Existing Discharge Goals were taken from the Final Operations and Maintenance Plan for GM-38 Area Groundwater Remediation from Tetra Tech EC. Existing goals were based on emission estimates for a 95% reduction, and not the previous DAR-1 Analysis. Attachment B (provided at the end of this package) provides the original emission estimates.

<sup>(2)</sup>Existing Discharge Goals were calculated using the actual flow rate of 9,200 cfm and the existing discharge loading rate in pounds per hour (lb/hr).

<sup>(3)</sup>Values were taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 prior to treatment with vapor phase granular activated carbon (GAC), for the months of January, February and March 2011.

<sup>(4)</sup>Actual VOC Loading was calculated using an average flow rate of 9,200 cfm and the January-March 2011 concentrations. Existing off gas treatment consists of two stage vapor phase GAC followed by potassium permanganate zeolite media to provide additional treatment for vinyl chloride.

<sup>(5)</sup>Values were calculated using an average flow rate of 9,200 cfm, and the Actual Annual % of the AGCs from the 2011 DAR-1 Model Output to achieve air quality requirements.

**ATTACHMENT A**  
**2008 AIR PERMIT SUBMITTAL**

**New York State Department of Environmental Conservation  
Air Permit Application**



DEC ID	APPLICATION ID	OFFICE USE ONLY

### Section I - Certification

<b>Title V Certification</b>	
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons directly responsible for gathering the information [required pursuant to 6 NYCRR 201-6.3(d)] I believe the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations.	
Responsible Official	Title
Signature	Date     /     /

<b>State Facility Certification</b>	
I certify that this facility will be operated in conformance with all provisions of existing regulations.	
Responsible Official	Title
Signature	Date     /     /

### Section II - Identification Information

Title V Facility Permit N/A	State Facility Permit N/A
<input type="checkbox"/> New <input type="checkbox"/> Significant Modification	<input type="checkbox"/> New <input type="checkbox"/> Modification
<input type="checkbox"/> Renewal <input type="checkbox"/> Minor Modification	General Permit Title: _____
<input checked="" type="checkbox"/> Application involves construction of new facility <input type="checkbox"/> Application involves construction of new emission unit(s)	

<b>Owner/Firm</b>				
Name US Navy/NAVFAC Midlant				
Street Address 9742 Maryland Ave, Bldg Z-144				
City Norfolk	State VA	Country US	Zip 23511-3095	
Owner Classification <input checked="" type="checkbox"/> Federal <input type="checkbox"/> Corporation/Partnership	<input type="checkbox"/> State <input type="checkbox"/> Individual	<input type="checkbox"/> Municipal	Taxpayer ID: _____	
<b>Facility</b> <input type="checkbox"/> Confidential				
Name Naval Weapons Industrial Reserve Plant (NWIRP) GM-38 Area				
Location Address Bethpage				
<input type="checkbox"/> City / <input checked="" type="checkbox"/> Town / <input type="checkbox"/> Village Oyster Bay, New York	Zip 11714			
Project Description Air stripping of groundwater to remove VOCs			<input type="checkbox"/> Continuation Sheet(s)	

<b>Owner/Firm Contact Mailing Address</b>				
Name (Last, First, Middle Initial) Fly, Lora	Phone No. (757) 444-0781			
Affiliation Department of the Navy	Title Remedial PM	Fax No. ( )		
Street Address 9742 Maryland Ave. Bldg Z-144				
City Norfolk	State VA	Country US	Zip 23511-3095	
<b>Facility Contact Mailing Address</b>				
Name (Last, First, Middle Initial) Same	Phone No. ( )			
Affiliation	Title	Fax No. ( )		
Street Address				
City	State	Country	Zip	

**New York State Department of Environmental Conservation  
Air Permit Application**



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section III - Facility Information**

Classification					
<input type="checkbox"/> Hospital	<input type="checkbox"/> Residential	<input type="checkbox"/> Educational/Institutional	<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Industrial	<input type="checkbox"/> Utility

Affected States (Title V Only)					N/A
<input type="checkbox"/> Vermont	<input type="checkbox"/> Massachusetts	<input type="checkbox"/> Rhode Island	<input type="checkbox"/> Pennsylvania	Tribal Land:	
<input type="checkbox"/> New Hampshire	<input type="checkbox"/> Connecticut	<input type="checkbox"/> New Jersey	<input type="checkbox"/> Ohio	Tribal Land:	

SIC Codes											
9999											

Facility Description		<input type="checkbox"/> Continuation Sheet(s)
Groundwater Remediation by Air Stripping followed by Vapor-Phase GAC for emission control		

Compliance Statements (Title V Only)		N/A
I certify that as of the date of this application the facility is in compliance with all applicable requirements: <input type="checkbox"/> YES <input type="checkbox"/> NO		
If one or more emission units at the facility are not in compliance with all applicable requirements at the time of signing this application (the 'NO' box must be checked), the noncomplying units must be identified in the "Compliance Plan" block on page 8 of this form along with the compliance plan information required. For all emission units at this facility that are operating <u>in compliance</u> with all applicable requirements complete the following:		
<input type="checkbox"/> This facility will continue to be operated and maintained in such a manner as to assure compliance for the duration of the permit, except those units referenced in the compliance plan portion of Section IV of this application. <input type="checkbox"/> For all emission units, subject to any applicable requirements that will become effective during the term of the permit, this facility will meet all such requirements on a timely basis. <input type="checkbox"/> Compliance certification reports will be submitted at least once a year. Each report will certify compliance status with respect to each requirement, and the method used to determine the status.		

Facility Applicable Federal Requirements N/A										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
	CERCLA	all substantive	requirements							

Facility State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section III - Facility Information (continued)**

Facility Compliance Certification N/A									<input type="checkbox"/> Continuation Sheet(s)	
Rule Citation										
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
<input type="checkbox"/> Applicable Federal Requirement	<input type="checkbox"/> Capping	CAS No.		Contaminant Name						
<input type="checkbox"/> State Only Requirement	-	-		-						
Monitoring Information										
<input type="checkbox"/> Ambient Air Monitoring	<input type="checkbox"/> Work Practice Involving Specific Operations	<input type="checkbox"/> Record Keeping/Maintenance Procedures								
Description										
<hr/> <hr/> <hr/> <hr/> <hr/>										
Work Practice	Process Material					Reference Test Method				
Type	Code	Description								
Parameter										
Code	Description					Manufacturer Name/Model No.				
Limit				Limit Units						
Upper	Lower	Code	Description							
Averaging Method			Monitoring Frequency			Reporting Requirements				
Code	Description	Code	Description	Code	Description					

Facility Emissions Summary			<input type="checkbox"/> Continuation Sheet(s)		
CAS No.	Contaminant Name	PTE		Actual (lbs/yr)	
		(lbs/yr)	Range Code		
NY075 - 00 - 5	PM-10				
NY075 - 00 - 0	PARTICULATES				
7446 - 09 - 5	SULFUR DIOXIDE				
NY210 - 00 - 0	OXIDES OF NITROGEN				
630 - 08 - 0	CARBON MONOXIDE				
7439 - 92 - 1	LEAD				
NY998 - 00 - 0	VOC	117			
NY100 - 00 - 0	HAP	110			
0079 - 01 - 6	Trichloroethylene	99			
00075 - 01 - 4	Vinyl Chloride	3.7			
00540 - 59 - 0	1,2-Dichloroethylene	7.3			
- -					
- -					

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information

Emission Unit Description										<input type="checkbox"/> Continuation Sheet(s)		
EMISSION UNIT	0	-	0	0	E	U	1					
Air Stripper AS-1 for groundwater remediation, provided with activated carbon for emission control.												
The emission point is stack 00ST-1. The 2-stage VGAC is followed by a 3rd vessel containing potassium permanganate zeolite media for increased VC capacity.												

Building										<input type="checkbox"/> Continuation Sheet(s)	
Building	Building Name					Length (ft)	Width (ft)	Orientation			
BLDG-1	Treatment Plant					75	75	0			

Emission Point										<input type="checkbox"/> Continuation Sheet(s)
EMISSION PT.	00ST1									
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section					
					Length (in)	Width (in)				
90	40	15	36	80						
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal				
19	8020			BLDG-1	50					
EMISSION PT.										
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section					
					Length (in)	Width (in)				
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal				

Emission Source/Control										<input type="checkbox"/> Continuation Sheet(s)
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.			
ID	Type				Code	Description				
AS-1	I				048	Granular Act. Carbon	Air Stripping Column			
Design Capacity	Design Capacity Units				Waste Feed		Waste Type			
	Code	Description			Code	Description	Code	Description		
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.			
ID	Type				Code	Description				
Design Capacity	Design Capacity Units				Waste Feed		Waste Type			
	Code	Description			Code	Description	Code	Description		

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section IV - Emission Unit Information (continued)**

Process Information										<input type="checkbox"/> Continuation Sheet(s)				
EMISSION UNIT	0	-	0	0	E	U	1				PROCESS	P	R	1
<b>Description</b>														
<p>The remedial system is air stripping, using a packed column at a groundwater flow rate of 1,100 gpm (plus 100 gpm recycle, for a total of 1,200 gpm). Vapor phase treatment includes the use of 3 vessels, a 2-stage GAC unit, followed by a 3rd vessel containing a potassium permanganate impregnated zeolite for increased VC capacity. Prior to entering the vapor-phase GAC adsorption system, the humidity of the air stripper exhaust is reduced to approximately 50 percent or less to optimize the efficiency of the vapor-phase GAC.</p>														
<p>Air Stripper AS-1: Existing. Type: Vertical, Cylindrical Construction: Aluminum</p>														
<p>Packing: 25-foot Jaeger Tripack. Dimensions: 10.0 ft. Dia x 47 ft. H</p>														
Source Classification Code (SCC)		Total Thruput			Thruput Quantity Units									
		Quantity/Hr	Quantity/Yr	Code	Description									
<input type="checkbox"/> Confidential <input checked="" type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule			Building	Floor/Location								
		Hrs/Day	Days/Yr											
		24	365	BLDG-1										
Emission Source/Control Identifier(s)														
AS-1														
EMISSION UNIT	-										PROCESS			
<b>Description</b>														
<p> </p>														
Source Classification Code (SCC)		Total Thruput			Thruput Quantity Units									
		Quantity/Hr	Quantity/Yr	Code	Description									
<input type="checkbox"/> Confidential <input type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions		Operating Schedule			Building	Floor/Location								
		Hrs/Day	Days/Yr											
Emission Source/Control Identifier(s)														

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section IV - Emission Unit Information (continued)**

Emission Unit	Emission Point	Process	Emission Source	Emission Unit Applicable Federal Requirements								<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-

Emission Unit	Emission Point	Process	Emission Source	Emission Unit State Only Requirements								<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-

<b>Emission Unit Compliance Certification</b>										<input type="checkbox"/> Continuation Sheet(s)		
<b>Rule Citation</b>												
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause			
6	NYCRR	212										
<input checked="" type="checkbox"/> Applicable Federal Requirement					<input type="checkbox"/> State Only Requirement			<input type="checkbox"/> Capping				
Emission Unit	Emission Point	Process	Emission Source	CAS No.				Contaminant Name				
0-00EU1	00ST1	PR1	AS-1	00079 - 01 - 6				Trichloroethylene				
<b>Monitoring Information</b>												
<input type="checkbox"/> Continuous Emission Monitoring <input checked="" type="checkbox"/> Intermittent Emission Testing <input type="checkbox"/> Ambient Air Monitoring				<input type="checkbox"/> Monitoring of Process or Control Device Parameters as Surrogate <input type="checkbox"/> Work Practice Involving Specific Operations <input type="checkbox"/> Record Keeping/Maintenance Procedures								
<b>Description</b>												
Monthly grab samples analyzed for VOCs from the vapor phase treatment system influent, effluent and two intermediate locations.												
Work Practice		Process Material						Reference Test Method				
Type	Code	Description										
Parameter								Manufacturer Name/Model No.				
Code	Description											
23	Concentration											
Limit								Limit Units				
Upper	Lower		Code	Description								
3,125			255	micrograms per cubic meter								
Averaging Method			Monitoring Frequency						Reporting Requirements			
Code	Description		Code	Description						Code	Description	
01	Instantaneous		05	Monthly						10	Upon Request	

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section IV - Emission Unit Information (continued)**

Determination of Non-Applicability (Title V Only)							N/A	<input type="checkbox"/> Continuation Sheet(s)	
Rule Citation									
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement			
Description									
Rule Citation									
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement			
Description									
Process Emissions Summary									
EMISSION UNIT 0 - 0 0 E U 1								PROCESS	P R 1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined
0079 - 01 - 6	Trichloroethylene						95	1.87	02
PTE				Standard Units	PTE How Determined			Actual	
(lbs/hr)	(lbs/yr)	(standard units)	(lbs/hr)		(lbs/yr)				
0.09	99			02					
EMISSION UNIT 0 - 0 0 E U 1								PROCESS	P R 1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined
00075 - 01 - 4	Vinyl Chloride						95	0.17	03
PTE				Standard Units	PTE How Determined			Actual	
(lbs/hr)	(lbs/yr)	(standard units)	(lbs/hr)		(lbs/yr)				
0.01	3.7			02					
EMISSION UNIT 0 - 0 0 E U 1								PROCESS	P R 1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined
000540 - 59 - 0	1,2-Dichloroethylene						95	0.6	02
PTE				Standard Units	PTE How Determined			Actual	
(lbs/hr)	(lbs/yr)	(standard units)	(lbs/hr)		(lbs/yr)				
0.03	7.3			02					

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section IV - Emission Unit Information (continued)**

EMISSION UNIT		Emission Unit Emissions Summary				<input type="checkbox"/> Continuation Sheet(s)	
0	-	0	0	E	U	1	
CAS No.		Contaminant Name					
00107- 06 - 2		1,2-Dichloroethane					
ERP (lbs/yr)		PTE Emissions		Actual			
		(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
13.4		Below Reporting Threshold BRT					
CAS No.		Contaminant Name					
00108- 88 - 3		Toluene					
ERP (lbs/yr)		PTE Emissions		Actual			
		(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
72.7		BRT	BRT				
CAS No.		Contaminant Name					
01330- 20 - 7		Xylene					
ERP (lbs/yr)		PTE Emissions		Actual			
		(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
77.1		BRT	BRT				
CAS No.		Contaminant Name					
-	-	1,1,2-Trichloroethane					
ERP (lbs/yr)		PTE Emissions		Actual			
		(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)		
		BRT	BRT				

Compliance Plan											<input type="checkbox"/> Continuation Sheet(s)			
For any emission units which are not in compliance at the time of permit application, the applicant shall complete the following														
Consent Order			Certified progress reports are to be submitted every 6 months beginning ____ / ____ / ____											
Emission Unit	Process	Emission Source	Applicable Federal Requirement											
			Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause		
Remedial Measure / Intermediate Milestones										R/I	Date Scheduled			

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

**Section IV - Emission Unit Information (continued)**

Request for Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT											
Emission Reduction Description											
Contaminant Emission Reduction Data											
Baseline Period    /    /    to    /    /										Reduction	
										Date	Method
										/	/
CAS No.		Contaminant Name								ERC (lbs/yr)	
										Netting	Offset
Facility to Use Future Reduction											
Name										APPLICATION ID	
										/	/
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village					State			Zip			

Use of Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT											
Proposed Project Description											
Contaminant Emissions Increase Data											
CAS No.		Contaminant Name								PEP (lbs/yr)	
Statement of Compliance											
<input type="checkbox"/> All facilities under the ownership of this "ownership/firm" are operating in compliance with all applicable requirements and state regulations including any compliance certification requirements under Section 114(a)(3) of the Clean Air Act Amendments of 1990, or are meeting the schedule of a consent order.											
Source of Emission Reduction Credit - Facility											
Name										PERMIT ID	
										/	/
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village					State			Zip			
Emission Unit		CAS No.		Contaminant Name				ERC (lbs/yr)			
								Netting	Offset		

New York State Department of Environmental Conservation  
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Supporting Documentation

- P.E. Certification (form attached)
- List of Exempt Activities (form attached)
- Plot Plan
- Methods Used to Determine Compliance (form attached)
- Calculations
- Air Quality Model ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Confidentiality Justification
- Ambient Air Monitoring Plan ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Stack Test Protocols/Reports ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Continuous Emissions Monitoring Plans/QA/QC ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- MACT Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Operational Flexibility: Description of Alternative Operating Scenarios and Protocols
- Title IV: Application/Registration
- ERC Quantification (form attached)
- Use of ERC(s) (form attached)
- Baseline Period Demonstration
- Analysis of Contemporaneous Emission Increase/Decrease
- LAER Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- BACT Demonstration ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )
- Other Document(s): \_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_ ( \_\_\_\_ / \_\_\_\_ / \_\_\_\_ )

**ATTACHMENT B**  
**2008 EMISSION ESTIMATES BASED ON 95% REMOVAL**

**ATTACHMENT 1**  
**Emission Estimate**

Feed Water Flow 1,100 gpm: max or normal  
250 m<sup>3</sup>/hr

Water Flow Including Recycle 1,200 gpm: max or normal  
273 m<sup>3</sup>/hr

Air Flow 8,000 cfm  
13,592 m<sup>3</sup>/hr

A/W vol ratio 50

EXAMPLE EMISSION CALC: Vinyl Chloride

4.8 ug/L x 1000 L/m<sup>3</sup> x 250 m<sup>3</sup> water/13,623 m<sup>3</sup> air = 88 ug/m<sup>3</sup>

**POTENTIAL EMISSION ESTIMATES,  
USED TO DEVELOP 95% REDUCTION  
OF EMISSION VALUES AS BASED ON  
INFLUENT GROUNDWATER CONCENTRATIONS  
(95% REDUCTION OF EMISSION  
VALUES ARE PROVIDED  
ON PAGE 7 OF THE 2008 AIR  
PERMIT APPLICATION PROCESS  
EMISSIONS SUMMARY)**

Name	CAS Number	Toxicity: H/M/L <sup>2</sup>	VOC <sup>3</sup>	HAP <sup>4</sup>	GW Conc. <sup>1</sup>		Effluent Conc <sup>1</sup>		Uncontrolled Stripper Exhaust							
					Max ug/L	Avg ug/L	Max ug/L	Avg ug/L	Max lb/day	Avg lb/day	Max lb/hr	Avg lb/hr	Max gm/sec	Avg gm/sec	Max ug/m <sup>3</sup>	Avg ug/m <sup>3</sup>
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	3	3.0			0.04	0.04	0.00	0.00	2.08E-04	2.08E-04	55	55
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	3.5	0.3			0.05	0.00	0.00	0.00	2.43E-04	2.08E-05	64	6
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	4	0.7			0.05	0.01	0.00	0.00	2.77E-04	4.85E-05	74	13
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	3	1.0	0.3	0.1	0.04	0.01	0.00	0.00	1.87E-04	6.24E-05	55	18
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	9	1.6			0.12	0.02	0.00	0.00	6.24E-04	1.11E-04	165	29
1,2-Dichloroethylene	00540-59-0	M	Yes	No	1,100	31.5	1.3	0.0	14.51	0.42	0.60	0.02	7.62E-02	2.18E-03	20,219	579
Benzene	00071-43-2	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	1	0.1			0.01	0.00	0.00	0.00	6.94E-05	6.94E-06	18	2
Chloroform	00067-66-3	M	Yes	Yes	2	0.8			0.03	0.01	0.00	0.00	1.39E-04	5.55E-05	37	15
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	2	0.1			0.03	0.00	0.00	0.00	1.39E-04	6.94E-06	37	2
Tetrachloroethylene	00127-18-4	M	Yes	Yes	900	33.8	0.9	0.0	11.88	0.45	0.49	0.02	6.24E-02	2.34E-03	16,543	621
Toluene	00108-88-3	L	Yes	Yes	15	0.7			0.20	0.01	0.01	0.00	1.04E-03	4.85E-05	276	13
Trichloroethylene	00079-01-6	M	Yes	Yes	3,400	411.5	4.5	0.5	44.86	5.43	1.87	0.23	2.35E-01	2.85E-02	62,494	7,564
Vinyl chloride	00075-01-4	H	Yes	Yes	300	4.8	0.0	0.0	3.96	0.06	0.17	0.00	2.08E-02	3.33E-04	5,514	88
Xylenes	01330-20-7	M	Yes	Yes	16	0.2			0.21	0.00	0.01	0.00	1.11E-03	1.39E-05	294	4
Total VOCs					5,764	487.3	7.0	0.6	76.05	6.43	3.17	0.27				
Total HAPs					4,667	458.8	5.7	0.6	61.57	6.05	2.57	0.25				

Total Uncontrolled VOC 2,347 lb/yr

Total Uncontrolled HAP 2,209 lb/yr

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003

2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Toxics Section, September 10, 2007.

3. Source: 6 NYCRR Part 200 1(cg)

4. Source: 6 NYCRR Part 200.1(ag)

**ATTACHMENT 1**  
**Emission Estimate**

Feed Water Flow 1,100 gpm: max or normal  
250 m<sup>3</sup>/hr

Water Flow Including Recycle 1,200 gpm: max or normal  
273 m<sup>3</sup>/hr

Air Flow 8,000 cfm  
13,592 m<sup>3</sup>/hr

A/W vol ratio 50

Name	CAS Number	Toxicity: H/M/L <sup>2</sup>	VOC <sup>3</sup>	HAP <sup>4</sup>	Controlled Stripper Exha				
					GAC	Max lb/day	Avg lb/day	Max gm/sec	Avg gm/sec
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	95%	0.00	0.00	1.04E-05	1.04E-05
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	95%	0.00	0.00	1.21E-05	1.04E-06
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	95%	0.00	0.00	1.39E-05	2.43E-06
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	95%	0.00	0.00	9.36E-06	3.12E-06
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	95%	0.01	0.00	3.12E-05	5.55E-06
1,2-Dichloroethylene	00540-59-0	M	Yes	No	95%	0.73	0.02	3.81E-03	1.09E-04
Benzene	00071-43-2	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	95%	0.00	0.00	3.47E-06	3.47E-07
Chloroform	00067-66-3	M	Yes	Yes	95%	0.00	0.00	6.94E-06	2.77E-06
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	95%	0.00	0.00	6.94E-06	3.47E-07
Tetrachloroethylene	00127-18-4	M	Yes	Yes	95%	0.59	0.02	3.12E-03	1.17E-04
Toluene	00108-88-3	L	Yes	Yes	95%	0.01	0.00	5.20E-05	2.43E-06
Trichloroethylene	00079-01-6	M	Yes	Yes	95%	2.24	0.27	1.18E-02	1.43E-03
Vinyl chloride	00075-01-4	H	Yes	Yes	95%	0.20	0.00	1.04E-03	1.66E-05
Xylenes	01330-20-7	M	Yes	Yes	95%	0.01	0.00	5.55E-05	6.94E-07
Total VOCs					3.80	0.32			
Total HAPs					3.08	0.30			
					Total Controlled VOC	117 lb/yr			
					Total Controlled HAP	110 lb/yr			

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003  
 2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Tox  
 3. Source: 6 NYCRR Part 200.1(cg)  
 4. Source: 6 NYCRR Part 200.1(ag)

**ATTACHMENT C**  
**2011 DISCHARGE GOALS AND 2011 DAR-1 ANALYSIS**

Tetra Tech NUS

**STANDARD CALCULATION SHEET**

CLIENT: US CLEAN	FILE No:	BY: SK	PAGE: 1 of 1
SUBJECT: Calculation of Current Discharge Goals GM-38 Area NWIRP Bethpage, New York	CHECKED BY:		DATE: 9/7/2011

1. Purpose:

To calculate current discharge goals for Trichloroethene (TCE), Tetrachloroethene (PCE), Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total), for treatment of off-gas from the air stripper stack AS-1.

2. Approach:

From the Contaminant Assessment Summary of the DAR-1 Model output for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total) (see DAR-1 output for analysis inputs), use the Actual Annual % of the Annual Guideline Concentration (AGC), a current average flow rate of 9,200 cubic feet per minute (cfm), and influent chemical emission rates in pounds per hour (lb/hour) and pounds per year (lb/year) to back calculate current discharge goals.

3. Calculation of Current Discharge Goals:

Chemical	Current Actual Annual % of AGC <sup>(1)</sup>	Current Maximum Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(2)</sup>	Current Chemical Emission Rate Prior to Treatment (lb/hour) <sup>(3)</sup>	Current Chemical Emission Rate Prior to Treatment (lb/year) <sup>(3)</sup>	Calculated Discharge Goal (lb/hr) <sup>(4)</sup>	Calculated Discharge Goal (lb/year) <sup>(4)</sup>	Maximum Allowable Concentration ( $\mu\text{g}/\text{m}^3$ ) <sup>(4)</sup>
TCE	390.6	10,000	0.3446	3,019	0.0882	770	2,600
PCE	132.8	6,800	0.2344	2,053	0.1764	1,500	5,100
Vinyl Chloride	13.49	76	0.0026	22.94	0.0194	170	560
cis 1,2-Dichloroethene	0.2322	750	0.0258	226.4	11.13	98,000	320,000
1,2-Dichloroethene (total)	0.2322	750	0.0258	226.4	11.13	98,000	320,000

**Notes:**

<sup>(1)</sup>Actual Annual % of the AGCs is from the attached DAR-1 Model Output.

<sup>(2)</sup>Values were taken from the Quarterly Operations Report First Quarter 2011 (June 2011) from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 for the months of January, February, and March 2011.

<sup>(3)</sup>Chemical Emission Rates were calculated from maximum concentrations and an average flow rate of 9,200 cfm.

<sup>(4)</sup>Discharge Goals are based on a flow of 9,200 cfm, and calculated from the Actual Annual % of the AGCs from the DAR-1 Model Output to achieve air quality requirements. The summary of additional inputs for this model run is provided in the DAR-1 Model Output. Stack height is 40 feet, and the property line was evaluated at a distance of 50 feet.

BETHPAGE SITE GM-38 OFF-SITE GROUNDWATER AIR STRIPPER STACK EMISSIONS  
 DAR-1 MODEL OUTPUT, POINT SOURCE (STACK EMISSIONS) TYPE  
 INCLUDES ISCLT MODELING SUMMARY

- I. Summary of Inputs for Model Run to Nearest Property Line (50 feet), worst case scenario (highest contaminant concentrations seen in first quarter 2011 in untreated effluent from Air Stripper AS-1 prior to treatment with granular activated carbon (GAC))

Chemical	CAS No. 00079-01-6 (TCE)	CAS No. 00127-18-4 (PCE)	CAS No. 00075-01-4 (Vinyl Chloride)	CAS No. 00156-59-2 (cis 1,2-Dichloroethene)	CAS No. 00540-59-0 (1,2-Dichloroethene, total)
Emission Rate Prior to Treatment <sup>(1)</sup> (lb/hour)	0.3444	0.2342	0.0026	0.0258	0.0258
Emission Rate Prior to Treatment <sup>(1)</sup> (lb/year)	3,017	2,052	22.93	226.0	226.0
Maximum Concentration of Untreated Off Gas ( $\mu\text{g}/\text{m}^3$ ) <sup>(1)</sup>	10,000	6,800	76	750	750
Annual Guideline Concentration (AGC) ( $\mu\text{g}/\text{m}^3$ )	0.5	1.0	0.11	63	63
Short-term Guideline Concentration (SGC) ( $\mu\text{g}/\text{m}^3$ )	14,000	1,000	180,000	--	--

HA	Height Above stack/ maximum height of plume (HA, feet)	15
SH	Stack Height/Treatment Building Air Stack (SH, feet)	40
D	Stack Diameter (D, inches)	36
T	Stack Exit Temperature (T, degrees Fahrenheit)	80
V	Stack Exit Velocity (V, ft/sec)	21.69
Q <sup>(2)</sup>	Stack Exit Flow Rate [Q, Actual Cubic Feet per Minute (ACFM)]	9,200
Dpl	Shortest Distance from Source Building (Treatment Building) to Property Line (Dpl, feet) for point sources	50
BW	Building Width (BW, feet) of Source Building (Treatment Building) for point sources	75
BL	Building Length (BL, feet) of Source Building (Treatment Building)	75
Q	Actual Hourly Emission Rate (lbs/hour) for source contaminant	Chemical specific, see above
Qa	Actual Annual Emission Rate (lbs/year) for source contaminant	Chemical specific, see above

<sup>(1)</sup> Emission rates and maximum concentration values were taken from the Quarterly Operations Report First Quarter (June 2011) as provided by ECOR Services, using January, February, and March 2011 maximum rates of untreated off gas from Air Stripper AS-1 in the

GM-38 Treatment Building. Emission rates are based on continuous operation 24 hours per day, 7 days a week, 52 weeks a year, or approximately 8,760 hours of operation.

<sup>(2)</sup>"Q" is an average value of January and February 2011 monthly flow rates. Effective water and vapor flow rates were reduced during the reporting period of March due to a shutdown of the Treatment Plant on March 23, 2011.

II. Contaminant Assessment Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT ASSESSMENT SUMMARY OF DOR-1 ANALYSIS						9/ 8/11
CAS NUMBER	AGC ug/m <sup>3</sup>	SHORT-TERM		CAVITY		POINT or AREA SOURCE Page 1
		MAXIMUM (Gav,Pt,Area) ug/m <sup>3</sup>	% OF AGC	ACTUAL ANNUAL ug/m <sup>3</sup>	POTENTIAL ANNUAL ug/m <sup>3</sup>	
00075-01-4	0.11000000	0.0005	0.0000	13.3889	13.4948	
00079-01-6	0.50000000	0.7757	0.0000	390.1734	398.6266	
00127-18-4	1.00000000	7.3852	0.0000	132.6635	132.8415	
00156-59-2	63.00000000	0.0000	0.0000	0.2320	0.2322	
00540-59-0	63.00000000	0.0000	0.0000	0.2320	0.2322	
SUMMARY TOTALS		8.1614	0.0000	536.6897	537.4274	

III. Contaminant Impact Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT IMPACT SUMMARY OF DOR-1 ANALYSIS						9/ 8/11
CAS NUMBER	AGC ug/m <sup>3</sup>	SHORT-TERM		CAVITY		POINT or AREA SOURCE Page 1
		MAXIMUM (Gav,Pt,Area) ug/m <sup>3</sup>	ACTUAL ANNUAL ug/m <sup>3</sup>	POTENTIAL ANNUAL ug/m <sup>3</sup>	ACTUAL ANNUAL ug/m <sup>3</sup>	
00075-01-4	0.11000000	0.81988204	0.00000000	0.01472780	0.01484433	
00079-01-6	0.50000000	108.60282900	0.00000000	1.95086694	1.95313276	
00127-18-4	1.00000000	73.85244750	0.00000000	1.32663476	1.32841584	
00156-59-2	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	
00540-59-0	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	

IV. Contaminant Impact Summary Step by Step Menu for TCE:

```
*****  
NUIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00079-01-6      SIC =    0  
AGC =           0.500000000 ug/m3      SGC =       14000.000000 ug/m3  
STACK: HA=     15., SH=   40., D=   36., T=   80., U=   21.69, Q=   9200.00  
BUILDING: Dpl=    50., BW=   75., BL=   75., %CONTROL=   0.0000  
** Reported Hourly Emission Rate (Q) is equal to      0.344400000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to      3017.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet >) is less than or equal to the cavity length, or 3 building heights (< 75. feet >). Therefore, this building will have cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet >) is greater than or equal to the building height (< 25. feet >). Therefore, the computer will NOT redefine the cavity length.  
II.B.3. Stack height (< 40. feet >) is greater than cavity height (< 38. feet >). Therefore, this source does not contribute to the buildings cavity impact. The Computer will assume the CAVITY Annual Impact equals 0.00 ug/m3.  
II.C. CAVITY Annual Impact (< 0.000 ug/m3 >) is less than AGC (< 0.500 ug/m3 >).  
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).  
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.  
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal to 2.604 ug/m3 for 8760. hours/year of operation.  
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal to 2.601 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a. Stack height to building height ratio is greater than 1.5, but less than 2.5. Computer will multiply actual annual & potential annual impacts by 0.75 factor.
```

- III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
- III.D. STANDARD POINT SOURCE Actual Annual Impact (< 1.953 ug/m<sup>3</sup> > is greater than AGC (< 0.500 ug/m<sup>3</sup> >).
- \*\*\*\* Refer to DAR-1 Section III.D.1. A refined site specific modeling analysis may be required.
- III.D. STANDARD POINT SOURCE Potential Annual Impact (< 1.951 ug/m<sup>3</sup> > is greater than AGC (< 0.500 ug/m<sup>3</sup> >).
- \*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\* operation instead of reported 8760. hours/year.
- 2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.
- 2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m<sup>3</sup> as the plume escaped the cavity region: hs(< 40. feet) > hc(< 26. feet).
- III.C. CAVITY Short-Term Impact (< 0.000 ug/m<sup>3</sup> > is less than SGC (< 14000.000 ug/m<sup>3</sup> >).
- 2.3 Momentum flux, F<sub>m</sub>, is equal to 1000.331 ft(4)/sec(2).  
2.3 Effective stack height, h<sub>e</sub>, is equal to 51.001 feet.  
2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 38.826 ug/m<sup>3</sup>, for hs/hb = 1.60  
2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 129.908 ug/m<sup>3</sup>, for: hs/hb = 1.60 and ESH = 51. feet.  
2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 108.603 ug/m<sup>3</sup>, for: RF = 0.84  
III.D. Maximum non-cavity Short-Term Impact (CST: 108.603 ug/m<sup>3</sup>) is less than the SGC (< 14000.000 ug/m<sup>3</sup> > for the point source.  
2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 108.603 ug/m<sup>3</sup> and is reported in the ANALYSIS MENU. This value is less than the SGC (< 14000.000 ug/m<sup>3</sup> >).

V. Contaminant Impact Summary Step by Step Menu for PCE:

```
*****  
HVICP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00127-18-4      SIC =     0  
AGC =           1.000000000 ug/m3      SGC =       1000.000000 ug/m3  
STACK: HA=    15., SH=   40., D=   36., T=   80., U=   21.69, q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., %CONTROL=   0.0000  
** Reported Hourly Emission Rate (Q) is equal to      0.234200000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to      2052.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet >  
is less than or equal to the cavity length, or 3 building  
heights (< 75. feet >). Therefore, this building will have  
cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet >) is greater than or  
equal to the building height (< 25. feet >). Therefore, the  
computer will NOT redefine the cavity length.  
II.B.3. Stack height (< 40. feet >) is greater than cavity height  
< 38. feet >. Therefore, this source does not contribute to  
the buildings cavity impact. The Computer will assume the  
CAVITY Annual Impact equals 0.00 ug/m3.  
II.C. CAVITY Annual Impact (< 0.000 ug/m3 >) is less than AGC  
< 1.000 ug/m3 >.  
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.  
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.  
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal  
to 1.771 ug/m3 for 8762. hours/year of operation.  
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal  
to 1.769 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a. Stack height to building height ratio is greater than  
1.5, but less than 2.5. Computer will multiply actual  
annual & potential annual impacts by 0.75 factor.
```

III.B.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.B. STANDARD POINT SOURCE Actual Annual Impact (< 1.326 ug/m<sup>3</sup> > is greater than AGC (< 1.000 ug/m<sup>3</sup> >).

\*\*\*\*\* Refer to DAR-1 Section III.B.1. A refined site specific modeling analysis may be required.

III.D. STANDARD POINT SOURCE Potential Annual Impact (< 1.327 ug/m<sup>3</sup> > is greater than AGC (< 1.000 ug/m<sup>3</sup> >).

\*\*\*\*\* Potential Annual Impact is based upon 8760 hours/year operation instead of reported 8762. hours/year.

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m<sup>3</sup> as the plume escaped the cavity region: hs(< 40. feet) > hc(< 26. feet).

II.C. CAVITY Short-Term Impact (< 0.000 ug/m<sup>3</sup> > is less than SGC (< 1000.000 ug/m<sup>3</sup> >).

2.3 Momentum Flux, F<sub>m</sub>, is equal to 1000.331 ft<4>/sec<2>.

2.3 Effective stack height, h<sub>e</sub>, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 26.403 ug/m<sup>3</sup>, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 88.349 ug/m<sup>3</sup>, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 73.852 ug/m<sup>3</sup>, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 73.852 ug/m<sup>3</sup> > is less than the SGC (< 1000.000 ug/m<sup>3</sup> > for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 73.852 ug/m<sup>3</sup> and is reported in the ANALYSIS MENU. This value is less than the SGC (< 1000.000 ug/m<sup>3</sup> >).

VI. Contaminant Impact Summary Step by Step Menu for Vinyl Chloride:

```
*****  
NUJRP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00075-01-4      SIC =     0  
AGC =           0.110000000 ug/m3      SGC =       180000.000000 ug/m3  
STACK: HA=    15., SH=   40., D=   36., T=   80., U=   21.69, q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., zCONTROL=   0.0000  
** Reported Hourly Emission Rate <Q> is equal to      0.002600000 lbs/hour.  
** Reported Annual Emission Rate <Qa> is equal to      22.9300000 lbs/year.  
II.B. Refined CAVITY IMPACT METHOD (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line < 50. feet >  
is less than or equal to the cavity length, or 3 building  
heights < 75. feet >. Therefore, this building will have  
cavity impacts <if they occur> at receptors off plant property.  
II.B.2. The largest building dimension < 75. feet > is greater than or  
equal to the building height < 25. feet >. Therefore, the  
computer will NOT redefine the cavity length.  
II.B.3. Stack height < 40. feet > is greater than cavity height  
< 38. feet >. Therefore, this source does not contribute to  
the buildings cavity impact. The Computer will assume the  
CAVITY Annual Impact equals 0.00 ug/m3.  
II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC  
< 0.110 ug/m3 >.  
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).  
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.  
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal  
to 0.020 ug/m3 for 8819. hours/year of operation.  
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal  
to 0.020 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a. Stack height to building height ratio is greater than  
1.5, but less than 2.5. Computer will multiply actual  
annual & potential annual impacts by 0.75 factor.
```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.015 ug/m<sup>3</sup> > is less than AGC < 0.110 ug/m<sup>3</sup> >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.015 ug/m<sup>3</sup> > is less than AGC < 0.110 ug/m<sup>3</sup> >.

\*\*\*\*\* Potential Annual Impact is based upon 8760 hours/year  
\*\*\*\*\* operation instead of reported 8819. hours/year. \*\*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Vade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m<sup>3</sup> as the plume escaped the cavity region: hs< 40. Feet > hc< 26. Feet >.

II.C. CAVITY Short-Term Impact < 0.000 ug/m<sup>3</sup> > is less than SGC < 180000.000 ug/m<sup>3</sup> >.

2.3 Momentum flux, F<sub>m</sub>, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, h<sub>e</sub>, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 0.293 ug/m<sup>3</sup>. For hc/hb = 1.68

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 0.991 ug/m<sup>3</sup>. For: hs/hb = 1.68 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 0.820 ug/m<sup>3</sup>. for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 0.820 ug/m<sup>3</sup> > is less than the SGC < 180000.000 ug/m<sup>3</sup> > for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 0.820 ug/m<sup>3</sup> and is reported in the ANALYSIS MENU. This value is less than the SGC < 180000.000 ug/m<sup>3</sup> >.

VII. Contaminant Impact Summary Step by Step Menu for cis 1,2-Dichloroethene:

```
*****  
NUIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00156-59-2      SIC =      0  
    AGC =       63.000000000 ug/m3      SGC =       0.0000000 ug/m3  
    STACK: HA=   15., SH=   40., D=   36., T=   80., U=   21.69, q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., %CONTROL=   0.0000  
*** Reported Hourly Emission Rate <Q> is equal to      0.025800000 lbs/hour.  
*** Reported Annual Emission Rate <Qa> is equal to      226.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line < 50. feet >  
is less than or equal to the cavity length, or 3 building  
heights < 75. feet >. Therefore, this building will have  
cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension < 75. feet > is greater than or  
equal to the building height < 25. feet >. Therefore, the  
computer will NOT redefine the cavity length.
```

II.B.3. Stack height < 40. feet > is greater than cavity height  
< 38. feet >. Therefore, this source does not contribute to  
the buildings cavity impact. The Computer will assume the  
CAVITY Annual Impact equals 0.00 ug/m3.

II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC  
< 63.000 ug/m3 >.

III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).

III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).

III.A.1.b. Effective stack height, he, is equal to 51.001 feet.

III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal  
to 0.195 ug/m3 for 8760. hours/year of operation.

III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal  
to 0.195 ug/m3 assuming 8,760 hours/year of operation.

III.A.4.a. Stack height to building height ratio is greater than  
1.5, but less than 2.5. Computer will multiply actual  
annual & potential annual impacts by 0.75 factor.

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m<sup>3</sup> > is less than AGC < 63.000 ug/m<sup>3</sup> >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m<sup>3</sup> > is less than AGC < 63.000 ug/m<sup>3</sup> >.

\*\*\*\*\* Potential Annual Impact is based upon 8760 hours/year \*\*\*\*\*  
\*\*\*\*\* operation instead of reported 8760. hours/year. \*\*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.  
See "Technical Reference for the Screening Procedures of the  
DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m<sup>3</sup> as the plume escaped the cavity region: hs( 40. feet) > hc( 26. feet).

III.C. CAVITY Short-Term Impact is equal to 0.000 ug/m<sup>3</sup>.  
There is no SGC for this contaminant.

2.3 Momentum Flux, Fm, is equal to 1000.331 Ft(4)/sec(2).

2.3 Effective stack height, he, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 2.909 ug/m<sup>3</sup>, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 9.732 ug/m<sup>3</sup>, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSID) is equal to 8.136 ug/m<sup>3</sup>, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST) equals 8.136 ug/m<sup>3</sup> for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 8.136 ug/m<sup>3</sup> and is reported in the ANALYSIS MENU.

VIII. Contaminant Impact Summary Step by Step Menu for 1,2-Dichloroethene (total):

```
*****  
NWIRP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00540-59-0      SIC =    0  
AGC =           63.000000000 ug/m3      SGc =           0.000000 ug/m3  
STACK: HA=   15., SH=   40., D=   36., T=   80., U=   21.69, q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., %CONTROL=   0.0000  
** Reported Hourly Emission Rate <Q> is equal to      0.025800000 lbs/hour.  
** Reported Annual Emission Rate <Qa> is equal to      226.000000 lbs/year.  
II.B.  Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1.  Shortest Distance from building to Property Line < 50. feet >  
is less than or equal to the cavity length, or 3 building  
heights < 75. feet >. Therefore, this building will have  
cavity impacts <if they occur> at receptors off plant property.  
II.B.2.  The largest building dimension < 75. feet > is greater than or  
equal to the building height < 25. feet >. Therefore, the  
computer will NOT redefine the cavity length.  
II.B.3.  Stack height < 40. feet > is greater than cavity height  
< 38. feet >. Therefore, this source does not contribute to  
the buildings cavity impact. The Computer will assume the  
CAVITY Annual Impact equals 0.00 ug/m3.  
II.C.  CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC  
< 63.000 ug/m3 >.  
III.A.  STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b.  Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).  
III.A.1.b.  Effective stack height, he, is equal to 51.001 feet.  
III.A.2.  STANDARD POINT SOURCE Actual Annual Impact is equal  
to 0.195 ug/m3 for 8760. hours/year of operation.  
III.A.3.  STANDARD POINT SOURCE Potential Annual Impact is equal  
to 0.195 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a.  Stack height to building height ratio is greater than  
1.5, but less than 2.5. Computer will multiply actual  
annual & potential annual impacts by 0.75 factor.
```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m<sup>3</sup> > is less than AGC < 63.000 ug/m<sup>3</sup> >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m<sup>3</sup> > is less than AGC < 63.000 ug/m<sup>3</sup> >.

\*\*\*\* Potential Annual Impact is based upon 8760 hours/year  
\*\*\*\* operation instead of reported 8760. hours/year. \*\*\*\*

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m<sup>3</sup> as the plume escaped the cavity region: hs( 40. feet) > hc( 26. feet).

II.C. CAVITY Short-Term Impact is equal to 0.000 ug/m<sup>3</sup>. There is no SGC for this contaminant.

2.3 Momentum Flux, F<sub>M</sub>, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, h<sub>e</sub>, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 2.909 ug/m<sup>3</sup>, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 9.732 ug/m<sup>3</sup>, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 8.136 ug/m<sup>3</sup>, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST) equals 8.136 ug/m<sup>3</sup> for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 8.136 ug/m<sup>3</sup> and is reported in the ANALYSIS MENU.

IX. AGCs and SGCS for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethylene, and 1,2-Dichloroethene (total):

CAS NUMBER	CONTAMINANT NAME	AGCs & SGCS				9/ 8/11 Page 1
		SGC ug/m <sup>3</sup>	H O M	AGC ug/m <sup>3</sup>	H I O D U X	
00075-01-4	VINYL CHLORIDE	180000.00000	D	0.110000000	E H U HA	
00079-11-6	TRICHLOROETHYLENE	14000.00000	Z	0.500000000	D H U HD	
00127-18-4	TETRACHLOROETHYLENE	1000.00000	H	1.000000000	H M U HI	
00156-59-2	DICHLOROETHYLENE, cis	0.00000		63.000000000	D M	
00540-59-0	DICHLOROETHYLENE, 1,2	0.00000		63.000000000	D M	

X. Contaminant Emissions Summary for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT EMISSIONS SUMMARY					9/ 8/11 Page 1
CAS NUMBER	CONTAMINANT NAME	NUM. OF EPs PER CONTAM.	EMISSIONS (lbs/hour)	EMISSIONS (lbs/year)	
00075-01-4	VINYL CHLORIDE	1	0.0026000	22.93000	
00079-01-6	TRICHLOROETHYLENE	1	0.3444000	3017.00000	
00127-18-4	TETRACHLOROETHYLENE	1	0.2342000	2052.00000	
00156-59-2	DICHLOROETHYLENE, cis	1	0.0258000	226.00000	
00540-59-0	DICHLOROETHYLENE, 1,2	12	0.0258000	226.00000	
SUMMARY TOTALS		5	0.6328000	5543.93000	

XI. Meter Grid Modeling Results for Maximum Annual Concentrations of TCE, within 25 meters:

CONCENTRATIONS × 10 <sup>-2</sup> (ug/m <sup>3</sup> ) for 00079-01-6										09/08/11 13:17:58
TIME ↑	UTMN ↑	AGC = 0.500000000 ug/m <sup>3</sup>	367000.	369000.	371000.	373000.	375000.	377000.	379000.	
4511000.	0.04 0.06 0.08 0.14 0.23 0.32 0.41 0.30 0.14 0.10 0.08 0.06 0.05	366000.	370000.	372000.	374000.	376000.	378000.			
4510000.	0.03 0.05 0.08 0.13 0.25 0.43 0.60 0.40 0.17 0.12 0.09 0.07 0.06									
4509000.	0.02 0.03 0.06 0.11 0.24 0.58 1.01 0.52 0.22 0.14 0.11 0.08 0.06									
4508000.	0.02 0.03 0.04 0.06 0.18 0.62 2.16 0.64 0.31 0.19 0.13 0.11 0.09									
4507000.	0.02 0.03 0.04 0.06 0.11 0.26 7.27 1.43 0.60 0.34 0.22 0.15 0.12									
4506000.	0.03 0.03 0.05 0.07 0.13 0.33 2.58 2.99 1.12 0.51 0.30 0.20 0.14									
4505000.	0.03 0.04 0.05 0.08 0.20 0.45 0.94 0.81 0.60 0.45 0.33 0.23 0.16									
4504000.	0.03 0.04 0.07 0.12 0.20 0.22 0.47 0.43 0.33 0.27 0.24 0.20 0.16									

TOP 100 CONTRIBUTORS TO MAXIMUM CONCENTRATION FOR 00079-01-6					09/08/11 13:17:58
Emission Point	Facility Name (shortened)	EP	Distance to Max.(m)	CONC. ug/m <sup>3</sup>	Percent of Max.
TOTAL	NWIRP BETHPAGE GM-38 AREA	SSE	539.	0.727E-01	100.000
TOTAL OF ALL	1 CONTRIBUTORS			0.727E-01	100.000

XII. ISCLT Model Run Information, within 25 meters:

MODEL RUN INFORMATION		09/08/11 13:17:58
1.	Current GRID SPACING equals 1000. meters.	
2.	Maximum Concentration (flashing) equals 0.0727115273 ug/m <sup>3</sup> @ UTME: 373000. UTMN: 4507800.	
3.	RUN FILE: TEMP7.RUN	
4.	METEOROLOGICAL FILE: ALB.MET	
5.	RUN MODE: URBAN	
6.	HALF-LIVES: not used to account for pollutant removal from air.	
7.	BLD. WAKE EFFECTS: RG-1 METHOD, all data KNOWN (hh,hu,hl,orientation)	
8.	EMISSIONS: ACTUAL ANNUAL EMISSIONS	
9.	SOURCES: All sources within 25. meters of UTME: 373275. UTMN: 4506537.	
10.	CONTAMINANT CAS NUMBER(s): 80079-81-6	
11.	EMISSION POINT - CONTAMINANT(s) found by computer: 1	
12.	No data is being copied to DUMP file.	

**APPENDIX C**

**FIELD LOGS AND**  
**CHAIN OF CUSTODY DOCUMENTATION**

03/25/15

Date: 03/25/15



## Groundwater Level Measurement Sheet

Project Site: NWIRP Bethpage – GM-38

Location: Bethpage, NY

Field Crew: RMJRH

Water Level Meter: Solinst

Weather: Clear 28°F

Time of Low Tide: N/A

Time of High Tide: N/A

Well ID	Time	Depth to Water (ft.)	Total Depth of Well / Screed Interval (ft.)	PID (ppm)	Comments
RW1-MW1	10:30	35.72	435 / 395-435	---	
RW1-MW2	08:30	37.74	435 / 395-435	---	
RW1-MW3	18:40	27.58	435 / 395-435	---	
RW2-MW1	08:20 19:30	38.09	510 / 470-510	---	
RW2-MW2	19:35	37.51	510 / 470-510	---	
RW2-MW3	19:40	38.12	510 / 470-510	---	
RW3-MW1	14:35	35.95	350 / 330-350	---	
RW3-MW2	17:40	39.62	495 / 475-495	---	
RW3-MW3	11:50	37.25	340 / 320-340	---	
RW3-MW4	12:00	37.65	495 / 475-495	---	
TP1	08:48	35.05	470 / 450-470	---	
IW1-MW1	08:40	45.54	470 / 450-470	---	
RW-1	08:34	61.99	Open vault and check integrity of piping, etc.		
RW-3	Condition:	good	Open vault and check integrity of piping, etc.		

Signature: FMJRH

Date: 3-25-15

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 1 - MW 1

Date: 03/25/15  
 Sampler: RM/RH  
 PID: \_\_\_\_\_



Start Time: 10:35 End Time: 11:15

Well Construction: 4"

Depth to Water: 35.62

Well Depth: 43.50

Water Column: 39.91.98

Total Volume Removed (L): 28.0

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14100055
LaMotte	2020e	1862
QED	MP15	Rental 1
Marschalk Bladder Pump	24"	ID# 22259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>3</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
10:45	~2.0	~200	35.62	13.53	5.09	182	2.71	218.7		CLEAR
10:50	~3.0	~200	35.61	13.66	5.04	182	2.47	222.5	0.40	CLEAR
10:55	~4.0	~200	35.62	14.05	5.00	182				CLEAR
11:00	~5.0	~200	35.62	14.05	5.00	182	1.80	232.4	0.61	CLEAR
11:05	~6.0	~200	35.68	14.38	4.84	181	1.58	244.0	0.60	CLEAR
11:10	~7.0	~200	35.62	14.29	4.79	182	1.57	243.9	0.20	CLEAR
11:15	~8.0	~200	35.61	14.22	4.72	182	1.58	244.3	0.19	CLEAR

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
11:15	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 1 - MW 1 - 20150325	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

\_\_\_\_\_

RM

Signature

3-25-15

Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 1 - MW 3

Date: 03/25/15  
 Sampler: BM/RH  
 PID: -----



Start Time: 18:45 End Time: 19:15

Well Construction: 4"

Depth to Water: 27.58

Well Depth: 435

Water Column: 407.012

Total Volume Removed (L): ~450

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F160055
LaMotte	2020e	18102
QED	MP15	Rental
Marschalk Bladder Pump	24"	ID# 22259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1855	150	150	27.59	10.78	5.44	185	2.94	244.3	3.84	Clear
1900	225	150	27.57	11.46	5.45	180	1.75	215.5	3.44	Clear
1905	3.0	150	27.56	11.91	5.44	190	1.24	268.3	4.65	Clear
1910	3.75	150	27.57	11.99	5.44	193	1.17	167.4	4.98	Clear
1915	4.50	150	27.56	12.00	5.44	192	1.19	168.3	3.42	Clear

Acceptance Criteria:

<0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
19:15	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 1 - MW 3 - 2015 03 25	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

*DM*

Signature

3-25-15

Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW2 - MW 1

Date: 03/26/15  
 Sampler: RM / RH  
 PID: -----



Start Time: 08:20 End Time: 08:50

Well Construction: 4"

Depth to Water: 38.09

Well Depth: 510

Water Column: 471.91

Total Volume Removed (L): 15.25

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100058
LaMotte	2020e	1862
QED	MP15	Rental
Marschalk Bladder Pump	24"	ID# 27259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>3</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
08:30	1.75	175	38.14	12.18	8.57	301	4.11	162.0	2.81	Clear
08:35	~2.00	175	38.21	12.24	8.65	300	4.20	161.3	2.63	Clear
08:40	~3.50	175	38.30	12.27	8.84	300	0.99	159.0	2.11	Clear
08:45	~4.40	175	38.31	12.32	8.80	299	0.82	153.4	2.06	Clear
08:50	~5.25	175	38.34	12.42	8.92	291	0.86	157.1	2.09	Clear

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
08:50	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW2 - MW1 - 20150326	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

PM

Signature

3/26/15

Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 1

Date: 03/25/15  
 Sampler: nm/RH  
 PID: -----



Start Time: 14:40 End Time: 15:45  
 Well Construction: 4"  
 Depth to Water: 35.95  
 Well Depth: # 350.00  
 Water Column: 314.05  
 Total Volume Removed (L): ~ 17,40  
 Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100058
LaMotte	2020e	18602
QED	MP15	Rental
Marschalk Bladder Pump	24"	ID# 22259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>6</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
14:50	~1.5	175	35.96	10.78	4.89	138	3.41	262.4	5.53	Clear
14:55	~2.4	175	35.94	10.75	4.88	138	2.91	246.5	8.72	Clear
15:00	~3.9	175	35.96	10.61	4.80	138	2.44	272.7	10.01	Clear
15:05	~5.4	"	35.94	10.45	4.85	135	2.52	277.2	85.70	orange flock
15:10	~6.8	"	35.96	10.74	4.83	133	3.04	280.5	40.3	Clear w/flock
15:15	~8.4	"	35.94	10.84	4.82	133	3.18	282.1	27.9	Clear
15:20	~9.8	"	35.94	10.79	4.80	133	3.39	288.5	20.2	Clear
15:25	~11.3	"	35.95	10.82	4.79	132	3.42	292.0	42.6	Clear
15:30	~12.87	"	35.95	10.64	4.80	133	3.44	294.8	34.9	Clear
15:35	~14.3	"	35.95	10.71	4.80	133	3.45	296.1	33.2	Clear
15:40	~15.8	"	35.95	10.71	4.81	133	3.45	293.2	310.2	Clear
15:45	~17.80	"	35.95	10.73	4.80	132	3.44	293.7	35.3	clear

Acceptance Criteria: <0.3ft 3% ±0.1 3% 10% ± 10mv 10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
15:45	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 3 -MW 1 - 2015-03-25	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

AM  
Signature

3-25-15  
Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38

Location: Bethpage, NY

Well ID: RW 3 - MW 2

17:45

Start Time: 16:20 End Time: 18:15

Well Construction: 4"

Depth to Water: 37.62

Well Depth: 49.5

Water Column: 455.38

Total Volume Removed (L): 26.75

Dedicated Pump in Well?: No

Date: 03/25/15

Sampler: RM/RH

PID: -----



### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100058
LaMotte	2020e	1862
QED	MP15	Rental
Marschalk Bladder Pump	24"	ID# 73814

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
1750	1.125	225	37.62	9.42	4.91	91	4.67	289.4	6.30	clear
1755	2.25	225	39.58	9.61	4.90	91	4.29	289.7	4.60	clear
1800	3.375	225	39.59	9.98	4.93	90	3.77	290.0	3.29	clear
1805	4.5	225	39.59	10.27	4.95	91	3.46	291.4	3.06	clear
1810	5.62	225	39.59	10.50	4.96	89	3.28	293.3	1.96	clear
1815	6.75	225	39.58	10.51	4.94	90	3.28	294.5	1.77	clear
1820	225	3								

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
18:15	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 3 - MW 2 - 20150325	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

initial attempt to purge @ 16:20 - NO water after 20 min - pulled pump, replaced air line - all OK replaced pump & reattempted purge.

RM

Signature

3-25-15

Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 3

Date: 03/25/15  
 Sampler: PM/RH  
 PID: -----



Start Time: 12:00 End Time: 12:30

Well Construction: 4"

Depth to Water: 37.65

Well Depth: 340

Water Column: 302.35

Total Volume Removed (L): ~7.5

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100058
LaMotte	2020e	18102
QED	MP15	Rental
Marschalk Bladder Pump	24"	ID# 73814

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC ( $\mu\text{S}/\text{cm}^3$ )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
12:10	2.5	250	37.71	14.25	5.19	150	3.20	223.6	9.19	clear
12:15	3.75	250	37.73	14.19	5.15	151	1.72	227.3	10.93	clear
12:20	5.0	--	37.68	14.27	5.09	152	1.62	239.0	8.73	clear
12:25	6.25	--	37.64	14.10	5.08	152	1.51	239.6	8.47	clear
12:30	7.5	--	37.63	14.45	5.08	151	1.51	234.1	8.41	clear

Acceptance Criteria: <0.3ft 3%  $\pm 0.1$  3% 10%  $\pm 10\text{mv}$  10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
12:30	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 3 - MW 3 - 20150315	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)
	+ M3MSD FOR VOCs & Hg				
	+ DUP for all parameters				

### Comments

\_\_\_\_\_  
 \_\_\_\_\_

Pch

Signature

3-25-15

Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: RW 3 - MW 4

Date: 03/25/15  
 Sampler: RM/RH  
 PID: \_\_\_\_\_



Start Time: 13:30 End Time: 14:00

Well Construction: 4"

Depth to Water: 38.70

Well Depth: 475

Water Column: 434.24

Total Volume Removed (L): ~ 2.50

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100058
LaMotte	2020e	1862
QED	MP15	Rental 2
Marschalk Bladder Pump	24"	ID# 22259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
13:30	2.25	225	38.55	13.05	5.07	163	5.42	237.3	3.30	Clear
13:35	1.35	225	38.55	13.93	4.74	173	2.80	258.5	2.63	Clear
13:40	1.52	225	38.55	14.00	4.68	173	1.33	269.5	1.93	Clear
13:45	1.8	225	38.55	14.00	4.72	162	1.11	272.4	1.02	Clear
13:50	2.0	225	38.55	14.00	4.70	168	1.13	281.3	0.63	Clear
13:55	2.25	225	38.55	14.02	4.68	180	1.17	280.6	0.73	Clear
14:00	2.50	225	38.56	14.01	4.65	180	1.18	280.7	0.62	Clear

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

± 10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
14:00	NWIRP-GM-38-GW-	40 mL CG	3	---	TCL VOCs (624)
	RW 3-MW4 - 20150325	500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

AM  
Signature

3-25-15  
Date

# H&S Environmental, Inc.

## Low Flow/ Low Stress Groundwater Sampling Log

Project: NWIRP Bethpage - GM-38  
 Location: Bethpage, NY  
 Well ID: TP1

Date: 03/25/15  
 Sampler: RM/RH  
 PID: -----



Start Time: 09:10 End Time: 09:50

Well Construction: 4"  
 Depth to Water: 35.60  
 Well Depth: 470.00  
 Water Column: 434.4  
 Total Volume Removed (L): ~40.00

Dedicated Pump in Well?: No

### Field Testing Equipment

Make	Model	Serial #
YSI	556	14F100055
LaMotte	2020e	1862
QED	MP15	Rental 1
Marschalk Bladder Pump	24"	ID# 22259

Time (hh:mm)	Volume Removed (L)	Flow Rate (mL/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm <sup>6</sup> )	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color
09:20	1.50	150	35.64	10.01	6.77	215	9.01	180.6		Clear
09:30	2.0	150	35.63	10.73	6.30	190	8.19	185.9	4.13	Clear
09:35	3.75	"	35.62	10.78	6.23	179	8.00	185.0	1.46	Clear
09:40	4.50	"	35.62	10.79	6.21	176	7.90	183.7	9.6	Clear
09:45	5.25	"	35.62	10.93	6.18	175	7.74	182.2	0.53	Clear
09:50	6.0	"	35.62	10.97	6.18	173	7.70	181.4	0.24	Clear

Acceptance Criteria:

<0.3ft

3%

±0.1

3%

10%

±10mv

10%

2" Screen Volume = 0.16 gal/ft

6" Screen Volume = 1.46 gal/ft

4" Screen Volume = 0.64 gal/ft

### Sample Collection

Time	Sample ID	Container	# Bottles	Preservative	Analysis
09:50	NWIRP-GM-38-GW-TP1-20150325	40 mL CG	3	---	TCL VOCs (624)
		500 mL PL	1	HNO <sub>3</sub>	Hg (245.1)
		250 mL PL	1	---	TSS (SM2540D)

### Comments

\_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

  
 Signature

3-25-15

Date



## Instrument Calibration Log

Project/Site Name: NWIRP Bethpage – GM-38

Date: 03/25/15

Weather: clear 27°F

Calibrated By: P. MASTROCOLA

Instrument: YSI 556

Serial Number: 14F100055

Parameters	Morning Calibration Time: 0730	Cal. Temperature °C	Afternoon Cal. Check Time: 1930	Comments
Conductivity 1413 ( $\mu\text{S}/\text{cm}^{\circ}$ )	1535 / 1413	5.79 4.63	1415	
pH (7)	7.13 / 7.00	5.74	7.02	
pH (4)	3.90 / 4.00	5.19	4.10	
pH (10)	10.15 / 10.00	5.77	10.01	
ORP 240 (mv)	239.60 / 240.0	551	221.4	
Dissolved Oxygen (%)	99.4 / 100.1	6.68	83.29	
Zero Dissolved Oxygen (mg/L)	—	—	—	
Barometric Pressure (mmHg)	747.8	—	741.4	

pH Check (Every 3 hrs):

(NJ only)

Time:  
Standard: NA  
Reading:

Time:  
Standard: NA  
Reading:

Time:  
Standard: NA  
Reading:

Signature: PM

Date: 3-25-15



## Instrument Calibration Log

Project/Site Name: NWIRP Bethpage - GM-38

Date: 03/26/15

Weather: Cloudy overcast 43°

Calibrated By: RMASHCOLA

Instrument: YSI 556

Serial Number:  
14F100055

Parameters	Morning Calibration Time: 0740	Cal. Temperature °C	Afternoon Cal. Check Time: 10:30	Comments
Conductivity 1413 ( $\mu\text{S}/\text{cm}^{\circ}$ )	1415 / 1413	18.09	1426	
pH (7)	7.02 / 7.00	17.99	7.03	
pH (4)	4.10 / 4.00	18.14	4.16	
pH (10)	10.01 / 10.00	18.31	9.98	
ORP 240 (mv)	221.4 / 240.0	17.44	230.1	
Dissolved Oxygen (%)	83.21 / 100.0	16.36	96.2	
Zero Dissolved Oxygen (mg/L)	—	—	—	
Barometric Pressure (mmHg)	761.4	—	—	

pH Check (Every 3 hrs): Time: Standard: NA Time: Standard: NA Time: Standard: NA  
(NJ only) Reading: Reading: Reading:

Signature: PM

Date: 3-26-15



## Instrument Calibration Log

Project/Site Name: NWIRP Bethpage GM-38

Calibrated By: Rmastrocola

Instrument/Serial Number	Pre-Cal 1-AM (NTU)	Pre-Cal 1-PM (NTU)	Pre-Cal 10-AM (NTU)	Pre-Cal 10-PM (NTU)	Post-Cal 1-AM (NTU)	Post-Cal 1-PM (NTU)	Post-Cal 10-AM (NTU)	Post-Cal 10-PM (NTU)	Date
LaMotte 2020e									
1862	0.90	0.92	10.68	10.55	1.00	1.00	10.00	10.00	Time: & 3/25/15
1802	0.92	0.98	10.55	10.16	1.00	1.00	10.00	10.00	Time: 0745 & 1935 3/26/15 Time: 0740 & 1030
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &
									Time: &

Signature: DM

Date: 3-26-15



Environmental • Industrial Hygiene • Field Services

34 Dogwood Lane • Middletown, PA 17057 • 717.944.5541 • Fax: 717.944.1430

# CHAIN OF CUSTODY!

## REQUEST FOR ANALYSIS

ALL SHADED AREAS MUST BE COMPLETED BY THE  
CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Page 1 of 2

Courier:

Tracking #:

Co. Name: H&S Environmental, Inc.

Contact (Report to): Jen Good

Address: 160 E. Main St., Suite 2F  
Westborough, MA 01581

Phone: 508.366.7442

Bill to (if different than Report to):

PO#: 2031-507

Same

Project Name#: NWIRP Bethpage GM-38 Qtrly LTM

ALSI Quote #:

TAT:  Normal-Standard TAT is 10-12 business days.  
 Rush-Subject to ALSI approval and surcharges.

Date Required:

Approved By:

Email?  -Y jgood@hsenv.com  
Fax?  -Y No:

Sample Description/Location  
(as it will appear on the lab report)

COC Comments

Sample Date

Military Time

\*G or C

\*\*Matrix

TCL VOCs (Method 624)

Mercury (Method 245.1)

TSS (SM2540D)

Enter Number of Containers Per Analysis

- 1 BP-GM-38-GW-RW1-MW1- 20150325 03/25/15 11:15 G GW 3 1 1
- 2 BP-GM-38-GW-RW1-MW3- 20150325 03/25/15 19:15 G GW 3 1 1
- 3 BP-GM-38-GW-RW2-MW1- 20150326 03/26/15 08:50 G GW 3 1 1
- 4 BP-GM-38-GW-RW3-MW1- 20150325 03/25/15 15:45 G GW 3 1 1
- 5 BP-GM-38-GW-RW3-MW2- 20150325 03/25/15 15:15 G GW 3 1 1
- 6 BP-GM-38-GW-RW3-MW3- 20150325 MS/MSD for VOCs, Hg 03/25/15 12:30 G GW 9 3 1
- 7 BP-GM-38-GW-RW3-MW4- 20150325 03/25/15 14:00 G GW 3 1 1
- 8 BP-GM-38-GW-TP1- 20150325 03/25/15 09:50 G GW 3 1 1

SAMPLED BY (Please Print):

ROSA MASTROCOLA  
RANDY HOFFMASTER

LOGGED BY (signature):

DATE

TIME

REVIEWED BY (signature):

DATE

TIME

Relinquished By / Company Name

Date

Time

Received By / Company Name

Date

Time

1 RMASTROCOLA

3/26/15 09:45

2

3

4

5

6

7

8

9

10

Data Deliverables

- Standard
- CLP-like
- NJ-Reduced
- NJ-Full
- (other) \_\_\_\_\_

END  
Required?

If yes, format type:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

DOD Criteria Required?  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

State Samples Collected In?

- MD
- NJ
- NY
- PA

Other  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

PWSID  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ALSI FIELD SERVICES

- Pickup
- Labor
- Composite Sampling
- Rental Equipment
- Other

\* G=Grab; C=Composite

\*\*Matrix: AI=Air; DW=Drinking Water; GW=Groundwater; OI=Oil; OL=Other Liquid; SL=Sludge; SO=Soil; WP=Wipe; WW=Wastewater

\*\*\*Container Type: AG-Amber Glass; CG-Clear Glass, PL-Plastic. Container Size: 250ml, 500ml, 1L, 8oz., etc. Preservative: HCl, HNO3, NaOH, etc.



Environmental • Industrial Hygiene • Field Services  
34 Dogwood Lane • Middletown, PA 17057 • 717.944.5541 • Fax: 717.944.1430

# CHAIN OF CUSTODY/ REQUEST FOR ANALYSIS

ALL SHADED AREAS MUST BE COMPLETED BY THE  
CLIENT / SAMPLER. INSTRUCTIONS ON THE BACK.

Page 2 of 2

Courier:

Tracking #:

**Co. Name:** H&S Environmental, Inc.

**Contact (Report to):** Jen Good

**Address:** 160 E. Main St., Suite 2F  
Westborough, MA 01581

**Phone:** 508.366.7442

**Bill to** (if different than Report to):

PO#:

Same

**Project Name#:** NWIRP Bethpage GM-38 Qtrly LTM

**ALSI Quote #:**

TAT:	<input checked="" type="checkbox"/> Normal-Standard TAT is 10-12 business days.	Date Required:
	<input type="checkbox"/> Rush-Subject to ALSI approval and surcharges.	Approved By:

Email? <input checked="" type="checkbox"/>	-Y <u>jgood@hsenv.com</u>
Fax? <input type="checkbox"/>	-Y No.: _____

**Sample Description/Location**  
(as it will appear on the lab report)

**COC Comments**

Sample Date

Military Time

**G or C**

**Matrix**

TCL VOCs (Method 624)

Mercury (Method 245.1)

TSS (SM2540D)

**Enter Number of Containers Per Analysis**

1 BP-GM-38-GW-RW3-MW3-DUP-20150325

03/25/15 12:30

G

GW

3

1

1

2 BP-GM-38-FB-20150325

03/25/15 10:10

G

GW

3

1

3 BP-GM-38-TB-20150325

3

4

5

6

7

8

**SAMPLED BY (Please Print):**

ROSA MASTROCOLA  
RANDY HOFFMASTER

**LOGGED BY (signature):**

DATE

TIME

**REVIEWED BY (signature):**

DATE

TIME

**Relinquished By / Company Name**

Date

Time

**Received By / Company Name**

Date

Time

1 R. MASTROCOLA

3/26/15 09:45

2

3

4

5

6

7

8

9

10

**Data Deliverables**

Standard

SDWA Form?

MD

CLP-like

yes

NJ

NJ-Reduced

yes

NY

NJ-Full

yes

X

(other)

yes

PA

Other

yes

PWSID

DOD Criteria Required?

**Receipt information**  
(completed by Sample)

Performed by:  INITIAL HERE

Cooler Temp:

Therm. ID:

No. of Coolers:

Notes:

Correct containers?

Correct sample volume?

Correct preservation?

Headspace/Volatiles?

Circle appropriate Y or N.

Custody seals Present?

(If present) Seals intact?

Received on ice?

COC labels complete/accurate?

Container in good condition?

**ALSI FIELD SERVICES**

Pickup

Labor

Composite Sampling

Rental Equipment

Other:

\* G=Grab; C=Composite

\*\* Matrix: AI=Air; DW=Drinking Water; GW=Groundwater; OI=Oil; OL=Other Liquid; SL=Sludge; SO=Soil; WP=Wipe; WW=Wastewater

\*\*\* Container Type: AG-Amber Glass; CG-Clear Glass, PL=Plastic. Container Size: 250ml, 500ml, 1L, 8oz, etc. Preservative: HCl, HNO3, NaOH, etc.

**APPENDIX D**

**DATA VALIDATION REPORTS**

**VOLATILE ORGANIC COMPOUNDS**  
USEPA Region II –Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM

**Location:** 100 Broadway, Bethpage, NY

**Project Number:** 2031-507

**SDG #:** G2061789-HNW-089

**Client:** H&S Environmental, Inc.

**Date:** 05/14/2015

**Laboratory:** ALS Environmental, Middletown, PA

**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for nine (9) water samples, one (1) trip blank and one (1) field blank analyzed for Volatiles by EPA Method 624.
2. The samples were collected on 3/25 thru 26/2015. The samples were submitted to ALS Environmental, Middletown, PA on 3/27/2015 for analysis.
3. The USEPA Region II SOP HW-24, Revision No.: 2, 2008, Validating Volatile Organic Compounds by Gas Chromatography/Mass Spectrometry, SW-846 Method 8260B; USEPA National Functional Guidelines for Organic Data Review, EPA 540/R-99/008, October 1999; EPA Method 624 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Volatiles data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

### **Samples:**

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
BP-GM-38-GW-RW1-MW1-20150325	2061789001	3/25/2015	Water	
BP-GM-38-GW-RW1-MW3-20150325	2061789002	3/25/2015	Water	
BP-GM-38-GW-RW2-MW1-20150326	2061789003	3/26/2015	Water	
BP-GM-38-GW-RW3-MW1-20150325	2061789004	3/25/2015	Water	
BP-GM-38-GW-RW3-MW2-20150325	2061789005	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-20150325	2061789006	3/25/2015	Water	
BP-GM-38-GW-RW3-MW4-20150325	2061789007	3/25/2015	Water	
BP-GM-38-GW-TP1-20150325	2061789008	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-DUP-20150325	2061789009	3/25/2015	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW3-20150325
BP-GM-38-FB-20150325	2061789010	3/25/2015	Water	Field Blank
BP-GM-38-TB-20150325	2061789011	3/25/2015	Water	Trip Blank

### **Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

### **Holding Times:**

1. All water samples were analyzed within 14days from sample collection. No qualifications were required.
2. All water samples were properly preserved (pH<2.0). No qualifications were required.

### **GC/MS Tuning:**

1. All of the BFB tunes in the initial and continuing calibrations met the percent relative abundance criteria. No qualifications were required.

### **Initial Calibration:**

1. Initial calibration curve analyzed on 3/26/2015 (ms03.i) exhibited acceptable %RSD and average RRF values for all compounds with the following exception(s):

Compound	%D
Bromodichloromethane	16.9
Bromomethane	27.3
Carbon Tetrachloride	22.4
Chlorodibromomethane	34.8
2-Chloroethylvinyl ether	30.5
Cis-1,3-Dichloropropene	25.7
Trans-1,3-Dichloropropene	22.5

Client Sample ID	Laboratory Sample ID	Compound	Action
BP-GM-38-GW-RW1-MW1-20150325	2061789001	Bromodichloromethane, Bromomethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	UJ
BP-GM-38-GW-RW1-MW3-20150325	2061789002	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ UJ UJ UJ
BP-GM-38-GW-RW2-MW1-20150326	2061789003	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ UJ UJ UJ
BP-GM-38-GW-RW3-MW1-20150325	2061789004	Bromomethane, Bromodichloromethane,	J UJ

Client Sample ID	Laboratory Sample ID	Compound	Action
		Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	UJ UJ UJ UJ UJ
BP-GM-38-GW-RW3-MW2-20150325	2061789005	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ UJ UJ UJ
BP-GM-38-GW-RW3-MW3-20150325	2061789006	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ R <sup>(1)</sup> UJ UJ
BP-GM-38-GW-RW3-MW4-20150325	2061789007	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ UJ UJ UJ
BP-GM-38-GW-TP1-20150325	2061789008	Bromomethane, Bromodichloromethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	J UJ UJ UJ UJ UJ UJ
BP-GM-38-GW-RW3-MW3-DUP-20150325	2061789009	Bromodichloromethane, Bromomethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	UJ
BP-GM-38-FB-20150325	2061789010	Bromodichloromethane, Bromomethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether,	UJ

Client Sample ID	Laboratory Sample ID	Compound	Action
		Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	
BP-GM-38-TB-20150325	2061789011	Bromodichloromethane, Bromomethane, Carbon Tetrachloride, Chlorodibromomethane, 2-Chloroethylvinyl ether, Cis-1,3-Dichloropropene, Trans-1,3-Dichloropropene	UJ

(1) Results for this compound were qualified rejected (R) due to very low MS/MSD %R.

#### **Continuing Calibration Verification (CCV):**

- CCV analyzed on 3/27/2015 @ 19:32 (ms03.i) exhibited acceptable %Ds ( $\leq 15.0\%$ ) for all compounds with the following exception(s):

Compound	%D
Bromoform	-25.3
Bromomethane <sup>(1)</sup>	-18.6
2-chloroethylvinyl ether <sup>(1)</sup>	15.6
1,1-dichloroethene	22.7
Trans-1,2-dichloroethene	17.1
Methylene chloride	15.3

(1) Results for these compounds were previously qualified due to ICV criteria.

Client Sample ID	Laboratory Sample ID	Compound	Action
BP-GM-38-GW-RW1-MW1-20150325	2061789001	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ UJ J J UJ
BP-GM-38-GW-RW1-MW3-20150325	2061789002	Bromomethane, Bromoform, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ UJ J UJ UJ
BP-GM-38-GW-RW2-MW1-20150326	2061789003	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene	UJ UJ J UJ

Client Sample ID	Laboratory Sample ID	Compound	Action
		Methylene chloride	UJ
BP-GM-38-GW-RW3-MW1-20150325	2061789004	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-GW-RW3-MW2-20150325	2061789005	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-GW-RW3-MW3-20150325	2061789006	Bromoform, Bromomethane, 2-chloroethylvinyl ether <sup>(1)</sup> 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ R <sup>(1)</sup> J UJ UJ
BP-GM-38-GW-RW3-MW4-20150325	2061789007	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-GW-TP1-20150325	2061789008	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-GW-RW3-MW3-DUP- 20150325	2061789009	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-FB-20150325	2061789010	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ
BP-GM-38-TB-20150325	2061789011	Bromoform, Bromomethane, 2-chloroethylvinyl ether, 1,1-dichloroethene, Trans-1,2-dichloroethene Methylene chloride	UJ UJ J UJ UJ

(1) Results for this compound were qualified rejected (R) due to very low MS/MSD %R.

**Surrogates:**

1. All surrogates %REC values for all water samples and associated QC were within the laboratory control limits. No qualifications were required.

**Internal Standard (IS) Area Performance:**

1. All samples exhibited acceptable area count for all three internal standards. No qualifications were required.

**Method Blank (MB), Storage Blank (SB), Trip Blank (TB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):**

1. Method Blank (2156358) analyzed on 3/28/2015 was free of contamination. No qualifications were required.
2. Field Blank (BP-GM-38-FB-20150325) (2061789010) analyzed on 3/28/2015 was free of contamination with the exception of the following:

Sample ID	Compound	Result ( $\mu\text{g/l}$ )	Action Level (5x)* ( $\mu\text{g/l}$ )	Sample(s) Affected	Action
2061789010	Bromomethane	0.34	1.7	NWIRP-GM-38-GW-RW2-MW1-20140325 NWIRP-GM-38-GW-RW3-MW1-20140325 NWIRP-GM-38-GW-RW3-MW4-20140326 NWIRP-GM-38-GW-RW1-MW1-20140324 NWIRP-GM-38-GW-RW1-MW3-20140325 NWIRP-GM-38-GW-RW3-MW2-20140325 NWIRP-GM-38-GW-RW3-MW3-20140326 NWIRP-GM-38-GW-TP1-20140325 NWIRP-GM-38-GW-RW1-MW1-DUP NWIRP-GM-38-TB-20140324	None U U U U U U U U None None

3. Trip Blank (BP-GM-38-TB-20150325) (2061789011) analyzed on 3/28/2015 was free of contamination. No qualifications were required.

**Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):**

1. Laboratory Control Sample (2155880) was analyzed on 03/28/2015. All %RECs were within the laboratory control limits. No qualifications were required.
2. Laboratory Control Sample (2156359) was analyzed on 03/28/2015. All %RECs were within the laboratory control limits. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-GW-RW3-MW3-DUP20150325 (2061789009) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW3-20150325 (2061789006). All RPDs were  $\leq$ 50.0%. No qualifications were required.

Field Sample	Compound	Analytical Method	Result	Units	Field Duplicate	Result	Units	RPD	Qualifier
BP-GM-38-GW-RW3-MW3-20150325	1,1,1-Trichloroethane	EPA 624	0.48	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	0.45	$\mu\text{g/l}$	6.5	None
BP-GM-38-GW-RW3-MW3-20150325	1,1-Dichloroethane	EPA 624	1.8	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	1.8	$\mu\text{g/l}$	0	None
BP-GM-38-GW-RW3-MW3-20150325	1,1-Dichloroethene	EPA 624	1.5	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	1.4	$\mu\text{g/l}$	6.9	None
BP-GM-38-GW-RW3-MW3-20150325	Chloroform	EPA 624	0.4	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	0.33	$\mu\text{g/l}$	19.2	None
BP-GM-38-GW-RW3-MW3-20150325	Cis-1,2-Dichloroethene	EPA 624	1.3	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	1.3	$\mu\text{g/l}$	0	None
BP-GM-38-GW-RW3-MW3-20150325	Tetrachloroethene	EPA 624	0.36	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	0.37	$\mu\text{g/l}$	2.7	None
BP-GM-38-GW-RW3-MW3-20150325	Trichloroethene	EPA 624	182	$\mu\text{g/l}$	BP-GM-38-GW-RW3-MW3-DUP-20150325	184	$\mu\text{g/l}$	1.1	None

**Matrix Spike (MS)/ Matrix Spike Duplicate (MSD):**

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample BP-GM-38-GW-RW3-MW3-20150325 (2061789006). All %RECs and RPDs were within the laboratory control limits with the following exception(s):

Compound	%REC/%REC/RPD	Action
2-Chloroethylvinyl ether	0/0/A	R

NA= Not Applicable; A=Acceptable

**Compound Quantitation and Reported Contract Required Quantitation Limits (CRQLs):**

1. All results were within the linear calibration range. No qualifications were required.

**Target Compound Identification:**

1. All Relative Retention Times (RRTs) of the reported compounds were within  $\pm$  0.06 RRT units of the standard (opening CCV).
2. Sample compound spectra were compared against the laboratory standard spectra.
3. No QC deviations were observed.

**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: G2061789-HNW-089.

**MERCURY**  
USEPA Region II – Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM  
**Location:** 100 Broadway, Bethpage, NY  
**Project Number:** 2031-507  
**SDG #:** G2061789-HNW-089  
**Client:** H&S Environmental, Inc.  
**Date:** 05/14/2015  
**Laboratory:** ALS Environmental, Middletown, PA  
**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for nine (9) water samples and one (1) field blank analyzed for Mercury by EPA Method 245.1.
2. The samples were collected on 3/25 thru 26/2015. The samples were submitted to ALS Environmental, Middletown, PA on 3/27/2015 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Mercury data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

**Samples:**

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
BP-GM-38-GW-RW1-MW1-20150325	2061789001	3/25/2015	Water	
BP-GM-38-GW-RW1-MW3-20150325	2061789002	3/25/2015	Water	
BP-GM-38-GW-RW2-MW1-20150326	2061789003	3/26/2015	Water	
BP-GM-38-GW-RW3-MW1-20150325	2061789004	3/25/2015	Water	
BP-GM-38-GW-RW3-MW2-20150325	2061789005	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-20150325	2061789006	3/25/2015	Water	
BP-GM-38-GW-RW3-MW4-20150325	2061789007	3/25/2015	Water	
BP-GM-38-GW-TP1-20150325	2061789008	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-DUP-20150325	2061789009	3/25/2015	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW3-20150325
BP-GM-38-FB-20150325	2061789010	3/25/2015	Water	Field Blank

**Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

**Holding Times:**

1. All water samples were digested and analyzed within the 28 days holding times for Mercury. No qualifications were required.

**Initial and Continuing Calibration Verification (ICV and CCV):**

1. The correlation coefficient for Mercury calibration curve analyzed was  $\geq 0.995$ . No qualifications were required.
2. All ICVs and CCVs %REC values were within the QC limits (80-120%). No qualifications were required.

**Blanks (Method Blank, ICB and CCB):**

1. All ICBs and CCBs were free of contamination. No qualifications were required.
2. Method Blank (2158620) digested on 4/02/2015 was free of contamination. No qualifications were required.
3. Method Blank (2159123) digested on 04/03/2015 was free of contamination. No qualifications were required.

**Field Blank (FB) and Equipment Blank (EB):**

1. Field Blank (BP-GM-38-FB-20150325) (2061789010) analyzed on 4/03/2015 was free of contamination. No qualifications were required.

**Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):**

1. Mercury %REC in Laboratory Control Sample (2158621) analyzed on 04/02/2015 was within the laboratory control limits. No qualifications were required.
2. Mercury %REC in Laboratory Control Sample (2159124) analyzed on 04/03/2015 was within the laboratory control limits. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-GW-RW3-MW3-DUP20150325 (2061789009) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW3-20150325 (2061789006). Both samples were reported as non-detects. No qualifications were required.

**Matrix Spike (MS)/ Matrix Spike Duplicate (MSD) and Duplicate:**

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample BP-BP-GM-38-GW-RW3-MW3-20150325 (2061789006). All %RECs and RPD were within the laboratory control limits. No qualifications were required.
2. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample BP-BP-GM-38-GW-RW3-MW3-DUP-20150325 (2061789009). All %RECs and RPD were within the laboratory control limits. No qualifications were required.

**Compound Quantitation and Reported Detection Limits:**

1. All sample results were reported within the linear calibration range.

**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: G2061789-HNW-089.

**GENERAL CHEMISTRY**  
USEPA Region II – Data Validation

**Project Name:** Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM  
**Location:** 100 Broadway, Bethpage, NY  
**Project Number:** 2031-507  
**SDG #:** G2061789-HNW-089  
**Client:** H&S Environmental, Inc.  
**Date:** 05/14/2015  
**Laboratory:** ALS Environmental, Middletown, PA  
**Reviewer:** Sherri Pullar

**Summary:**

1. Data validation was performed on the data for nine (9) water samples analyzed for Solids, Total Suspended (TSS) by SM20<sup>th</sup> 2540D.
2. The samples were collected on 3/25 thru 26/2015. The samples were submitted to ALS Environmental, Middletown, PA on 3/27/2015 for analysis.
3. The USEPA Region II SOP No. HW-2, Revision 13, September 2006, Validation of Metals for Contract Laboratory Program (CLP), SOW-ILM05.3 (SOP Revision 13); USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-04-004, October 2004 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Solids, Total Suspended data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

### **Samples:**

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
BP-GM-38-GW-RW1-MW1-20150325	2061789001	3/25/2015	Water	
BP-GM-38-GW-RW1-MW3-20150325	2061789002	3/25/2015	Water	
BP-GM-38-GW-RW2-MW1-20150326	2061789003	3/26/2015	Water	
BP-GM-38-GW-RW3-MW1-20150325	2061789004	3/25/2015	Water	
BP-GM-38-GW-RW3-MW2-20150325	2061789005	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-20150325	2061789006	3/25/2015	Water	
BP-GM-38-GW-RW3-MW4-20150325	2061789007	3/25/2015	Water	
BP-GM-38-GW-TP1-20150325	2061789008	3/25/2015	Water	
BP-GM-38-GW-RW3-MW3-DUP-20150325	2061789009	3/25/2015	Water	Field Duplicate of sample BP-GM-38-GW-RW3-MW3-20150325

### **Sample Conditions/Problems:**

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

### **Holding Times:**

1. All water samples were analyzed within the 7 days holding times for Solids, Total Suspended. No qualifications were required.

**Method Blank (MB), Storage Blank (SB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):**

1. Method Blank (2156562) analyzed on 3/28/2015 was free of contamination. No qualifications were required.
2. Method Blank (2157926) analyzed on 3/31/2015 was free of contamination. No qualifications were required.

**Field Duplicate:**

1. Sample BP-GM-38-GW-RW3-MW3-DUP-20150325 (2061789009) was collected as field duplicate for sample BP-GM-38-GW-RW3-MW3-20150325 (2061789006). Both samples were reported as non-detects. No qualifications were required.

**Laboratory Duplicate:**

1. Sample Duplicate was performed on sample BP-GM-38-GW-TP1-20150325 (2061789008). All RPDs were within the laboratory control limits. No qualifications were required.

**Compound Quantitation and Reported Detection Limits:**

1. All sample results were reported within the linear calibration range.

**Comments:**

1. Validation qualifiers (if required) were entered into the EDD for SDG: G2061789-HNW-089.



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-FB-20150325	2061789010	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Tetrachloroethene	1	ug/L	U	0.26	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	cis-1,2-Dichloroethene	1	ug/L	U	0.26	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Chloroform	1	ug/L	U	0.15	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,1,1-Trichloroethane	1	ug/L	U	0.27	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Bromomethane	0.34	ug/L	UJ	0.27	2
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,1-Dichloroethane	1	ug/L	U	0.19	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,1-Dichloroethene	1	ug/L	UJ	0.17	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-FB-20150325	2061789010	624	20150325	1	Trichloroethene	1	ug/L	U	0.21	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-FB-20150325	2061789010	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW1-MW1-20150	2061789001	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,1,1-Trichloroethane	1	ug/L	U	0.27	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,1-Dichloroethane	5.1	ug/L		0.19	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,1-Dichloroethene	2.2	ug/L	J	0.17	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Bromomethane	2	ug/L	UJ	0.27	2
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Chloroform	1	ug/L	U	0.15	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	cis-1,2-Dichloroethene	39.5	ug/L		0.26	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Tetrachloroethene	0.3	ug/L	J	0.26	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	trans-1,2-Dichloroethene	0.79	ug/L	J	0.12	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Trichloroethene	99.5	ug/L		0.21	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW1-MW1-20150	2061789001	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW1-MW3-20150	2061789002	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW1-MW3-20150	2061789002	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Tetrachloroethene	1	ug/L	U	0.26	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	cis-1,2-Dichloroethene	0.54	ug/L	J	0.26	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Chloroform	0.79	ug/L	J	0.15	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,1,1-Trichloroethane	1.5	ug/L		0.27	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Bromomethane	0.39	ug/L	UJ	0.27	2
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Chloromethane	0.29	ug/L	J	0.25	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,1-Dichloroethane	8.1	ug/L		0.19	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,1-Dichloroethene	2.3	ug/L	J	0.17	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,1,2-Trichloroethane	0.43	ug/L	J	0.3	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	Trichloroethene	2	ug/L		0.21	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW1-MW3-20150	2061789002	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	245.1	20150326	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW2-MW1-20150	2061789003	2540D	20150326	1	Total Suspended Solids	17	mg/L		5	5
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,2-Dichloroethane	0.41	ug/L	J	0.22	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Toluene	0.26	ug/L	J	0.12	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Tetrachloroethene	1	ug/L	U	0.26	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	cis-1,2-Dichloroethene	2.6	ug/L		0.26	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Chloroform	0.46	ug/L	J	0.15	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Benzene	0.56	ug/L	J	0.16	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,1,1-Trichloroethane	1	ug/L	U	0.27	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Bromomethane	0.59	ug/L	UJ	0.27	2
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,1-Dichloroethane	2.1	ug/L		0.19	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,1-Dichloroethene	0.61	ug/L	J	0.17	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	Trichloroethene	4.3	ug/L		0.21	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW2-MW1-20150	2061789003	624	20150326	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW3-MW1-20150	2061789004	2540D	20150325	1	Total Suspended Solids	12	mg/L		5	5
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Tetrachloroethene	2.2	ug/L		0.26	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	cis-1,2-Dichloroethene	1	ug/L	U	0.26	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Chloroform	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,1,1-Trichloroethane	0.35	ug/L	J	0.27	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Bromomethane	0.31	ug/L	UJ	0.27	2
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,1-Dichloroethane	0.64	ug/L	J	0.19	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,1-Dichloroethene	0.42	ug/L	J	0.17	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	Trichloroethene	41.8	ug/L		0.21	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW1-20150	2061789004	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW3-MW2-20150	2061789005	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Tetrachloroethene	1	ug/L	U	0.26	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,1,1-Trichloroethane	0.38	ug/L	J	0.27	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Chloroform	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,1-Dichloroethane	0.56	ug/L	J	0.19	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,1-Dichloroethene	0.33	ug/L	J	0.17	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Bromomethane	0.3	ug/L	UJ	0.27	2
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	cis-1,2-Dichloroethene	1.5	ug/L		0.26	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	Trichloroethene	159	ug/L		0.21	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW2-20150	2061789005	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW3-MW3-20150	2061789006	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Toluene	1	ug/L	U	0.12	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	R	0.28	2
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,1,1-Trichloroethane	0.48	ug/L	J	0.27	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,1-Dichloroethane	1.8	ug/L		0.19	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,1-Dichloroethene	1.5	ug/L	J	0.17	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Bromomethane	0.28	ug/L	UJ	0.27	2
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Chloroform	0.4	ug/L	J	0.15	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	cis-1,2-Dichloroethene	1.3	ug/L		0.26	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Tetrachloroethene	0.36	ug/L	J	0.26	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	Trichloroethene	182	ug/L		0.21	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW3-20150	2061789006	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,1,1-Trichloroethane	0.45	ug/L	J	0.27	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,1-Dichloroethane	1.8	ug/L		0.19	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,1-Dichloroethene	1.4	ug/L	J	0.17	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Chloroform	0.33	ug/L	J	0.15	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Bromomethane	2	ug/L	UJ	0.27	2
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	cis-1,2-Dichloroethene	1.3	ug/L		0.26	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Tetrachloroethene	0.37	ug/L	J	0.26	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	Trichloroethene	184	ug/L		0.21	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,1,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW3-DUP-2	2061789009	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-RW3-MW4-20150	2061789007	2540D	20150325	1	Total Suspended Solids	5	mg/L		5	5



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Tetrachloroethene	1	ug/L	U	0.26	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	cis-1,2-Dichloroethene	1	ug/L	U	0.26	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Chloroform	1.2	ug/L		0.15	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,1,1-Trichloroethane	0.6	ug/L	J	0.27	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Bromomethane	0.33	ug/L	UJ	0.27	2
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,1-Dichloroethane	6.9	ug/L		0.19	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,1-Dichloroethene	1.3	ug/L	J	0.17	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	Trichloroethene	2.7	ug/L		0.21	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-RW3-MW4-20150	2061789007	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-GW-TP120150325	2061789008	245.1	20150325	1	Mercury, Total	0.0005	mg/L	U	0.00016	0.0005
BP-GM-38-GW-TP120150325	2061789008	2540D	20150325	1	Total Suspended Solids	5	mg/L	U	5	5
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,2-Dichloroethane	0.88	ug/L	J	0.22	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Tetrachloroethene	0.48	ug/L	J	0.26	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	cis-1,2-Dichloroethene	13.4	ug/L		0.26	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Chloroform	2.6	ug/L		0.15	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,1,1-Trichloroethane	1	ug/L	U	0.27	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Bromomethane	0.33	ug/L	UJ	0.27	2
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,1-Dichloroethane	2.5	ug/L		0.19	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,1-Dichloroethene	1.2	ug/L	J	0.17	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	Trichloroethene	52.3	ug/L		0.21	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,1,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-GW-TP120150325	2061789008	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Ethylbenzene	1	ug/L	U	0.16	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	cis-1,3-Dichloropropene	1	ug/L	UJ	0.12	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	trans-1,3-Dichloropropene	1	ug/L	UJ	0.14	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,4-Dichlorobenzene	1	ug/L	U	0.15	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Acrolein	30	ug/L	U	2.4	30
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,2-Dichloroethane	1	ug/L	U	0.22	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Acrylonitrile	5	ug/L	U	0.89	5
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Toluene	1	ug/L	U	0.12	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Chlorobenzene	1	ug/L	U	0.11	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	2-Chloroethylvinyl ether	2	ug/L	UJ	0.28	2
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Chlorodibromomethane	1	ug/L	UJ	0.22	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Tetrachloroethene	1	ug/L	U	0.26	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	cis-1,2-Dichloroethene	1	ug/L	U	0.26	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	trans-1,2-Dichloroethene	1	ug/L	UJ	0.12	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,3-Dichlorobenzene	1	ug/L	U	0.14	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,3-Dichloropropene, Tota	1	ug/L	U	0.19	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Carbon Tetrachloride	1	ug/L	UJ	0.24	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Chloroform	1	ug/L	U	0.15	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Benzene	1	ug/L	U	0.16	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,1,1-Trichloroethane	1	ug/L	U	0.27	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Bromomethane	2	ug/L	UJ	0.27	2
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Chloromethane	1	ug/L	U	0.25	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Chloroethane	1	ug/L	U	0.24	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Vinyl Chloride	2	ug/L	U	0.24	2
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Methylene Chloride	1	ug/L	UJ	0.32	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Bromoform	2	ug/L	UJ	0.21	2
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Bromodichloromethane	1	ug/L	UJ	0.13	1



**NWIRP BETHPAGE GM-38**  
**MARCH 2015 EVENT**  
**DATA SUMMARY TABLE**  
**AQUEOUS**  
**SDG: 2061789, HNW-089**

Sample Name	Lab ID	Analytical Method	Sample Date	Dilution Factor	Analyte	Result	Unit	Qualifier	DL	LOD
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,1-Dichloroethane	1	ug/L	U	0.19	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,1-Dichloroethene	1	ug/L	UJ	0.17	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Trichlorofluoromethane	1	ug/L	U	0.21	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,2-Dichloropropane	1	ug/L	U	0.24	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,1,2-Trichloroethane	1	ug/L	U	0.3	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	Trichloroethene	1	ug/L	U	0.21	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,1,2,2-Tetrachloroethane	1	ug/L	U	0.22	1
BP-GM-38-TB-20150325	2061789011	624	20150325	1	1,2-Dichlorobenzene	1	ug/L	U	0.2	1